



Annual Groundwater and Drinking Water Program Review



Calendar Year 2022

Illinois Environmental Protection Agency

**Annual Groundwater and Drinking Water Program
Review
Calendar Year 2022**

**Illinois Environmental Protection Agency
Bureau of Water
Division of Public Water Supplies**

Annual Compliance Report for 2022

Introduction

Each year, the Illinois Environmental Protection Agency (Illinois EPA) provides citizens and the United States Environmental Protection Agency (U.S. EPA) with a report on the status of public drinking water in Illinois. This report provides both an assessment of how well public water supply systems are doing at meeting the standards set in the federal Safe Drinking Water Act and insights about current challenges faced by public water suppliers.

Ongoing attention, investment, and response to new and ongoing challenges to our water resources is needed to maintain the ability to rely on an adequate supply of safe water. Sustainable water resources are critical to personal and public health. Protecting water sources, treating the water, and testing the water after it is treated as part of the multi-barrier approach to assuring an adequate supply of water that is safe to drink.


Protecting and supplying safe water depends on many organizations and individuals. While the Illinois EPA administers and enforces the provisions of the federal Safe Drinking Water Act (SDWA) on behalf of the EPA, we rely on our partners in areas ranging from government to industry to non-profit organizations to take an active role and contribute in this quest. These partners include everyone, including individual citizens. Everyone plays a part in ensuring safe water. As always, our aim with this report is to provide a clear picture of what is done to protect the quality of the public drinking water in Illinois and the success of the efforts to do so.

In Illinois, regulatory oversight of public water systems (PWS)¹ is shared by the Illinois EPA and Illinois Department of Public Health (IDPH). The Illinois EPA was designated as Illinois' primary enforcement authority by the U.S. EPA on August 29, 1979. The Illinois EPA, through an Intergovernmental Funding Agreement has empowered the IDPH to administer the Non-Community PWS Program while the Illinois EPA retains regulatory authority over Community Water Systems (CWS)².


1 PWS serve 15 service connections or 25 residents.

2 CWS serve 15 or more year-round service connections or 25 or more year-round residents.

The Illinois EPA regulates 1,753 active Community Water Systems CWS's. Currently, 1,133 CWS's use groundwater sources, 620 use surface water sources or groundwater sources under the direct influence of surface water. 755 CWS's purchase water from other CWS's. A total of 12,057,572 persons are served by those systems; thirty eight (38) percent of that population is directly served from surface water systems. Thirty five (35) percent of the population is served by purchased surface water, two (2) percent by purchased groundwater, and twenty four (24) percent by groundwater systems. It is worth noting that although only 26 percent of the population is served by groundwater (including purchased groundwater), groundwater dependent systems comprise almost 65 percent of the total number of CWSs.

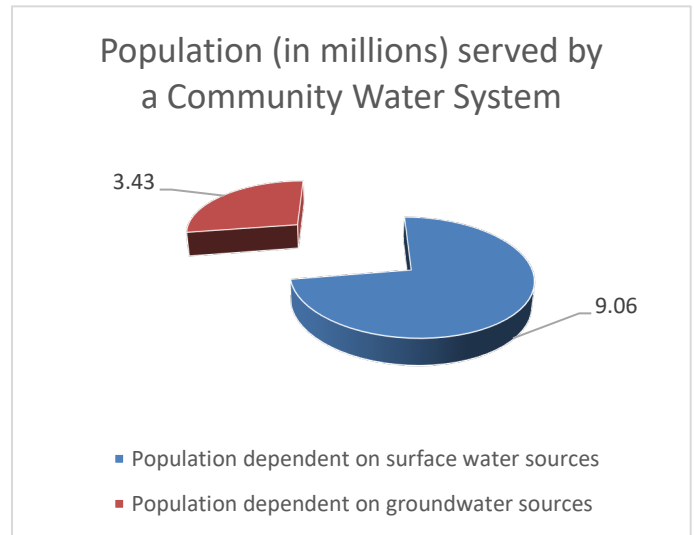

The Transient Non-Community (TNC) PWS served a population of 296,178 in 2022, while Non-Transient Non-Community (NTNC) PWS served a population of 161,457. A total of 387,790 persons are served by systems using groundwater, while only 69,847 persons are served by surface water. These numbers reflect the areas where Non-Community Public Water Systems (NCPWS) are located predominantly in rural or non-incorporated areas where groundwater is generally available as a source of potable water.

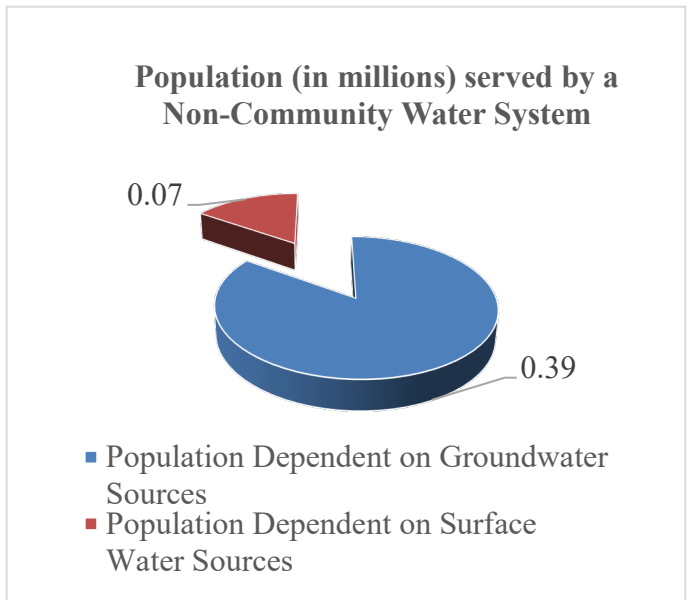

Statutory Background

The program to protect PWS in Illinois began in 1915 and has undergone considerable legal and regulatory restructuring over the years. In 1970, the General Assembly formulated the Illinois Environmental Protection Act (Act), 415 ILCS 5/14. They found that “state supervision of public water supplies is necessary in order to protect the public from disease and to assure an adequate source of pure water for all beneficial uses,” and “it is the purpose of this Title to assure adequate protection of public water supplies.” The Illinois Groundwater Protection Act (IGPA), 415 ILCS 55/1 was also adopted in 1987. Additionally, programs to protect groundwater were initiated by the Act in conjunction with “Water Quality Standards” for waters of the State that included underground water (35 Ill. Adm. Code Part 302). In 1991, the Illinois Pollution Control Board (IPCB) adopted comprehensive groundwater quality rules (35 Ill. Adm. Code Part 620).

The “core mission” of the Illinois EPA’s Division of Public Water Supplies (DPWS) is to ***assure that all persons served by community public water supplies receive water, which is safe in quality, clean, adequate in quantity and of satisfactory mineral character for ordinary domestic consumption.*** To accomplish this goal, the DPWS oversees the design, construction, and operation of CWSs in Illinois. More specifically, the Illinois EPA must review the safety and protection of drinking water source water, implement a permitting program for the design, construction, and operation of CWS treatment facilities, and maintain a surveillance program of water systems’ untreated and treated waters.

To support these activities, the DPWS has been staffed by a diverse contingent of engineers, geologists and scientists that comprise the Compliance Assurance (CAS), Field Operations (FOS), Groundwater (GWS), and Permit (PS) Sections. The DPWS is further supported by the Infrastructure and Financial Assistance Section (IFAS) of the Bureau of Water (BOW), the Division of Legal Counsel, the Division of Laboratories, the State of Illinois’ Central Management Services (CMS) and Department of Innovation and Technology (DoIT).

As mentioned previously, the IDPH supports the NCWS program through a series of rules including, but not limited to the Illinois Plumbing Code (77 Ill. Adm. Code 890); the Illinois Water Well Construction Code (415 ILCS 30); the Surface Source Water Treatment Code (77 Ill. Adm. Code 930); and the Drinking Water Systems Code (77 Ill. Adm. Code 900). The IDPH’s Division of Environmental Health works to reduce the incidence of disease and injury related to environmental factors that fall within five major areas of responsibility: rulemaking; plan reviews and construction permits; inspections; vocational and facility licensing; and engineering and toxicological reports.

To support these areas of responsibility within the NPWS, IDPH has field staff located in the IDPH’s six Regional Offices (RO) and leverages the resources of Local Health Departments (LHD). Compliance assurance and engineering services are generally conducted by staff located in the Central Office in Springfield. Consistent with the requirements of the SDWA, program activities include sanitary surveys, water analysis and reporting; plan review; technical assistance; and training and education.

Under the SDWA and subsequent amendments, the U.S. EPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs) and Maximum Residual Disinfectant Levels (MRDLs). For some regulations, treatment techniques (TT) are established in lieu of an MCL to control unacceptable levels of contaminants in water. The SDWA also requires PWS to notify their consumers when they have violated these regulations. The consumer notifications must provide an understandable explanation of the nature of the violation, its potential adverse health effects, steps that the PWS is undertaking to correct the violation and the possibility of using alternative water supplies during the violation.

Through the ongoing review of Illinois EPA’s programs, the U.S. EPA has granted the Illinois EPA primary enforcement authority to determine the frequency that CWS monitor and report on the contaminants present in their water. Generally, the larger the population served by a water system, larger the number of samples collected and the more frequent the monitoring and reporting (M&R) requirements. Additionally, the U.S. EPA supports the development of new MCLs by requiring CWS to monitor and report on currently unregulated contaminants (e.g., Unregulated Contaminant

Monitoring Regulation (UCMR)). As data are acquired for these contaminants, scientific analyses are conducted to determine the need for development of new MCLs.

In 1998, the Illinois EPA began making CWS revolving loans through a partnership with the U.S. EPA and the federal government. Since this time, the Illinois EPA has made more than \$2.8 billion in revolving loans to water systems. This money has gone to public water supply systems around the State to maintain compliance with federal and State laws and regulations and maintain and improve the State's drinking water infrastructure.

OVERVIEW OF THE PWS PROGRAMS IN ILLINOIS

Community Public Water Supply Surveillance Program

To sustain compliance with regulatory requirements and ensure the safety of Illinois CWS consumers, the Illinois EPA is committed to completing engineering evaluations (sanitary surveys) as frequently as possible. Through the DPWS' institutional knowledge, the more frequent the contact between the Illinois EPA and CWS, the higher the percentage of compliant water systems.

The focus of the Illinois EPA's inspections of CWS continues to be an evaluation of the general operation and maintenance practices at the respective systems. Inspectors evaluate CWS's compliance with Illinois Pollution Control Board rules, and various ancillary programs that affect the CWS, such as the regulations under the Title IV: Drinking Water Security and Safety of the *Public Health Security & Bioterrorism Preparedness & Response Act of 2002* (Public Act 107-188, June 12, 2002). Fundamental aspects of these inspections also revolve around the provision of technical assistance, identification of significant deficiencies and necessary corrective actions to ensure the safety of drinking water supplies. The engineering evaluations include an on-site review of the eight components of the sanitary survey, including source, treatment, distribution system, finished water storage, pumps, monitoring & reporting, management & operation, and operator compliance assessments. The DPWS conducts surveillance and inspections at CWS from six Regional Offices located in Rockford, Elgin, Champaign, Springfield, Collinsville, and Marion.

Field Operations Section (FOS)	
Chris Johnston, Manager	
Champaign Regional Office	Springfield Regional Office
Vacant, Manager	John Bartolomucci, EPS IV
Matt Talbert, P.E, EPE IV	Michael Dragovich, EPE III
Shane McCully, EPE III	Jamie Cowles, EPE III
Jeremy Chervinko, (April - 2023)	
Rockford Regional Office	Collinsville Regional Office
Kirk Bergstrom (Aug - 2023)	Vacant, Manager
Sneh H. Patel, EPE I (May-2023)	James Blessman, EPE III
Andrew Holloway, EPE II	Regan Taylor, EPE III
Fei Zaho, EPE I	
Elgin Regional Office	Marion Regional Office
Segundo Nallatan, P.E., Manager	Vacant, Manager
Dwayne Booker, EPE III	John Kinder, EPE III
Grover Hopkins, EPE III	Eric Lamczyk, EPE I (June- 2023)
Dharmishtha Patel, EPE III	
Shibu Vazha, EPE III	
Gopi Ramanathan, EPE III -	
Marlene Diamond (Admin. Support)	

With assistance of national stakeholder groups, the U.S. EPA has established that over the next two-year reporting cycle, state primary enforcement programs should complete sanitary surveys at a minimum of ninety percent (90%) of the CWSs in their state on a 3-year frequency rather than the eighty percent (80%) goal from previous reporting periods. In 2022, the Illinois EPA conducted 528 sanitary surveys, which was 90% of the total systems to be inspected for 2022. For the reporting period (2020-2022), the Illinois EPA has conducted sanitary surveys at approximately 77.31% percent (1,339 of 1,753) of the CWS under its regulatory authority.

Non-Community Public Water Supply Surveillance Program

The NCWS surveillance Program shares many commonalities with the CWS surveillance activities. Sanitary surveys are intended to review the adequacy of the water system’s source of water, facilities, equipment, operation, and maintenance to ensure the production and distribution of safe drinking water. Sanitary surveys for NCWS are intended to identify and correct significant deficiencies and are conducted once every two years by the IDPH or LHD field staff. IDPH Field Offices are located in Rockford, Peoria, Champaign, Marion, Edwardsville, and West Chicago. There are 93 LHDs throughout the State that help conduct NCWS surveillance and perform sanitary surveys. IDPH regional office staff and LHD staff that perform sanitary surveys generally work in several Public Health Surveillance Programs and many times conduct multiple program inspections while visiting a NCWS. IDPH Policy sets a goal for completing sanitary surveys once every two years, For the reporting period (2020-2022), the IDPH has conducted sanitary surveys at approximately 94.67 percent of the NTNCWS and 99.59 percent of the TNCWS under its regulatory authority.

Community Public Water Supply Compliance Assurance Program

To ensure Illinois CWSs are in compliance with State and federal statutes and regulations, the IPCB adopts identical in substance regulatory provisions from the U.S. EPA, per Section 5/7.2 of the Act. Ensuring that CWSs are in compliance with these regulations, which include MCLs in drinking water, is substantially the core mission of the Compliance Assurance Section (CAS). Additionally, CAS coordinates technical outreach to water systems to assure proactive compliance measures are taken ahead of formal enforcement. The DPWS conducts compliance efforts for CWSs from the Central Office in Springfield.

Compliance Assurance Section
Joey Logan Pugh, Manager (July 2022)
David Saladino, EPS III
Katherine Andring EPS III
Adam Nutt, EPS II
Sara Parmenter, EPS II
Mandy Trader, LSCT (March 2022)
Jasmine Hatcher-Moorman, LSCT (June-2023)
Corinne Cullina (July 3, 2023)
Kathryn Capranica (July - 2023)

Victoria Arnish (August - 2023)

Justin Burge (September - 2023)

Non-Community Public Water Supply Compliance Assurance Program

Similar to the CWS compliance program, the IDPH tracks water system compliance with state and federal statutes and regulations. All NCPWS are tested at least annually for total coliform bacteria and nitrate. NTNCWS are also tested for contaminants, such as pesticides, solvents, lead and copper, arsenic, metals, and disinfection byproducts. Responsibility for tracking water system compliance is shared by Regional and Central Office staff. Data tracking activities are conducted by Central Office Staff.

IDPH Non-Community Water Supply Program
Environmental Health Services Section Chief, Gerrin Cheek Butler
Eric Portz, P.E., Safe Drinking Water Program Manager - Non-Community Water Supplies
Jamie Tosetti, Environmental Health Specialist III
Jennifer Krick, Environmental Health Specialist II
Benjamin Koester, Environmental Health Specialist II
Maria Crain, Administrative Assistant

Community Public Water Supply Operator Certification Program

The Illinois Public Water Supply Operations Act (415 ILCS 45/1) establishes the statutory basis for the community water supply operator certification program in Illinois. This statute further establishes a reliable mechanism for Illinois EPA communications with CWS, ensuring that Responsible Operators in Charge (ROINC) supervise the portions of the CWS for which they are accountable, and requiring the timely submittal of information that the Illinois EPA relies upon to protect drinking water quality. Finally, this statute provides the basis for the regulatory requirements found in 35 Ill. Adm. Code Part 681. The most recent amendments to this Part became effective in 2017. The 2017 revisions to the regulation focused on further defining the experience requirements to become a licensed water supply operator in Illinois.

The Illinois EPA would also like to make note of our training partners. The operator training opportunities provided by the Environmental Resources Training Center at Southern Illinois University-Edwardsville, the Illinois Potable Water Supply Operators Association, Illinois Rural Water Association, Illinois Section of the American Water Works Association, and two-year colleges are critical to the successful treatment of potable water in Illinois. Whether large conferences, webinars, semester long classes, regional forums, or water system specific curricula, these educators, associations and individuals have afforded opportunities to water professionals in Illinois that are unparalleled across the country.

The Illinois EPA's CWS Operator Certification Program is administered by the CAS of the DPWS. The Illinois EPA estimates that this program requires approximately four full-time staff. The Operator Certification Program is coordinated by a staff member from the CAS of the DPWS:

Operator Certification Unit
Tatum DeMay, Operator Certification Coordinator EPS IV
Katherine Andring, EPS III
Adam Nutt, EPS II

Non-Community Public Water Supply Operator Certification Program

The IDPH NCWS program administers a program to properly credential NTNCWS from the Central Office in Springfield. The IDPH uses the services of the Water Quality Association to conduct initial Operator Certification Training and administer, certification examinations. The following IDPH Environmental Health Services staff is actively involved in the administration of the program:

Personnel
Eric Portz, Safe Drinking Water Program Manager
Maria Crain, Administrative Assistant

Community Public Water Supply Capacity Development Program

The 1996 SDWA required all states to develop and implement a new system program and existing system strategy for capacity development. Subsequently, Illinois had to ensure that all new CWSs and all new NTNC public water supply systems commencing operation after October 1, 1999, had adequate technical, managerial, and financial (TMF) capacity before commencing operation. Illinois adopted regulations to implement this requirement which can be found in Title 35 of the Ill. Adm. Code Part 652 and Title 77 of the Ill. Adm. Code Part 900. Illinois also had to develop and implement a strategy to help all existing CWS and NTNC public water supply systems achieve and maintain TMF capacity beginning October 1, 2000. Illinois submitted a Capacity Development Strategy for existing public water supplies in July 2000 to the U.S. EPA and the strategy was approved by the U.S. EPA on September 27, 2000. Illinois' Revised Capacity Development Strategy was reviewed and approved by the U.S. EPA on May 24, 2023. In Illinois, the Illinois EPA regulates CWS systems IDPH regulates NTNC public water supply systems.

It is difficult to estimate the full-time equivalents devoted to this program as it is integrated into all aspects of the drinking water program. In several recent U.S. EPA evaluations of the Illinois Capacity Development Program, U.S. EPA has expressed concerns that this program is understaffed. The Capacity Development program is now coordinated by a staff member from the Permit Section of the DPWS:

Personnel
Jenny Larsen, Capacity Development Coordinator

Non-Community Public Water Supply Capacity Development Program

The Safe Drinking Water Program Manager coordinates Capacity Development Program activities at IDPH. Currently, the Program Manager reviews new NTNC Public Water System Construction Permit Applications and performs capacity reviews on these new systems. When capacity reviews are needed at existing NTNC Public Water Systems, the Program Manager coordinates the reviews with water system personnel and RO/LHD field staff.

Cross-Connection Control Program

The Cross-Connection Control Program in Illinois is one of several tools intended to protect water consumers in the state. Statutes in Illinois establish that no person can threaten a water supply and water supply officials are responsible for protecting their water mains from connections that have the potential to allow the backflow of contaminants into their respective distribution systems (a cross-connection). Regulations have been adopted to outline what comprises a viable Cross-Connection Control Program.

Water supplies in Illinois have significant partners in the implementation of their Cross-Connection Control Program. While it is up to the Illinois EPA to ensure that CWS have viable programs through physical inspection of water treatment facilities and documentation reviews, the IDPH deals with the plumbing aspects of the program.

The Environmental Resources Training Center located at Southern Illinois University-Edwardsville provides for the training and certification of licensed plumbers who wish to become certified Cross-Connection Control Device Inspectors (CCCDI). While any Illinois licensed plumber can inspect plumbing, or install a backflow device or assembly, only an Illinois CCCDI can test that device or assembly. Additionally, the Illinois EPA relies upon the Environmental Resources Training Center to track continuing education requirements and renewal of CCCDI certifications. It is difficult to estimate the full-time equivalents devoted to this program, as the Cross-Connection Control Program is an integral piece of the DPWS program in Illinois.

Groundwater and Source Water Protection Program

The Groundwater and Source Water Protection Program in Illinois is framed by Public Acts 83-1268 and 85-063, and the SDWA Section 1453. These laws amended the Act, and created the Illinois Groundwater Protection Act (IGPA) 415 ILCS 55/1, and led to the development of IPCB regulations for groundwater quality standards and protection requirements. Further, the IGPA requires stakeholder input from the ICCG and Groundwater Advisory Council (GAC) on the development of groundwater protection programs, laws, and policies. The Act was amended to require the development and implementation of a “priority” Regional Groundwater Protection Planning Program comprised of local stakeholders. In addition, the IGPA requires the ICCG to undertake a comprehensive evaluation of progress being made under these laws with biennial reporting to the Governor and General Assembly. See the IGPA Biennial Report; https://www2.illinois.gov/epa/topics/water-quality/groundwater/wellhead-protection/Documents/2020_01_07_Final_IGPA_Report.pdf. In August of 2019, Part 604 of the

Board regulations required each CWS system that treats surface or groundwater as a primary or emergency supply of water to develop source water protection plans that must be approved by the Illinois EPA. The DPWS source water protection initiatives are generally managed from the Central Office in Springfield and the Rockford Office by the GWS of the DPWS.

Groundwater Section	
Michael Summers, P.G., Manager, Groundwater Section	
Source Water Protection Unit	Hydrogeology and Compliance Unit
Anthony Dulka, P.G., Manager	Vacant , Manager
Greg White, P.G., EPS III (Rockford Office)	Lynn Dunaway, P.G., Lead Geologist, EPS IV
Ryan Bennett, EPG III	Amy Zimmer, EPG III
Alan Fuhrman, EPG III	Lauren Martin, EPG III
Keri Beckham, EPG III	Justin Bierwagen, EPG I (Jan-02023)
Karen Bridges, EPG III	Heather Mullenax, EPG I (Jan-2023)

Permitting Program

Correct construction and operation of a PWS is essential for providing a safe and adequate supply of drinking water. The DPWS conducts all permitting functions for CWS from the Central Office in Springfield.

Permit Section	
David Cook, P.E., Manager	
Headquarters	Des Plains office
Vacant , EPE IV Lead Engineer	Jenny Larsen, Capacity EPE IV Lead Engineer
Kent Cook, P.G., GIS II	Ricardo, NG EPE I (May - 2023)
Todd Lamm, EPE I	Linda Wong EPE I (May - 2023)
Cody Bauer, EPE II	Jason Selling EPE I (May - 2023)
Eric Markhardt, EPE I	
Vacant , EPE IV Lead Engineer	
Chris Kahrman, EPE III	
Gerard Zimmer, EPE III	

The Safe Drinking Water Program Manager conducts all permitting functions for NTNCWS from the Central Office in Springfield.

Personnel
Eric Portz, Safe Drinking Water Program Manager

Public Water Supply Loan Program

The Public Water Supply Loan Program (PWSLP) is administered by the Illinois EPA’s BOW-Infrastructure Financial Assistance Section (IFAS). IFAS also administers the Water Pollution Control Loan Program. IFAS manages all aspects of the funding process with input from the DPWS. Detailed program information is available on the Illinois EPA web site at <https://www2.illinois.gov/epa/topics/grants-loans/state-revolving-fund/Pages/default.aspx> .

Generally, the first step toward the Illinois EPA working with an applicant to fund a project is the submittal of a planning report, called a “Project Plan” in Illinois Administrative Code (35 Ill. Adm. Code section 662) ; Illinois’ Administrative Loan Rules. An applicant must also complete a Project Planning Submittal Checklist which identifies the location of other necessary information for application processing. Once a scope of work is identified in a “Project Plan,” IFAS staff will distribute the planning report to the Permit Section and Field Operation Section for review and approval. The CAS is also consulted to ensure funding is provided to address the loan applicant’s most pressing needs. Once comments from each of these Sections are received, IFAS sends a review letter requesting any additional information that is needed or answers to any questions the Illinois EPA may have. IFAS then produces a Project Summary document and the loan applicant will be required to either hold a public hearing (if the potential for environmental issues exists or if financial impacts to the loan applicant’s residents are significant), or simply place an ad in the local newspaper announcing the proposed project and request for funding. The public hearing, or placement of an ad in the local newspaper, is followed by a 10-day public comment period allowing for the submission of written comments concerning the proposed project. Once the public comment period is over and IFAS receives proof of the public notification in the newspaper and any responses to any public comments, the Illinois EPA will issue Planning Approval. Planning Approval is good for five years. Therefore, once a scope of work has been identified and approved, the loan applicant can pursue funding for any portion(s) of that scope within the following five years.

The Illinois EPA’s revolving loan funding process is unlike that of a bank in the respect that the Illinois EPA does not offer the funding agreement until after the recipient has demonstrated a definitive need for the project, obtained Illinois EPA Planning Approval, obtained all necessary permits, demonstrated the means and ability to repay the funding, adopted all necessary ordinances to do so and then gone out to bid on the project. Once a “winning/low” bidder is identified, the Illinois EPA can issue the Loan Agreement followed by the loan applicant entering into the contract for construction of the project. The Illinois EPA can fund the construction costs as well as planning efforts, design engineering and construction engineering/oversight. As of July 1,

The U.S. EPA has determined that lead service line replacement is an eligible loan expense. Following a legislative amendment, the Illinois EPA processed its first lead service line replacement project in 2017.

2017, loan applicants can qualify for reduced interest rates (Small Community Rate and/or Hardship Rate) based upon their service population, median household income, unemployment rate and population trends. Loan applicants qualifying for the Small Community Rate or Hardship Rate also have the option of extending the term of their loan beyond the traditional 20 years, up to a maximum of 30 years, provided the term of the loan does not exceed the useful life of the funded project. Details on the fixed loan rate of a loan agreement and repayment periods can be found within 35 Ill. Adm. Code Part 662.

Laboratory Certification

Illinois continues to provide a Laboratory Certification Program for all regulated contaminants, to certify commercial and municipal laboratories within the State. A remote assessment of Illinois EPA's laboratory was conducted on October 26 – November 3, 2021, and an audit report was sent to the State on May 5, 2022. Illinois EPA submitted responses to the report on June 17, 2022. Full Certification was granted on May 11, 2023, after all responses were accepted, which is contingent upon the laboratory's continued demonstration of acceptable performance through the analysis of annual proficiency testing samples.

The DPH's Lab audit visit occurred July 25, 2022, and full certification was granted for microbiological analytes and methods on July 29, 2022. The next audit is scheduled for July, 2024. Illinois continues to meet the elements of its Performance Partnership Agreement (PPA) with U.S. EPA;

- Illinois continues to audit all laboratories that produce results for compliance with SDWA at least once every two years and will meet all regulatory requirements.
- Illinois EPA's Division of Laboratories maintains a certification program and a certified State Lab for inorganic and organic contaminants of concern.
- IDPH maintains a certification program and a certified State Lab for bacteriological contaminants of concern.
- Illinois EPA and DPH submit responses to annual questionnaires to U.S. EPA Region 5.
- U.S. EPA Region 5 tracks State commitments to conduct laboratory certification activities by the IDPH and the Illinois EPA's Division of Laboratories.

Compliance and Enforcement Management

Illinois EPA and IDPH maintain an adequate enforcement and compliance assistance program. Illinois EPA issues Notices of Significant Deficiencies found within thirty days of completion of a sanitary survey, to which a response in the form of a Corrective Action Plan including a compliance schedule is required. When a system fails to meet the compliance deadlines contained in a Corrective Action Plan, Illinois EPA issues a Violation Notice to the system, in accordance with Section 31 of the Illinois Environmental Protection Act, 415 ILCS 5/31 (2022). In addition, Illinois EPA issues Violation Notices upon a system accruing eleven Enforcement Target Tool points, in accordance with USEPA's 2009 Enforcement Response Policy, and when a system incurs MCL exceedance violations, two consecutive monitoring violations, a failure to issue Public Notice, Lead Consumer Notification Form, and Consumer Confidence Reports, among other violations. Once a Violation Notice has been issued, Illinois EPA enters into a Compliance

Commitment Agreement which includes a schedule for returning to compliance, or makes a referral to the Office of the Illinois Attorney General for the filing of a civil complaint. Once a civil complaint has been filed, Illinois EPA works with the Attorney General's Office to obtain a Consent Order or Judgment that requires the system to return to compliance in accordance with the required actions and deadlines.

Illinois and U.S. EPA Region 5 continue to implement data exchange to ensure that enforcement resources are targeted at the non-compliant PWS. Current and historical violation data³ and follow-up enforcement actions can be found at the following web site:

<http://water.epa.state.il.us/dww/index.jsp>

Data management and reporting

Illinois EPA and IDPH maintain adequate data management systems (and updates it for new rules, and new versions of FedRep) that track requirements for all rules, which includes the appropriate combination of hardware, software, and personnel to accurately identify the inventories (including routine updates of system information), maintain water quality monitoring information, and track compliance with all M/R, MCL, MRDL, TT, PN, and public information requirements. Illinois continues to meet the elements of its PPA with U.S. EPA;

- Illinois EPA and IDPH continue to report to U.S. EPA actions and sample data quarterly and inventory data at least annually in accordance with 40 CFR 142.15.
- Illinois EPA and IDPH utilizes SDWIS/STATE to manage water system compliance with all regulatory compliance concerns.
- U.S. EPA Region 5 tracks quarterly and annual data reporting requirements.

Operator Certification

Illinois continued to maintain regulations for the operation and maintenance of all public water systems by properly certified individuals. Illinois continues to meet the elements of its PPA with U.S. EPA:

- Illinois continues to report to U.S. EPA the status of the operator certification program on an annual basis.
- U.S. EPA Region 5 tracks completion of this report to avoid a 20 percent withholding of the Illinois Drinking Water Revolving Loan Fund grant should Illinois fail to meet this commitment.

Capacity Development

Illinois continued to work with existing PWSs and required capacity demonstrations for new PWS to enhance water system technical, managerial, and financial capacity to operate in compliance with federal and State regulations.

Illinois EPA and IDPH continue to report to U.S. EPA the status of the Illinois Capacity Development Program on an annual basis. U.S. EPA Region 5 tracks completion of this report to

³ The data for this reporting originates and is maintained in the Illinois Safe Drinking Water Act Information System.

avoid a 20 percent withholding of the Illinois Drinking Water Revolving Loan Fund grant should Illinois fail to meet this commitment.

Source Water Assessments and Protection

Illinois has reported the number of CWSs with a Source Water Assessment Program (SWAP) report and implementation of SWAP measures electronically via SDWIS/STATE at 49.6 percent (871 of 1,757) of CWS. These systems that have SWAP source water protection minimize the risk to public health through source protection. Additionally, 72.6 percent (8,728,659 of 12,027,856) of the Illinois population served by community water systems have source water protection that have been identified in the SWAP program.

In August of 2019, Part 604 of the Board regulations was approved that updated the SWAP program by requiring CWSs to prepare a Source Water Protection Plan (SWPP) that must be approved by the Illinois EPA. SWP P's CWS (23 systems) serving a total population greater than 50,000 submitted their plans in 2022, CWS serving a total population greater than 5,000 (295 systems) are due to be submitted by July 26, 2023, and the remaining CWSs (761 systems) are due to be submitted by July 26, 2024. Illinois EPA anticipates that these efforts will drastically improve the percent of CWSs, that have minimized risks to public health through substantial implementation of SWP plans. Illinois CWSs are required to review their SWP plans every five years or when the system makes a change to their water source. The continued updates to SWPP's will substantially protect the source of all CWS in the State.

Reporting Requirements

Each quarter, the Illinois EPA submits data to the Federal Safe Drinking Water Information System (SDWIS/FED), an automated database maintained by the U.S. EPA. The data submitted by Illinois include, but are not limited to the following:

- PWS inventory information;
- incidences of violations of MCLs, MRDLs, monitoring, and TT violations;
- information on enforcement activity related to these violations; and
- source water protection information.

The Illinois EPA publishes a report on its website that contains information on permits issued during the previous year. The report includes CWS details regarding the construction and operating permit process, including milestones that measure program efficacy. The ICCG reports biennially to the Governor and the General Assembly on groundwater quality, quantity, and the State's enforcement efforts.

Measures and Indicators

Illinois continues to use quantitative measures developed by U.S. EPA Region 5 to regularly assess

program performance. (See Appendix G) these include, but are not limited to the following activities:

- Illinois continues to participate in semi-annual conference calls with U.S. EPA Region 5 to discuss national program measures, Region 5 specific shared goals and special high priority queries.
- Illinois continues to provide information regarding lead action level exceedances upon request from U.S. EPA Region 5.
- U.S. EPA Region 5 continues to track the status of the Illinois Drinking water program with respect to national program measures, Region 5 specific shared goals and special high priority queries.
- Public health concerns related to Lead and Copper Rule (LCR) implementation will remain a high priority area of focus.

Monitoring: What We Test For—and Why

Illinois community water supplies are tested for different types of contaminants. The number of samples and how often the testing is done depends on the type of contaminant and other factors. The type of contaminant also determines what actions are taken if unacceptable levels are found in the water.

Acute vs. Chronic Indicators - It is important that safe drinking water be free of contamination which has the potential to cause either short-term or long-term health effects. Contaminants fall into two groups according to the health effects that they cause:

ACUTE

Acute effects occur within hours or days of the time that a person consumes a contaminant. People can suffer acute health effects from almost any contaminant if they are exposed to extraordinarily high levels (as in the case of a spill). In drinking water, microbes, such as bacteria and viruses are the contaminants with the greatest chance of reaching levels high enough to cause acute health effects. Most people's bodies can fight off these microbial contaminants the way they fight off germs, and these acute contaminants typically do not have permanent effects. Nonetheless, when high enough levels occur, they can make people ill, and can be dangerous or deadly for infants, the elderly, and persons whose immune systems are already weak due to HIV/AIDS, chemotherapy, steroid use, or other factors.

CHRONIC

Chronic effects occur after people consume a contaminant at levels over U.S. EPA's safety standards for many years. U.S. EPA develops the standards for chronic MCLs on the basis that a person may have an adverse health effect after consuming two liters of water daily over a 70-year lifetime. The drinking water contaminants that can have chronic effects are chemicals (such as disinfection by-products, solvents, and pesticides), radionuclides (such as radium), and minerals (such as arsenic). Examples of the chronic effects of drinking water contaminants are cancer, liver or kidney problems, or reproductive difficulties.

Ninety nine point seven percent (99.7%) of the population served by Illinois CWSs received drinking water in compliance all health based requirements. It is important to note that most non-compliance was for a short duration, and the potential for health risk was minimized through prompt corrective action by the water supplies. Supplies with microbial problems (bacterial or

turbidity non-compliance) are required to issue boil orders when such violations occur. Community water systems with acute MCLs were limited to two (nitrate, nitrite, e coli and Surface Water Treatment Rule Treatment Technique violations) water systems.

Bacterial Contamination. The coliform test is used as a general indicator of water quality in the system, in terms of potential microbial contamination. If the coliform test is negative, it is an indication that the system is adequately protected against contamination from other types of disease-causing organisms. However, if coliform bacteria are found in the water, it is assumed that the system may be compromised, and steps are taken to protect the people who use the water.

Total coliform bacteria (without the detection of fecal coliform or *E. coli*) are generally not harmful. In these cases, the system will identify the source of the contamination, correct the problem, and thoroughly disinfect its system. The public will also be notified of the situation; however, unless unusual circumstances exist to cause particular concern about the safety of the water, a boil water notice would not be issued as would be if fecal coliform or *E. coli* were found.

Nitrate/Nitrite. Community water supply systems in Illinois are tested once a year for nitrate, a chemical which may occur naturally in the environment but that can also enter the water from sources like fertilizer run-off, decaying plant and animal wastes, and sewage. Nitrate is a health concern primarily for infants under the age of six months. The infant's digestive system can convert the nitrate to nitrite, which can interfere with the ability of the infant's blood to carry oxygen. The result is a serious illness known as methemoglobinemia, or "blue baby syndrome." Methemoglobinemia can be fatal if nitrate levels in the water are high enough and the illness is not treated properly.

The MCL for nitrate in drinking water is 10 parts per million (ppm). If a water supply system exceeds the standard, the people who use the water are notified and advised not to use the water for mixing infant formula or other uses that might result in consumption of the water by infants under six months of age. The advisory is kept in place until steps can be taken to reduce nitrate levels in the water. Possible remedial measures include treating the water to remove the nitrate or drilling a new water well.

Older children and adults are generally not at risk from drinking nitrate-contaminated water. In fact, the average adult consumes about 20-25 milligrams of nitrate per day in food, primarily from vegetables. Because of changes that occur after six months of age, the digestive tract no longer converts nitrate into nitrite. However, some adults—including people with low stomach acidity and people with certain blood disorders—may still be at risk for nitrate-induced methemoglobinemia.

Inorganic Chemicals. Community water systems in Illinois are tested for 13 other inorganic chemicals in addition to nitrate. If past results don't indicate the presence of inorganic chemicals, testing is usually done once every three years, otherwise, it may be done as often as once a year. The list includes antimony, arsenic, barium, beryllium, cadmium, chromium, cyanide, fluoride, mercury, nickel, selenium, sulfate, and thallium. In some cases, these chemicals may be naturally present in the groundwater. If a water supply system were to exceed the MCL for one of these chemicals, the people who use the water would be notified, the monitoring schedule would be increased to quarterly, and appropriate steps would be taken to reduce levels of these chemicals in the water.

Radioactive Elements. Community water systems in Illinois are also usually tested once every three years, or as often as once a year, in some cases, for a list of radioactive elements. If past results don't indicate the presence of radioactive elements, testing is usually done once every nine years. If a system were to exceed the federal MCL for one of these radioactive elements, the people who use the water would be notified, the monitoring schedule would be increased to quarterly, and steps would be taken to reduce the levels of these elements in the water.

Disinfection By-Products. Disinfection rids drinking water of microbiological organisms, such as bacteria, viruses, and protozoa, that can cause and spread diseases. The most common method of disinfection is the addition of chlorine to drinking water supplies. Not only is chlorine effective against waterborne bacteria and viruses in the source water, it also provides residual protection to inhibit microbial growth after the treated water enters the distribution system. This means the disinfectant continues working to keep the water safe as it travels from the treatment plant to the consumer's tap.

However, even though chlorine has been a literal lifesaver with regard to drinking water, it also has the potential to form by-products that are known to produce harmful health effects. Chlorine can combine with organic materials in the raw water to create contaminants called trihalomethanes (THMs) and haloacetic acids (HAAs). Repeated exposure to elevated levels of THMs over a long period of time could increase a person's risk of cancer. The formation of disinfection by-products is a greater concern for water systems that contain organics or use surface water, such as rivers, lakes, and streams, as their source. Surface water sources are more likely to contain the organic materials that combine with chlorine to form THMs and HAAs. All community water systems that add a disinfectant to the water must regularly test their treated water to determine if THMs and HAAs are present. If a water supply system were to exceed the MCL for THMs or HAAs, the people who use the water would be notified, the monitoring schedule would be increased to quarterly, and appropriate steps would be taken to reduce levels of these chemicals in the water.

Lead and Copper. All community and non-transient public water systems have been tested for lead and copper. In community water systems, the water is tested in a specific number of homes within each system to determine if the water exceeds the federal "action level" of 15 parts per billion (ppb) for lead or 1,300 ppb for copper. If a system exceeds the action level for lead or copper in more than 10 percent of the locations tested, it is required to take corrective action and do further testing. Current testing frequencies are based partly on the results of that initial round of testing and of the success of subsequent efforts to reduce risk of lead contamination in systems that have previously exceeded the action level.

Monitoring Violations for Calendar Year 2022

The following table summarizes the number of CWS in violation with aspects of the drinking water compliance program during 2022. In the cases of a violation, a water system is required to take corrective actions. These actions include public notification to inform affected residents of the situation and if there are any special precautions they should take. In all cases noted here, residents were advised directly by the water system at the time the violation occurred. All community water systems have also noted any violations in the annual water quality reports (also called Consumer Confidence Reports) they distribute to their residents.

Information on all violations for CWSs in 2022 is in Appendices A and B, Appendices C and D for

TNCWS and Appendix E and F for NTNCWS. Illinois EPA & IDPH) continue to address all systems not in compliance with state rules and regulations. Specifically, Illinois will address non-compliant PWSs that have a score of 11 or higher on the U.S. EPA's Enforcement Targeting Tool report, in accordance with the OECA Enforcement Response Policy.

- As an enforcement option, Illinois may refer noncompliant PWSs to the U.S. EPA Region 5 for follow-up action or the Illinois Attorney General's Office
- Illinois EPA and IDPH continue to keep records relating to enforcement decisions.
- Illinois EPA and IDPH continue to produce an annual compliance report by July 1 as part of a consolidated report program efficacy.
- U.S. EPA Region 5 track state commitments under measure SDWA02 (involving addressing with a formal enforcement action or return to compliance), the number of priority systems equal to the number of its PWSs that have a score of 11 or higher on the July Enforcement Targeting Tool report, and update Illinois quarterly.
- Illinois EPA and IDPH worked with U.S. EPA on the National Compliance Initiative (NCI).

Violations during Calendar Year 2022 Community Water Systems						
Total Number of Regulated Systems					1753	
Total Number of Systems in Violation*					385	
Total Number of Violations					1160	
Rule Subtotal by Violation Type						
Rule Category	MCLs		Treatment Techniques		Significant Monitoring Reporting	
	Number of Violations	Number of Systems*	Number of Violations	Number of Systems*	Number of Violations	Number of Systems*
Arsenic	2	2	0	0	2	2
Radiological	7	4	NA	NA	29	21
Nitrates	0	0	NA	NA	1	1
IOCs	0	0	NA	NA	0	0
SOCs	0	0	NA	NA	127	4
VOCs	0	0	NA	NA	107	6
Coliform	0	0	1	1	61	39
Ground Water Rule	NA	NA	0	0	0	0
All SWTR	NA	NA	0	0	0	0
DBPR (Stage 1) (chlorine chloramines)	NA	NA	0	0	51	44
DBPR (Stage 2)	28	14	0	0	50	25
Lead & Copper	NA	NA	28	22	122	105
Public Notice	NA	NA	NA	NA	115	63
Consumer Confidence Rule	NA	NA	NA	NA	54	52
TOTALS	37	20	29	23	550	247
	*Percentage of Systems In Compliance = 98.8%		*Percentage of Systems In Compliance = 98.6%		*Percentage of Systems In Compliance = 85.9%	

**Numbers from U.S. EPA-CDX Reporting Services. Although a CWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it is counted no more than once within the population being totaled. So, the sum of NUMBER OF CWS IN VIOLATION, over the various violation types or contaminants, may not add up to the total.*

Violations during Calendar Year 2022 Non-Transient Non-Community Water Systems						
Total Number of Regulated Systems					423	
Total Number of Systems in Violation*					248	
Total Number of Violations					1728	
Rule Subtotal by Violation Type						
Rule Category	MCLs		Treatment Techniques		Significant Monitoring Reporting	
	Number of Violations	Number of Systems	Number of Violations	Number of Systems	Number of Violations	Number of Systems
Radiological	NA	NA	NA	NA	NA	NA
Arsenic	3	1	NA	NA	10	6
IOCs	0	0	NA	NA	20	3
Nitrates	1	1	NA	NA	1	1
SOCs	0	0	NA	NA	666	20
VOCs	0	0	NA	NA	777	22
Revised Total Coliform Rule	1	1	0	0	35	31
Ground Water Rule	0	0	0	0	1	1
SWTRs	0	0	0	0	0	0
DBPR (Stage 1) (chlorine chloramines)	NA	NA	9	9	8	7
DBPR (Stage 2)	0	0	0	0	0	7
Lead & Copper	NA	NA	1	1	171	137
Public Notice	NA	NA	NA	NA	73	47
Consumer Awareness	NA	NA	NA	NA	0	0
TOTALS	5	3	10	10	1713	235
	*Percentage of Systems In Compliance = 99.2%		*Percentage of Systems In Compliance = 97.6%		*Percentage of Systems In Compliance = 44.4%	

**Although a NTNCPWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it is counted no more than once within the population being totaled. So, the sum of NUMBER OF NCPWS IN VIOLATION, over the various violation types or contaminants, may not add up to the total.*

Violations during Calendar Year 2022 Transient Non-Community Water Systems						
Total Number of Regulated Systems					3084	
Total Number of Systems in Violation*					521	
Total Number of Violations					653	
Rule Subtotal by Violation Type						
Rule Category	MCLs		Treatment Techniques		Significant Monitoring Reporting	
	Number of Violations	Number of Systems	Number of Violations	Number of Systems	Number of Violations	Number of Systems
Nitrates	1	1	NA	NA	12	12
Revised Total Coliform Rule	7	7	321	224	121	110
Ground Water Rule	0	0	0	0	6	6
Lead & Copper	NA	NA	0	0	3	2
Public Notice	NA	NA	NA	NA	182	159
TOTALS	8	8	321	224	324	289
	*Percentage of Systems In Compliance = 99.0%		*Percentage of Systems In Compliance = 92.7%		*Percentage of Systems In Compliance =90.6%	

**Although a TNCPWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it is counted no more than once within the population being totaled. So, the sum of NUMBER OF NCPWS IN VIOLATION, over the various violation types or contaminants, may not add up to the total.*

Appendix A
Illinois EPA 2022 Annual Compliance Report
Community Water Supplies Violations Sorted by Contaminant

From U.S. EPA's CDX Reporting Services database

Contaminant Name	PWS ID	PWS Name	Resolved Date	Violation Type Description
1,1,1-Trichloroethane	IL1975105	CRISWELL COURT MHP	04/25/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL1975105	CRISWELL COURT MHP	04/25/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL1975105	CRISWELL COURT MHP	04/25/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL1975105	CRISWELL COURT MHP	04/25/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL1975105	CRISWELL COURT MHP	04/25/2022	Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL1975105	CRISWELL COURT MHP		Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL1975105	CRISWELL COURT MHP		Monitoring, Regular
Arsenic	IL1470200	DE LAND		Maximum Contaminant Level Violation, Average
Arsenic	IL1470200	DE LAND		Maximum Contaminant Level Violation, Average
Arsenic	IL1470200	DE LAND		Maximum Contaminant Level Violation, Average
Arsenic	IL1470200	DE LAND		Maximum Contaminant Level Violation, Average
Arsenic	IL1470200	DE LAND		Maximum Contaminant Level Violation, Average

Arsenic	IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN		Maximum Contaminant Level Violation, Average
Arsenic	IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN		Maximum Contaminant Level Violation, Average
Arsenic	IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN		Maximum Contaminant Level Violation, Average
Arsenic	IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN		Maximum Contaminant Level Violation, Average
Arsenic	IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN		Maximum Contaminant Level Violation, Average
Arsenic	IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN		Maximum Contaminant Level Violation, Average
Arsenic	IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN		Maximum Contaminant Level Violation, Average
Arsenic	IL1130750	LE ROY		Monitoring, Regular
Arsenic	IL1130750	LE ROY		Monitoring, Regular
CARBON, TOTAL	IL0875510	VIENNA CORRECTIONAL CENTER		Monitoring and Reporting (DBP)
CARBON, TOTAL	IL0875510	VIENNA CORRECTIONAL CENTER		Monitoring and Reporting (DBP)
CARBON, TOTAL	IL1971100	WILMINGTON		Monitoring and Reporting (DBP)
CARBON, TOTAL	IL1971100	WILMINGTON		Monitoring and Reporting (DBP)
Chloramine	IL1590220	ACORN ACRES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1590220	ACORN ACRES MHP		Monitoring and Reporting (DBP)

Chloramine	IL1590220	ACORN ACRES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1590220	ACORN ACRES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1590220	ACORN ACRES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1650150	GALATIA	08/26/2022	Monitoring and Reporting (DBP)
Chloramine	IL1650150	GALATIA	08/26/2022	Monitoring and Reporting (DBP)
Chloramine	IL1650150	GALATIA	08/26/2022	Monitoring and Reporting (DBP)
Chloramine	IL1130080	HILLTOP MHP	06/28/2022	Monitoring and Reporting (DBP)
Chloramine	IL1130080	HILLTOP MHP	06/28/2022	Monitoring and Reporting (DBP)
Chloramine	IL1190120	LAKESHORE ESTATES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1190120	LAKESHORE ESTATES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1190120	LAKESHORE ESTATES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1190120	LAKESHORE ESTATES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1190120	LAKESHORE ESTATES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1190120	LAKESHORE ESTATES MHP		Monitoring and Reporting (DBP)
Chloramine	IL1190120	LAKESHORE ESTATES MHP		Monitoring and Reporting (DBP)

Chloramine	IL1190120	LAKESHORE ESTATES MHP		Monitoring and Reporting (DBP)
Chloramine	IL0290010	LONGACRE ESTATES MHP	07/29/2022	Monitoring and Reporting (DBP)
Chloramine	IL0290010	LONGACRE ESTATES MHP	07/29/2022	Monitoring and Reporting (DBP)
Chloramine	IL0290010	LONGACRE ESTATES MHP	07/29/2022	Monitoring and Reporting (DBP)
Chloramine	IL1570600	SPARTA	08/26/2022	Monitoring and Reporting (DBP)
Chloramine	IL1570600	SPARTA	08/26/2022	Monitoring and Reporting (DBP)
Chloramine	IL1570600	SPARTA	08/26/2022	Monitoring and Reporting (DBP)
Chloramine	IL0550650	WEST CITY	08/08/2022	Monitoring and Reporting (DBP)
Chloramine	IL0550650	WEST CITY	08/08/2022	Monitoring and Reporting (DBP)
Chloramine	IL0550650	WEST CITY	08/08/2022	Monitoring and Reporting (DBP)
Chlorine	IL0855200	BAHL WATER CORP	08/19/2022	Monitoring and Reporting (DBP)
Chlorine	IL0855200	BAHL WATER CORP	08/19/2022	Monitoring and Reporting (DBP)
Chlorine	IL0855200	BAHL WATER CORP	08/19/2022	Monitoring and Reporting (DBP)
Chlorine	IL1150100	BLUE MOUND	03/04/2022	Monitoring and Reporting (DBP)
Chlorine	IL1150100	BLUE MOUND	03/04/2022	Monitoring and Reporting (DBP)

Chlorine	IL1150100	BLUE MOUND	03/04/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	06/06/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	06/06/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	06/06/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	08/30/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	08/30/2022	Monitoring and Reporting (DBP)
Chlorine	IL0150020	CENTURY PINES APARTMENTS	08/30/2022	Monitoring and Reporting (DBP)
Chlorine	IL0310510	CICERO	03/01/2022	Monitoring and Reporting (DBP)
Chlorine	IL0310510	CICERO	03/01/2022	Monitoring and Reporting (DBP)
Chlorine	IL0310510	CICERO	03/01/2022	Monitoring and Reporting (DBP)
Chlorine	IL0375125	CORTLAND CORNERS MHP		Monitoring and Reporting (DBP)

Chlorine	IL0375125	CORTLAND CORNERS MHP		Monitoring and Reporting (DBP)
Chlorine	IL1975105	CRISWELL COURT MHP	03/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1975105	CRISWELL COURT MHP	03/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1975105	CRISWELL COURT MHP	03/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1975105	CRISWELL COURT MHP	08/03/2022	Monitoring and Reporting (DBP)
Chlorine	IL1975105	CRISWELL COURT MHP	08/03/2022	Monitoring and Reporting (DBP)
Chlorine	IL1975105	CRISWELL COURT MHP	08/03/2022	Monitoring and Reporting (DBP)
Chlorine	IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	09/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	09/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	09/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1730100	FINDLAY	08/09/2022	Monitoring and Reporting (DBP)
Chlorine	IL1730100	FINDLAY	08/09/2022	Monitoring and Reporting (DBP)
Chlorine	IL1730100	FINDLAY	08/09/2022	Monitoring and Reporting (DBP)
Chlorine	IL1730100	FINDLAY	08/09/2022	Monitoring and Reporting (DBP)
Chlorine	IL1435220	JUBILEE WATER COMPANY, INC.	03/09/2022	Monitoring and Reporting (DBP)

Chlorine	IL1435220	JUBILEE WATER COMPANY, INC.	03/09/2022	Monitoring and Reporting (DBP)
Chlorine	IL1435220	JUBILEE WATER COMPANY, INC.	03/09/2022	Monitoring and Reporting (DBP)
Chlorine	IL1435220	JUBILEE WATER COMPANY, INC.	03/09/2022	Monitoring and Reporting (DBP)
Chlorine	IL0010450	LORAINE	02/28/2022	Monitoring and Reporting (DBP)
Chlorine	IL0010450	LORAINE	02/28/2022	Monitoring and Reporting (DBP)
Chlorine	IL0010450	LORAINE	02/28/2022	Monitoring and Reporting (DBP)
Chlorine	IL0010450	LORAINE	02/28/2022	Monitoring and Reporting (DBP)
Chlorine	IL0110600	MANLIUS		Monitoring and Reporting (DBP)
Chlorine	IL0311770	MARKHAM	06/23/2022	Monitoring and Reporting (DBP)
Chlorine	IL0311770	MARKHAM	06/23/2022	Monitoring and Reporting (DBP)
Chlorine	IL0311770	MARKHAM	06/23/2022	Monitoring and Reporting (DBP)
Chlorine	IL0750600	MARTINTON	07/11/2022	Monitoring and Reporting (DBP)
Chlorine	IL0750600	MARTINTON	07/11/2022	Monitoring and Reporting (DBP)
Chlorine	IL0750600	MARTINTON	07/11/2022	Monitoring and Reporting (DBP)
Chlorine	IL0750600	MARTINTON	07/11/2022	Monitoring and Reporting (DBP)

Chlorine	IL1550150	MCNABB	09/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1550150	MCNABB	09/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1550150	MCNABB	09/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1650250	MUDDY	05/31/2022	Monitoring and Reporting (DBP)
Chlorine	IL1650250	MUDDY	05/31/2022	Monitoring and Reporting (DBP)
Chlorine	IL1650250	MUDDY	05/31/2022	Monitoring and Reporting (DBP)
Chlorine	IL1770400	PEARL CITY	08/18/2022	Monitoring and Reporting (DBP)
Chlorine	IL1770400	PEARL CITY	08/18/2022	Monitoring and Reporting (DBP)
Chlorine	IL1770400	PEARL CITY	08/18/2022	Monitoring and Reporting (DBP)
Chlorine	IL1530300	PULASKI	07/29/2022	Monitoring and Reporting (DBP)
Chlorine	IL1530300	PULASKI	07/29/2022	Monitoring and Reporting (DBP)
Chlorine	IL1670950	RIVERTON	07/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1670950	RIVERTON	07/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1670950	RIVERTON	07/07/2022	Monitoring and Reporting (DBP)
Chlorine	IL1190970	SOUTH ROXANA	09/12/2022	Monitoring and Reporting (DBP)

Chlorine	IL1190970	SOUTH ROXANA	09/12/2022	Monitoring and Reporting (DBP)
Chlorine	IL1190970	SOUTH ROXANA	09/12/2022	Monitoring and Reporting (DBP)
Chlorine	IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	04/05/2022	Monitoring and Reporting (DBP)
Chlorine	IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	04/05/2022	Monitoring and Reporting (DBP)
Chlorine	IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	04/05/2022	Monitoring and Reporting (DBP)
Chlorine	IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	04/05/2022	Monitoring and Reporting (DBP)
Chlorine	IL2035225	TIMBERLINE MHP	07/27/2022	Monitoring and Reporting (DBP)
Chlorine	IL2035225	TIMBERLINE MHP	07/27/2022	Monitoring and Reporting (DBP)
Chlorine	IL2035225	TIMBERLINE MHP	07/27/2022	Monitoring and Reporting (DBP)
Chlorine	IL0850500	WARREN	06/17/2022	Monitoring and Reporting (DBP)
Chlorine	IL0850500	WARREN	06/17/2022	Monitoring and Reporting (DBP)
Chlorine	IL0850500	WARREN	06/17/2022	Monitoring and Reporting (DBP)
Combined Radium (-226 and -228)	IL0317765	BLACKHAWK ESTATES LLC	09/06/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0317765	BLACKHAWK ESTATES LLC	09/06/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)		Maximum Contaminant Level Violation, Average

Combined Radium (-226 and -228)	IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL1030200	DIXON	07/20/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL1030200	DIXON	07/20/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC		Monitoring, Regular
Combined Radium (-226 and -228)	IL0630450	KINSMAN	07/20/2022	Monitoring, Regular

Combined Radium (-226 and -228)	IL0630450	KINSMAN	07/20/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0995050	LAND AND WTR ASSN		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL0995050	LAND AND WTR ASSN		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL0995050	LAND AND WTR ASSN		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL0995050	LAND AND WTR ASSN		Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015625	PHIL-AIRE ESTATES MHP	07/28/2022	Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015625	PHIL-AIRE ESTATES MHP	07/28/2022	Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015625	PHIL-AIRE ESTATES MHP	07/28/2022	Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015625	PHIL-AIRE ESTATES MHP	07/28/2022	Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015625	PHIL-AIRE ESTATES MHP	07/28/2022	Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015625	PHIL-AIRE ESTATES MHP	07/28/2022	Maximum Contaminant Level Violation, Average
Combined Radium (-226 and -228)	IL2015625	PHIL-AIRE ESTATES MHP	09/06/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL2015625	PHIL-AIRE ESTATES MHP	09/06/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0890160	PINGREE GROVE	04/29/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0890160	PINGREE GROVE	04/29/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL1970850	ROCKDALE	07/01/2022	Monitoring, Regular

Combined Radium (-226 and -228)	IL1970850	ROCKDALE	07/01/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL1970850	ROCKDALE	07/01/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0630650	SOUTH WILMINGTON	07/29/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0630650	SOUTH WILMINGTON	07/29/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0890850	SUGAR GROVE	07/18/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0890850	SUGAR GROVE	07/18/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0370550	SYCAMORE	09/21/2022	Monitoring, Regular
Combined Radium (-226 and -228)	IL0370550	SYCAMORE	09/21/2022	Monitoring, Regular
Combined Uranium	IL0630650	SOUTH WILMINGTON	07/29/2022	Monitoring, Regular
Consumer Confidence Rule	IL0950050	ABINGDON		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1834020	ALLERTON		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1210050	ALMA	01/05/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1210050	ALMA	01/05/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1210050	ALMA		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0750050	ASHKUM		Consumer Confidence Report Complete Failure to Report

Consumer Confidence Rule	IL1015300	BIRDS PINKSTAFF WATER DISTRICT	08/26/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1015300	BIRDS PINKSTAFF WATER DISTRICT	08/26/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0310240	BLUE ISLAND	07/27/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0310240	BLUE ISLAND	07/27/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1430080	BUFFALO HOLLOW FARMS WATER ASSOC		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0315175	CANDLELIGHT VILLAGE MHP		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0570250	CANTON	08/01/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0570250	CANTON	08/01/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0570250	CANTON	08/01/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0450100	CHRISMAN		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0250020	CLAY COUNTY WATER INC		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1610160	CLOVER LEAF VILLAGE MHP	09/05/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1610160	CLOVER LEAF VILLAGE MHP	09/05/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0310600	CRESTWOOD	07/18/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0310600	CRESTWOOD	07/18/2022	Consumer Confidence Report Complete Failure to Report

Consumer Confidence Rule	IL1615100	EAST LAWN WATER ASSOCIATION	08/05/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1615100	EAST LAWN WATER ASSOCIATION	08/05/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1617635	FALCON FARMS	08/12/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1617635	FALCON FARMS	08/12/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	08/01/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	08/01/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1035165	GREEN ACRES MHP		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1470250	HAMMOND	07/26/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1470250	HAMMOND	07/26/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1030300	HARMON	09/14/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1030300	HARMON	09/14/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1350010	HENDERSON PWD		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1730150	HERRICK		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0975700	HILLDALE MANOR SUBDIVISION	07/25/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0975700	HILLDALE MANOR SUBDIVISION	07/25/2022	Consumer Confidence Report Complete Failure to Report

Consumer Confidence Rule	IL1790300	HOPEDALE		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1090300	INDUSTRY		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1190120	LAKESHORE ESTATES MHP		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1190120	LAKESHORE ESTATES MHP		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0310370	LINDENTREE TOWNHOMES		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0311680	LYNWOOD	06/10/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0311680	LYNWOOD	06/10/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0311680	LYNWOOD	06/10/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0311680	LYNWOOD	06/10/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0554640	MACEDONIA	08/03/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0554640	MACEDONIA	08/03/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1610350	MISSISSIPPI MANUFACTURED HOME COMMUNITY	07/27/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1490500	NEBO	01/18/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1490500	NEBO	01/18/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1490500	NEBO	01/18/2022	Consumer Confidence Report Complete Failure to Report

Consumer Confidence Rule	IL1930350	NORRIS CITY	08/19/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1930350	NORRIS CITY	08/19/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0312460	PARK RIDGE	07/14/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0312460	PARK RIDGE	07/14/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0910010	PEMBROKE TOWNSHIP	08/22/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0910010	PEMBROKE TOWNSHIP	08/22/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1950450	ROCK FALLS	06/30/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1950450	ROCK FALLS	06/30/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1970850	ROCKDALE	08/04/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1970850	ROCKDALE	08/04/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0312790	SAUK	07/14/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0312790	SAUK	07/14/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0150300	SHANNON	08/01/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0150300	SHANNON	08/01/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0312970	SOUTH HOLLAND		Consumer Confidence Report Complete Failure to Report

Consumer Confidence Rule	IL1775235	STEPHENSON MOBILE ESTATES	07/27/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1775235	STEPHENSON MOBILE ESTATES	07/27/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0313060	STREAMWOOD	08/16/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0313060	STREAMWOOD	08/16/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0313090	THORNTON		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1615780	TOWER RIDGE SUBDIVISION		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1214920	WAMAC	07/27/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1214920	WAMAC	07/27/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0230200	WESTFIELD		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0230200	WESTFIELD		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1610170	WHISPERING HILLS MHP	08/12/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1610170	WHISPERING HILLS MHP	08/12/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0610400	WHITE HALL	08/03/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0610400	WHITE HALL	08/03/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL1770550	WINSLOW	08/03/2022	Consumer Confidence Report Complete Failure to Report

Consumer Confidence Rule	IL1770550	WINSLOW	08/03/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0437245	WOOD DALE ESTATES		Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0250300	XENIA	07/14/2022	Consumer Confidence Report Complete Failure to Report
Consumer Confidence Rule	IL0250300	XENIA	07/14/2022	Consumer Confidence Report Complete Failure to Report
Ethylbenzene	IL0635250	RIDGECREST NORTH SUBDIVISION		Monitoring, Regular
Ethylbenzene	IL0635250	RIDGECREST NORTH SUBDIVISION		Monitoring, Regular
Lead and Copper Rule	IL1590220	ACORN ACRES MHP		Initial Tap Sampling for Pb and Cu
Lead and Copper Rule	IL1590220	ACORN ACRES MHP		Initial Tap Sampling for Pb and Cu
Lead and Copper Rule	IL1950050	ALBANY	04/29/2022	Lead Consumer Notice
Lead and Copper Rule	IL1950050	ALBANY	04/29/2022	Lead Consumer Notice
Lead and Copper Rule	IL1950050	ALBANY	04/27/2022	Lead Consumer Notice
Lead and Copper Rule	IL1950050	ALBANY	04/27/2022	Lead Consumer Notice
Lead and Copper Rule	IL1210050	ALMA		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1210050	ALMA		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1115250	AQUA ILLINOIS-EASTWOOD MANOR		Lead Consumer Notice

Lead and Copper Rule	IL1115250	AQUA ILLINOIS-EASTWOOD MANOR		Lead Consumer Notice
Lead and Copper Rule	IL1115250	AQUA ILLINOIS-EASTWOOD MANOR		Lead Consumer Notice
Lead and Copper Rule	IL1115600	AQUA ILLINOIS-NUNDA		Lead Consumer Notice
Lead and Copper Rule	IL1115600	AQUA ILLINOIS-NUNDA		Lead Consumer Notice
Lead and Copper Rule	IL0755389	ARCADIA CARE		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0755389	ARCADIA CARE		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0410050	ARCOLA	03/30/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0410050	ARCOLA	03/30/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0410050	ARCOLA	03/30/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0410050	ARCOLA	03/30/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0410050	ARCOLA	03/30/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0410050	ARCOLA	03/30/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0270100	AVISTON	07/19/2022	Water Quality Parameter M/R
Lead and Copper Rule	IL0270100	AVISTON	07/19/2022	Water Quality Parameter M/R
Lead and Copper Rule	IL0270100	AVISTON	07/19/2022	Water Quality Parameter M/R

Lead and Copper Rule	IL0855200	BAHL WATER CORP		Lead Consumer Notice
Lead and Copper Rule	IL0270150	BARTELSON	03/01/2022	Water Quality Parameter M/R
Lead and Copper Rule	IL0270150	BARTELSON	03/01/2022	Water Quality Parameter M/R
Lead and Copper Rule	IL0270150	BARTELSON	03/01/2022	Water Quality Parameter M/R
Lead and Copper Rule	IL0755125	BEAVER CREEK VILLAGE MHP	02/09/2022	Lead Consumer Notice
Lead and Copper Rule	IL0755125	BEAVER CREEK VILLAGE MHP	02/09/2022	Lead Consumer Notice
Lead and Copper Rule	IL0550050	BENTON		Lead Consumer Notice
Lead and Copper Rule	IL0810150	BONNIE		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0810150	BONNIE		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0670200	BOWEN		WQP Entry Point/Tap Treatment Technique Non-Compliance
Lead and Copper Rule	IL0670200	BOWEN		WQP Entry Point/Tap Treatment Technique Non-Compliance
Lead and Copper Rule	IL0130100	BRUSSELS	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0130100	BRUSSELS	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0130100	BRUSSELS	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0130100	BRUSSELS	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration

Lead and Copper Rule	IL0130100	BRUSSELS	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0010050	CAMP POINT		WQP Entry Point/Tap Treatment Technique Non-Compliance
Lead and Copper Rule	IL0010050	CAMP POINT		WQP Entry Point/Tap Treatment Technique Non-Compliance
Lead and Copper Rule	IL1615170	CEDAR BROOK ESTATES SUBDIVISION	02/21/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1615170	CEDAR BROOK ESTATES SUBDIVISION	02/21/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1615170	CEDAR BROOK ESTATES SUBDIVISION	02/21/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0150020	CENTURY PINES APARTMENTS		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0150020	CENTURY PINES APARTMENTS		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0316000	CHICAGO	02/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL0316000	CHICAGO	02/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL0450100	CHRISMAN	07/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL0450100	CHRISMAN	07/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL0450100	CHRISMAN	07/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL0450100	CHRISMAN		Lead Consumer Notice
Lead and Copper Rule	IL0450100	CHRISMAN		Lead Consumer Notice

Lead and Copper Rule	IL0450100	CHRISMAN		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0450100	CHRISMAN		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0450100	CHRISMAN		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0450100	CHRISMAN		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0450100	CHRISMAN		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0450100	CHRISMAN		Public Education
Lead and Copper Rule	IL0550150	CHRISTOPHER	01/28/2022	Lead Consumer Notice
Lead and Copper Rule	IL0550150	CHRISTOPHER	01/28/2022	Lead Consumer Notice
Lead and Copper Rule	IL1610160	CLOVER LEAF VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1610160	CLOVER LEAF VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1610160	CLOVER LEAF VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1610160	CLOVER LEAF VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1610160	CLOVER LEAF VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1610160	CLOVER LEAF VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1610160	CLOVER LEAF VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1610160	CLOVER LEAF VILLAGE MHP		Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL1610160	CLOVER LEAF VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0375125	CORTLAND CORNERS MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0375125	CORTLAND CORNERS MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0375125	CORTLAND CORNERS MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0375125	CORTLAND CORNERS MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0375125	CORTLAND CORNERS MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0375125	CORTLAND CORNERS MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0735700	COUNTRY CLUB ESTATES SUBDIVISION		Lead Consumer Notice
Lead and Copper Rule	IL0735050	COUNTRY ESTATES SUBDIVISION		Lead Consumer Notice
Lead and Copper Rule	IL1975105	CRISWELL COURT MHP		Lead Consumer Notice
Lead and Copper Rule	IL1975105	CRISWELL COURT MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1975105	CRISWELL COURT MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1975105	CRISWELL COURT MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1135150	CROPSEY MUTUAL WATER ASSOCIATION		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1135150	CROPSEY MUTUAL WATER ASSOCIATION		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1135150	CROPSEY MUTUAL WATER ASSOCIATION		OCCT/SOWT Study/Recommendation

Lead and Copper Rule	IL1135150	CROPSEY MUTUAL WATER ASSOCIATION		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1135150	CROPSEY MUTUAL WATER ASSOCIATION		Lead Consumer Notice
Lead and Copper Rule	IL1670400	DAWSON	01/24/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1670400	DAWSON	01/24/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1670400	DAWSON	01/24/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1670400	DAWSON	01/24/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1670400	DAWSON	01/24/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1790150	DELAVAN		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1790150	DELAVAN		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0750400	DONOVAN		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0750400	DONOVAN		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0750400	DONOVAN		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0750400	DONOVAN		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0335100	EATON PWD	02/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL0335100	EATON PWD	02/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL0415150	EGYPTIAN TRAIL WATER CORP	01/27/2022	Lead Consumer Notice

Lead and Copper Rule	IL0415150	EGYPTIAN TRAIL WATER CORP	01/27/2022	Lead Consumer Notice
Lead and Copper Rule	IL0610100	ELDRED	02/08/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0610100	ELDRED	02/08/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0610100	ELDRED	02/08/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0610100	ELDRED	02/08/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0894380	ELGIN		Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0894380	ELGIN		Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0590050	EQUALITY	01/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL0590050	EQUALITY	01/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL0195945	FOUNTAIN VALLEY MHP	02/07/2022	Lead Consumer Notice
Lead and Copper Rule	IL0195945	FOUNTAIN VALLEY MHP	02/07/2022	Lead Consumer Notice
Lead and Copper Rule	IL0735600	GENESE0 HILLS SUBDIVISION	04/12/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0735600	GENESE0 HILLS SUBDIVISION	04/12/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0735600	GENESE0 HILLS SUBDIVISION	04/12/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0735600	GENESE0 HILLS SUBDIVISION	04/12/2022	Initial, Follow-up, or Routine Source Water M/R

Lead and Copper Rule	IL0311050	GLENWOOD		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0311050	GLENWOOD		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0311050	GLENWOOD		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0610150	GREENFIELD		Lead Consumer Notice
Lead and Copper Rule	IL0350050	GREENUP	01/18/2022	Lead Consumer Notice
Lead and Copper Rule	IL0350050	GREENUP	01/18/2022	Lead Consumer Notice
Lead and Copper Rule	IL1130080	HILLTOP MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1130080	HILLTOP MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0610200	HILLVIEW		Lead Consumer Notice
Lead and Copper Rule	IL0311260	HODGKINS	02/08/2022	Lead Consumer Notice
Lead and Copper Rule	IL0311260	HODGKINS	02/08/2022	Lead Consumer Notice
Lead and Copper Rule	IL0410350	IL AMERICAN-VILLA GROVE	02/10/2022	Lead Consumer Notice
Lead and Copper Rule	IL0410350	IL AMERICAN-VILLA GROVE	02/10/2022	Lead Consumer Notice
Lead and Copper Rule	IL0410350	IL AMERICAN-VILLA GROVE	02/10/2022	Lead Consumer Notice
Lead and Copper Rule	IL0410350	IL AMERICAN-VILLA GROVE	02/10/2022	Lead Consumer Notice

Lead and Copper Rule	IL1610120	ILCV CANDLE MHP, LLC		Lead Consumer Notice
Lead and Copper Rule	IL0195350	ILUR PORTFOLIOS - CARRIAGE ESTATES LLC	01/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL0195350	ILUR PORTFOLIOS - CARRIAGE ESTATES LLC	01/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL0450200	KANSAS		Lead Consumer Notice
Lead and Copper Rule	IL0730650	KEWANEE	01/14/2022	Lead Consumer Notice
Lead and Copper Rule	IL0730650	KEWANEE	01/14/2022	Lead Consumer Notice
Lead and Copper Rule	IL0370250	KINGSTON	01/21/2022	Lead Service Line Replacement (LSLR)
Lead and Copper Rule	IL0370250	KINGSTON	01/21/2022	Lead Service Line Replacement (LSLR)
Lead and Copper Rule	IL0370250	KINGSTON		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0370250	KINGSTON		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0370250	KINGSTON		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL1210300	KINMUNDY		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1210300	KINMUNDY		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1210300	KINMUNDY		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0975345	LAKE VIEW MHP		Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL0975345	LAKE VIEW MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1190120	LAKESHORE ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1190120	LAKESHORE ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0150100	LANARK	01/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL0150100	LANARK	01/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0311680	LYNWOOD	01/28/2022	Lead Consumer Notice
Lead and Copper Rule	IL0311680	LYNWOOD	01/28/2022	Lead Consumer Notice
Lead and Copper Rule	IL0311680	LYNWOOD	01/28/2022	Lead Consumer Notice
Lead and Copper Rule	IL0190450	MAHOMET	03/23/2022	Lead Consumer Notice
Lead and Copper Rule	IL0190450	MAHOMET	03/23/2022	Lead Consumer Notice

Lead and Copper Rule	IL1710250	MANCHESTER		Lead Consumer Notice
Lead and Copper Rule	IL1430500	MAPLETON	07/21/2022	Lead Consumer Notice
Lead and Copper Rule	IL1430500	MAPLETON	07/21/2022	Lead Consumer Notice
Lead and Copper Rule	IL1430500	MAPLETON	07/21/2022	Lead Consumer Notice
Lead and Copper Rule	IL1430500	MAPLETON	07/21/2022	Lead Consumer Notice
Lead and Copper Rule	IL0230100	MARSHALL	01/26/2022	Lead Consumer Notice
Lead and Copper Rule	IL0230100	MARSHALL	01/26/2022	Lead Consumer Notice
Lead and Copper Rule	IL0311830	MAYWOOD	02/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL0311830	MAYWOOD	02/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL0650200	MCLEANSBORO	01/24/2022	Lead Consumer Notice
Lead and Copper Rule	IL0650200	MCLEANSBORO	01/24/2022	Lead Consumer Notice
Lead and Copper Rule	IL0710250	MEDIA	03/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL0710250	MEDIA	03/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL1515050	MILLSTONE PWD	03/16/2022	Public Education
Lead and Copper Rule	IL1515050	MILLSTONE PWD	03/16/2022	Public Education

Lead and Copper Rule	IL1515050	MILLSTONE PWD	04/27/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1515050	MILLSTONE PWD	04/27/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1515050	MILLSTONE PWD	04/27/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1515050	MILLSTONE PWD	04/27/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1530150	MOUNDS		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1530150	MOUNDS		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1150350	MOUNT ZION		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL1150350	MOUNT ZION		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL1150350	MOUNT ZION		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL1150350	MOUNT ZION		OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL1490500	NEBO	01/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1490500	NEBO	01/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1490500	NEBO	01/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1490500	NEBO	04/21/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1490500	NEBO	04/21/2022	Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL1490500	NEBO	01/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1490500	NEBO	01/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1490500	NEBO	01/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1490500	NEBO	01/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1490500	NEBO		Lead Consumer Notice
Lead and Copper Rule	IL0110700	NEPONSET	02/11/2022	Lead Consumer Notice
Lead and Copper Rule	IL0110700	NEPONSET	02/11/2022	Lead Consumer Notice
Lead and Copper Rule	IL1170750	NILWOOD	05/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1170750	NILWOOD	05/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1130060	NORTH MEADOW VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1130060	NORTH MEADOW VILLAGE MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1795780	NORTH TAZEWELL PWD		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1795780	NORTH TAZEWELL PWD		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0895400	OGDEN GARDENS SUBDIVISION		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0895400	OGDEN GARDENS SUBDIVISION		Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL0895400	OGDEN GARDENS SUBDIVISION		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0312280	OLYMPIA FIELDS		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0312280	OLYMPIA FIELDS		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0312280	OLYMPIA FIELDS		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0312280	OLYMPIA FIELDS		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0750700	ONARGA	02/15/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0750700	ONARGA	02/15/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0750700	ONARGA	02/15/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0735150	OPHIEM PWS	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0735150	OPHIEM PWS	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0735150	OPHIEM PWS	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0735150	OPHIEM PWS	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0735150	OPHIEM PWS	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0735150	OPHIEM PWS	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
Lead and Copper Rule	IL0735150	OPHIEM PWS		Lead Consumer Notice

Lead and Copper Rule	IL0975575	PARK CITY MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0975575	PARK CITY MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0610450	PATTERSON (INC AS WILMINGTON)		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0610450	PATTERSON (INC AS WILMINGTON)		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0312490	PHOENIX		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0312490	PHOENIX		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0312490	PHOENIX		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1970800	PLAINFIELD	03/30/2022	Lead Consumer Notice
Lead and Copper Rule	IL1970800	PLAINFIELD	03/30/2022	Lead Consumer Notice
Lead and Copper Rule	IL0895550	POWERS WATER CO, INC.		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0895550	POWERS WATER CO, INC.		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0895550	POWERS WATER CO, INC.		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0895550	POWERS WATER CO, INC.		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0895550	POWERS WATER CO, INC.		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1115800	PRAIRIE PATH WATER COMPANY-WALK UP WOODS	05/31/2022	Lead Consumer Notice

Lead and Copper Rule	IL1115800	PRAIRIE PATH WATER COMPANY-WALK UP WOODS	05/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL0510200	RAMSEY	02/08/2022	Lead Consumer Notice
Lead and Copper Rule	IL0510200	RAMSEY	02/08/2022	Lead Consumer Notice
Lead and Copper Rule	IL0510200	RAMSEY	02/08/2022	Lead Consumer Notice
Lead and Copper Rule	IL0510200	RAMSEY	02/08/2022	Lead Consumer Notice
Lead and Copper Rule	IL1570450	RED BUD	02/11/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1570450	RED BUD	02/11/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1570450	RED BUD	02/11/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1570450	RED BUD	02/11/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1570450	RED BUD	02/11/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1570450	RED BUD	06/29/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1570450	RED BUD	06/29/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1570450	RED BUD	06/29/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1570450	RED BUD	06/29/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1570450	RED BUD		WQP Entry Point/Tap Treatment Technique Non-Compliance

Lead and Copper Rule	IL1570450	RED BUD		WQP Entry Point/Tap Treatment Technique Non-Compliance
Lead and Copper Rule	IL1570450	RED BUD		WQP Entry Point/Tap Treatment Technique Non-Compliance
Lead and Copper Rule	IL0590300	RIDGWAY	01/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL0590300	RIDGWAY	01/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL1955165	RIVERSIDE ESTATES MHP	05/04/2022	Lead Consumer Notice
Lead and Copper Rule	IL1955165	RIVERSIDE ESTATES MHP	05/04/2022	Lead Consumer Notice
Lead and Copper Rule	IL0735500	RUSTIC ACRES WATER ASSOCIATION	03/03/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0735500	RUSTIC ACRES WATER ASSOCIATION	03/03/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0735500	RUSTIC ACRES WATER ASSOCIATION	03/03/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1170010	SCOTTVILLE RURAL WATER COMPANY, INC.		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1170010	SCOTTVILLE RURAL WATER COMPANY, INC.		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1170010	SCOTTVILLE RURAL WATER COMPANY, INC.		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL2030600	SECOR	03/07/2022	Public Education
Lead and Copper Rule	IL2030600	SECOR	03/07/2022	Public Education
Lead and Copper Rule	IL0750800	SHELDON		Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL0750800	SHELDON		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0750800	SHELDON		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0750800	SHELDON		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0312970	SOUTH HOLLAND	03/07/2022	Public Education
Lead and Copper Rule	IL0312970	SOUTH HOLLAND	03/07/2022	Public Education
Lead and Copper Rule	IL0312970	SOUTH HOLLAND	06/28/2022	Public Education
Lead and Copper Rule	IL0312970	SOUTH HOLLAND	06/28/2022	Public Education
Lead and Copper Rule	IL0310140	SOUTH PALOS TWSP SANITARY DIST	01/20/2022	Lead Consumer Notice
Lead and Copper Rule	IL0310140	SOUTH PALOS TWSP SANITARY DIST	01/20/2022	Lead Consumer Notice
Lead and Copper Rule	IL1570600	SPARTA	01/14/2022	Lead Consumer Notice
Lead and Copper Rule	IL1570600	SPARTA	01/14/2022	Lead Consumer Notice
Lead and Copper Rule	IL1977910	STATEVILLE CORRECTIONAL CENTER	07/29/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1977910	STATEVILLE CORRECTIONAL CENTER	07/29/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1977910	STATEVILLE CORRECTIONAL CENTER	07/29/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1977910	STATEVILLE CORRECTIONAL CENTER	07/29/2022	OCCT/SOWT Study/Recommendation

Lead and Copper Rule	IL0315850	STERLING ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0315850	STERLING ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0315850	STERLING ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0315850	STERLING ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0315850	STERLING ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0315850	STERLING ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0315850	STERLING ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0315850	STERLING ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0315850	STERLING ESTATES MHP		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1795345	STONETOWN EDGEWOOD TERRACE, LLC		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1795345	STONETOWN EDGEWOOD TERRACE, LLC		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1795345	STONETOWN EDGEWOOD TERRACE, LLC		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1795345	STONETOWN EDGEWOOD TERRACE, LLC		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1795345	STONETOWN EDGEWOOD TERRACE, LLC		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1795345	STONETOWN EDGEWOOD TERRACE, LLC		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL1795345	STONETOWN EDGEWOOD TERRACE, LLC		Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL0735300	SUNNY HILL ESTATES SUBDIVISION	01/24/2022	Lead Consumer Notice
Lead and Copper Rule	IL0735300	SUNNY HILL ESTATES SUBDIVISION	01/24/2022	Lead Consumer Notice
Lead and Copper Rule	IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	03/02/2022	Public Education
Lead and Copper Rule	IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	03/02/2022	Public Education
Lead and Copper Rule	IL0735470	TIMBER RIDGE SBDV	01/27/2022	Lead Consumer Notice
Lead and Copper Rule	IL0735470	TIMBER RIDGE SBDV	01/27/2022	Lead Consumer Notice
Lead and Copper Rule	IL0515500	VANDALIA CORRECTIONAL CENTER	01/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL0515500	VANDALIA CORRECTIONAL CENTER	01/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL1795050	VENADO LAKES-ARGYLL WATER ASSOCIATION	04/14/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1795050	VENADO LAKES-ARGYLL WATER ASSOCIATION	04/14/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1795050	VENADO LAKES-ARGYLL WATER ASSOCIATION	04/14/2022	Initial, Follow-up, or Routine Source Water M/R

Lead and Copper Rule	IL1795050	VENADO LAKES-ARGYLL WATER ASSOCIATION	04/14/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL1195350	VILLAGE GREEN MOBILE HOME PARK		Initial Tap Sampling for Pb and Cu
Lead and Copper Rule	IL1350700	WAGGONER	06/29/2022	Lead Consumer Notice
Lead and Copper Rule	IL1350700	WAGGONER	06/29/2022	Lead Consumer Notice
Lead and Copper Rule	IL0111100	WALNUT	07/29/2022	Water Quality Parameter M/R
Lead and Copper Rule	IL0111100	WALNUT	07/29/2022	Water Quality Parameter M/R
Lead and Copper Rule	IL0111100	WALNUT	07/29/2022	Water Quality Parameter M/R
Lead and Copper Rule	IL0111100	WALNUT	07/29/2022	Water Quality Parameter M/R
Lead and Copper Rule	IL1790750	WASHINGTON	01/26/2022	Lead Consumer Notice
Lead and Copper Rule	IL1790750	WASHINGTON	01/26/2022	Lead Consumer Notice
Lead and Copper Rule	IL0390350	WELDON	02/08/2022	Lead Consumer Notice
Lead and Copper Rule	IL0390350	WELDON	02/08/2022	Lead Consumer Notice
Lead and Copper Rule	IL0395225	WEST SIDE MHP	02/28/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0395225	WEST SIDE MHP	02/28/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0395225	WEST SIDE MHP	02/28/2022	Initial, Follow-up, or Routine Source Water M/R

Lead and Copper Rule	IL0395225	WEST SIDE MHP	02/28/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0230200	WESTFIELD		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0230200	WESTFIELD		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0230200	WESTFIELD		Water Quality Parameter M/R
Lead and Copper Rule	IL0230200	WESTFIELD		Water Quality Parameter M/R
Lead and Copper Rule	IL0230200	WESTFIELD	04/13/2022	Lead Consumer Notice
Lead and Copper Rule	IL0230200	WESTFIELD	04/13/2022	Lead Consumer Notice
Lead and Copper Rule	IL0230200	WESTFIELD		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0230200	WESTFIELD		OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0610400	WHITE HALL	05/14/2022	Lead Consumer Notice
Lead and Copper Rule	IL0610400	WHITE HALL	05/14/2022	Lead Consumer Notice
Lead and Copper Rule	IL1450300	WILLISVILLE	02/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL1450300	WILLISVILLE	02/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL1730550	WINDSOR	04/22/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1730550	WINDSOR	04/22/2022	OCCT/SOWT Study/Recommendation

Lead and Copper Rule	IL1730550	WINDSOR	04/22/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1730550	WINDSOR	04/22/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL1730550	WINDSOR	04/22/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0971950	WINTHROP HARBOR		Lead Consumer Notice
Lead and Copper Rule	IL0437245	WOOD DALE ESTATES		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0437245	WOOD DALE ESTATES		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0437245	WOOD DALE ESTATES		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0437245	WOOD DALE ESTATES	05/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL0437245	WOOD DALE ESTATES	05/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL0751000	WOODLAND	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0751000	WOODLAND	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0751000	WOODLAND	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL0751000	WOODLAND	04/20/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0751000	WOODLAND	04/20/2022	OCCT/SOWT Study/Recommendation
Lead and Copper Rule	IL0751000	WOODLAND	04/20/2022	OCCT/SOWT Study/Recommendation

Lead and Copper Rule	IL0550750	ZEIGLER		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0550750	ZEIGLER		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL0550750	ZEIGLER		Follow-up Or Routine LCR Tap M/R
Pentachlorophenol	IL1955225	HONEYCUTT HILL MHP LLC	06/13/2022	Monitoring, Regular
Pentachlorophenol	IL1955225	HONEYCUTT HILL MHP LLC	06/13/2022	Monitoring, Regular
Pentachlorophenol	IL1955225	HONEYCUTT HILL MHP LLC	06/13/2022	Monitoring, Regular
Pentachlorophenol	IL1955225	HONEYCUTT HILL MHP LLC	06/13/2022	Monitoring, Regular
Public Notice	IL1950050	ALBANY	08/05/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1950050	ALBANY	08/05/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1950050	ALBANY	08/05/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1950050	ALBANY	08/05/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1210050	ALMA		Public Notification Violation for NPDWR Violation
Public Notice	IL1115250	AQUA ILLINOIS-EASTWOOD MANOR		Public Notification Violation for NPDWR Violation
Public Notice	IL1115250	AQUA ILLINOIS-EASTWOOD MANOR		Public Notification Violation for NPDWR Violation
Public Notice	IL1115250	AQUA ILLINOIS-EASTWOOD MANOR		Public Notification Violation for NPDWR Violation

Public Notice	IL1115250	AQUA ILLINOIS- EASTWOOD MANOR		Public Notification Violation for NPDWR Violation
Public Notice	IL0855200	BAHL WATER CORP		Public Notification Violation for NPDWR Violation
Public Notice	IL0855200	BAHL WATER CORP		Public Notification Violation for NPDWR Violation
Public Notice	IL0855200	BAHL WATER CORP		Public Notification Violation for NPDWR Violation
Public Notice	IL0550050	BENTON		Public Notification Violation for NPDWR Violation
Public Notice	IL0550050	BENTON		Public Notification Violation for NPDWR Violation
Public Notice	IL0550050	BENTON		Public Notification Violation for NPDWR Violation
Public Notice	IL1015300	BIRDS PINKSTAFF WATER DISTRICT		Public Notification Violation for NPDWR Violation
Public Notice	IL1015300	BIRDS PINKSTAFF WATER DISTRICT		Public Notification Violation for NPDWR Violation
Public Notice	IL1015300	BIRDS PINKSTAFF WATER DISTRICT		Public Notification Violation for NPDWR Violation
Public Notice	IL1015300	BIRDS PINKSTAFF WATER DISTRICT		Public Notification Violation for NPDWR Violation
Public Notice	IL0450050	BROCTON		Public Notification Violation for NPDWR Violation
Public Notice	IL0450100	CHRISMAN	07/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0450100	CHRISMAN	07/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0630200	COAL CITY	03/03/2022	Public Notification Violation for NPDWR Violation

Public Notice	IL0630200	COAL CITY	03/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0630200	COAL CITY	03/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0630200	COAL CITY	03/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0630200	COAL CITY	04/20/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0630200	COAL CITY	04/20/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1030150	COMPTON	06/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1030150	COMPTON	06/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1135150	CROPSEY MUTUAL WATER ASSOCIATION		Public Notification Violation for NPDWR Violation
Public Notice	IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	06/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	06/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1975480	CRYSTAL LAWNS ADDITION IMPROVEMENT ASSOC	03/10/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1975480	CRYSTAL LAWNS ADDITION IMPROVEMENT ASSOC	03/10/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0310660	DIXMOOR		Public Notification Violation for NPDWR Violation
Public Notice	IL0054360	DONNELLSON	07/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0054360	DONNELLSON	07/15/2022	Public Notification Violation for NPDWR Violation

Public Notice	IL0054360	DONNELSON	07/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0054360	DONNELSON		Public Notification Violation for NPDWR Violation
Public Notice	IL0310720	FORD HEIGHTS		Public Notification Violation for NPDWR Violation
Public Notice	IL0310720	FORD HEIGHTS		Public Notification Violation for NPDWR Violation
Public Notice	IL0990060	FOUR STAR CAMPGROUND		Public Notification Violation for NPDWR Violation
Public Notice	IL0311050	GLENWOOD		Public Notification Violation for NPDWR Violation
Public Notice	IL0610150	GREENFIELD	01/25/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0610150	GREENFIELD	01/25/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0610150	GREENFIELD	01/25/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0610150	GREENFIELD	01/25/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0610150	GREENFIELD	08/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0610150	GREENFIELD	08/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0610150	GREENFIELD	08/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0610150	GREENFIELD	08/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1030300	HARMON		Public Notification Violation for NPDWR Violation

Public Notice	IL1030300	HARMON	03/25/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1030300	HARMON	03/25/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0950250	HENDERSON		Public Notification Violation for NPDWR Violation
Public Notice	IL0950250	HENDERSON		Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation

Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0970255	HIGHLAND LAKE WATER COMPANY	03/09/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1130080	HILLTOP MHP		Public Notification Violation for NPDWR Violation
Public Notice	IL0975245	HOLLY HOCK HILL MHP		Public Notification Violation for NPDWR Violation
Public Notice	IL0910040	HOPKINS PARK		Public Notification Violation for NPDWR Violation
Public Notice	IL0910040	HOPKINS PARK	04/08/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0910040	HOPKINS PARK	04/08/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1610120	ILCV CANDLE MHP, LLC		Public Notification Violation for NPDWR Violation
Public Notice	IL1750100	LAFAYETTE		Public Notification Violation for NPDWR Violation
Public Notice	IL1750100	LAFAYETTE		Public Notification Violation for NPDWR Violation
Public Notice	IL1190120	LAKESHORE ESTATES MHP		Public Notification Violation for NPDWR Violation

Public Notice	IL1190120	LAKESHORE ESTATES MHP		Public Notification Violation for NPDWR Violation
Public Notice	IL1190120	LAKESHORE ESTATES MHP		Public Notification Violation for NPDWR Violation
Public Notice	IL1190120	LAKESHORE ESTATES MHP		Public Notification Violation for NPDWR Violation
Public Notice	IL0995050	LAND AND WTR ASSN	07/23/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0995050	LAND AND WTR ASSN	07/23/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0110550	MALDEN		Public Notification Violation for NPDWR Violation
Public Notice	IL1530150	MOUNDS		Public Notification Violation for NPDWR Violation
Public Notice	IL1150350	MOUNT ZION	01/04/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1150350	MOUNT ZION	01/04/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1490500	NEBO	07/08/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1490500	NEBO	07/06/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1490500	NEBO	07/06/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0110700	NEPONSET		Public Notification Violation for NPDWR Violation
Public Notice	IL0110700	NEPONSET		Public Notification Violation for NPDWR Violation
Public Notice	IL0110700	NEPONSET		Public Notification Violation for NPDWR Violation

Public Notice	IL0110700	NEPONSET		Public Notification Violation for NPDWR Violation
Public Notice	IL1150400	NIANTIC	06/16/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1150400	NIANTIC	06/16/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1170750	NILWOOD	03/28/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1170750	NILWOOD	03/28/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1170750	NILWOOD	03/28/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1170750	NILWOOD	03/28/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1170750	NILWOOD	03/28/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1130060	NORTH MEADOW VILLAGE MHP		Public Notification Violation for NPDWR Violation
Public Notice	IL1795780	NORTH TAZEWELL PWD		Public Notification Violation for NPDWR Violation
Public Notice	IL0312280	OLYMPIA FIELDS	03/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0312280	OLYMPIA FIELDS	03/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1770400	PEARL CITY	04/04/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1770400	PEARL CITY	04/04/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0910010	PEMBROKE TOWNSHIP		Public Notification Violation for NPDWR Violation
Public Notice	IL2015625	PHIL-AIRE ESTATES MHP	06/29/2022	Public Notification Violation for NPDWR Violation

Public Notice	IL2015625	PHIL-AIRE ESTATES MHP	06/29/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0312490	PHOENIX		Public Notification Violation for NPDWR Violation
Public Notice	IL0312490	PHOENIX		Public Notification Violation for NPDWR Violation
Public Notice	IL0312490	PHOENIX	09/08/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0312490	PHOENIX	09/08/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0312490	PHOENIX	09/08/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0312490	PHOENIX	09/08/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0312490	PHOENIX	09/08/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1490800	PLEASANT HILL	03/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1490800	PLEASANT HILL	03/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1490800	PLEASANT HILL	03/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1490800	PLEASANT HILL	03/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1830650	POTOMAC		Public Notification Violation for NPDWR Violation
Public Notice	IL1830650	POTOMAC	06/13/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1830650	POTOMAC	06/13/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1830650	POTOMAC	06/13/2022	Public Notification Violation for NPDWR Violation

Public Notice	IL1830650	POTOMAC	06/13/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1830650	POTOMAC	06/13/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1830650	POTOMAC	06/13/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0895550	POWERS WATER CO, INC.		Public Notification Violation for NPDWR Violation
Public Notice	IL0312550	RICHTON PARK		Public Notification Violation for NPDWR Violation
Public Notice	IL1955165	RIVERSIDE ESTATES MHP		Public Notification Violation for NPDWR Violation
Public Notice	IL1970850	ROCKDALE		Public Notification Violation for NPDWR Violation
Public Notice	IL0750800	SHELDON	01/06/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0750800	SHELDON	01/06/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1370400	SOUTH JACKSONVILLE		Public Notification Violation for NPDWR Violation
Public Notice	IL1370400	SOUTH JACKSONVILLE		Public Notification Violation for NPDWR Violation
Public Notice	IL1095200	STRATFORD WEST ASSOCIATION, INC.	06/14/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1095200	STRATFORD WEST ASSOCIATION, INC.	06/14/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0750850	THAWVILLE		Public Notification Violation for NPDWR Violation
Public Notice	IL0750850	THAWVILLE		Public Notification Violation for NPDWR Violation

Public Notice	IL1750150	TOULON		Public Notification Violation for NPDWR Violation
Public Notice	IL1750150	TOULON		Public Notification Violation for NPDWR Violation
Public Notice	IL0770550	VERGENNES	03/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0770550	VERGENNES	03/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0770550	VERGENNES	03/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0770550	VERGENNES	03/03/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL0570950	VERMONT		Public Notification Violation for NPDWR Violation
Public Notice	IL1350700	WAGGONER	03/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1350700	WAGGONER	03/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1350700	WAGGONER	03/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1350700	WAGGONER	03/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1350700	WAGGONER	03/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1350700	WAGGONER	03/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT	08/10/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT	08/10/2022	Public Notification Violation for NPDWR Violation

Public Notice	IL0230200	WESTFIELD		Public Notification Violation for NPDWR Violation
Public Notice	IL0971950	WINTHROP HARBOR		Public Notification Violation for NPDWR Violation
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1590220	ACORN ACRES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0855200	BAHL WATER CORP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0855200	BAHL WATER CORP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1150100	BLUE MOUND	03/04/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1150100	BLUE MOUND	03/04/2022	Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0150020	CENTURY PINES APARTMENTS	05/02/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0150020	CENTURY PINES APARTMENTS		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0150020	CENTURY PINES APARTMENTS		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0310510	CICERO	03/01/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0310510	CICERO	03/01/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0310510	CICERO	03/01/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0375125	CORTLAND CORNERS MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0375125	CORTLAND CORNERS MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1975105	CRISWELL COURT MHP	03/07/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1975105	CRISWELL COURT MHP	03/07/2022	Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL1975105	CRISWELL COURT MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1975105	CRISWELL COURT MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1730100	FINDLAY		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1730100	FINDLAY		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1730100	FINDLAY		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1650150	GALATIA		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1650150	GALATIA		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1435220	JUBILEE WATER COMPANY, INC.	03/09/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1435220	JUBILEE WATER COMPANY, INC.	03/09/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1435220	JUBILEE WATER COMPANY, INC.	03/09/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190120	LAKESHORE ESTATES MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0010450	LORAINE	02/28/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0010450	LORAINE	02/28/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0010450	LORAINE	02/28/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0311770	MARKHAM		Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL0311770	MARKHAM		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0750600	MARTINTON		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0750600	MARTINTON		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0750600	MARTINTON		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1550150	MCNABB		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1550150	MCNABB		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1650250	MUDDY		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1650250	MUDDY		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0075275	OAK LAWN MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0075275	OAK LAWN MHP		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1770400	PEARL CITY		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1770400	PEARL CITY		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1670950	RIVERTON		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1670950	RIVERTON		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1190970	SOUTH ROXANA		Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL1190970	SOUTH ROXANA		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1570600	SPARTA		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1570600	SPARTA		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL1095200	STRATFORD WEST ASSOCIATION, INC.	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
Revised Total Coliform Rule	IL1095200	STRATFORD WEST ASSOCIATION, INC.	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
Revised Total Coliform Rule	IL1095200	STRATFORD WEST ASSOCIATION, INC.	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
Revised Total Coliform Rule	IL1095200	STRATFORD WEST ASSOCIATION, INC.	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
Revised Total Coliform Rule	IL1095200	STRATFORD WEST ASSOCIATION, INC.	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
Revised Total Coliform Rule	IL1095200	STRATFORD WEST ASSOCIATION, INC.	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
Revised Total Coliform Rule	IL1095200	STRATFORD WEST ASSOCIATION, INC.	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
Revised Total Coliform Rule	IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	04/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	04/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	04/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0550650	WEST CITY		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL0550650	WEST CITY		Monitoring, Routine (RTCR)
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average

Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL1030150	COMPTON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL0050100	MULBERRY GROVE		Maximum Contaminant Level Violation, Average

Total Haloacetic Acids (HAA5)	IL0050100	MULBERRY GROVE		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL0050100	MULBERRY GROVE		Maximum Contaminant Level Violation, Average
Total Haloacetic Acids (HAA5)	IL0050100	MULBERRY GROVE		Maximum Contaminant Level Violation, Average
Total Polychlorinated Biphenyls (PCB)	IL0316000	CHICAGO		Monitoring, Regular
Total Polychlorinated Biphenyls (PCB)	IL0316000	CHICAGO		Monitoring, Regular
TTHM	IL1990150	CARTERVILLE	08/26/2022	Monitoring and Reporting (DBP)
TTHM	IL1990150	CARTERVILLE	08/26/2022	Monitoring and Reporting (DBP)
TTHM	IL1990150	CARTERVILLE	08/26/2022	Monitoring and Reporting (DBP)
TTHM	IL1030150	COMPTON	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1030150	COMPTON	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1030150	COMPTON	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1030150	COMPTON	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1030150	COMPTON	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average

TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
TTHM	IL0054360	DONNELLSON		Maximum Contaminant Level Violation, Average
TTHM	IL1670550	ILLIOPOLIS		Maximum Contaminant Level Violation, Average
TTHM	IL1670550	ILLIOPOLIS		Maximum Contaminant Level Violation, Average
TTHM	IL1670550	ILLIOPOLIS		Maximum Contaminant Level Violation, Average
TTHM	IL1670550	ILLIOPOLIS		Maximum Contaminant Level Violation, Average
TTHM	IL1670550	ILLIOPOLIS		Maximum Contaminant Level Violation, Average
TTHM	IL1670550	ILLIOPOLIS		Maximum Contaminant Level Violation, Average
TTHM	IL1670550	ILLIOPOLIS		Maximum Contaminant Level Violation, Average
TTHM	IL1670550	ILLIOPOLIS		Maximum Contaminant Level Violation, Average
TTHM	IL1810250	JONESBORO	08/24/2022	Maximum Contaminant Level Violation, Average

TTHM	IL1810250	JONESBORO	08/24/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1810250	JONESBORO	08/24/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1810250	JONESBORO	08/24/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1810250	JONESBORO	08/24/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0990300	LA SALLE		Maximum Contaminant Level Violation, Average
TTHM	IL0990300	LA SALLE		Maximum Contaminant Level Violation, Average
TTHM	IL0990300	LA SALLE		Maximum Contaminant Level Violation, Average
TTHM	IL0990300	LA SALLE		Maximum Contaminant Level Violation, Average
TTHM	IL0990300	LA SALLE		Maximum Contaminant Level Violation, Average
TTHM	IL0990300	LA SALLE		Maximum Contaminant Level Violation, Average
TTHM	IL0990300	LA SALLE		Maximum Contaminant Level Violation, Average
TTHM	IL0990300	LA SALLE		Maximum Contaminant Level Violation, Average
TTHM	IL0990300	LA SALLE		Maximum Contaminant Level Violation, Average
TTHM	IL1550250	MARK	09/09/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1550250	MARK	09/09/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1550250	MARK	09/09/2022	Maximum Contaminant Level Violation, Average

TTHM	IL1550250	MARK	09/09/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1550250	MARK	09/09/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1515050	MILLSTONE PWD	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1195210	MITCHELL PWD	09/09/2022	Monitoring and Reporting (DBP)
TTHM	IL1195210	MITCHELL PWD	09/09/2022	Monitoring and Reporting (DBP)
TTHM	IL1195210	MITCHELL PWD	09/09/2022	Monitoring and Reporting (DBP)
TTHM	IL1150350	MOUNT ZION	02/10/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1150350	MOUNT ZION	02/10/2022	Failure Submit IDSE/Subpart V Plan Rpt

TTHM	IL1150350	MOUNT ZION	02/10/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1150350	MOUNT ZION	02/10/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL1150350	MOUNT ZION		Maximum Contaminant Level Violation, Average
TTHM	IL1150350	MOUNT ZION		Maximum Contaminant Level Violation, Average
TTHM	IL1150350	MOUNT ZION		Maximum Contaminant Level Violation, Average
TTHM	IL1150350	MOUNT ZION		Maximum Contaminant Level Violation, Average
TTHM	IL1150350	MOUNT ZION		Maximum Contaminant Level Violation, Average
TTHM	IL1150350	MOUNT ZION		Maximum Contaminant Level Violation, Average
TTHM	IL1150350	MOUNT ZION		Maximum Contaminant Level Violation, Average
TTHM	IL1150350	MOUNT ZION		Maximum Contaminant Level Violation, Average
TTHM	IL1150350	MOUNT ZION		Maximum Contaminant Level Violation, Average
TTHM	IL1590150	NOBLE		Maximum Contaminant Level Violation, Average
TTHM	IL1590150	NOBLE		Maximum Contaminant Level Violation, Average
TTHM	IL0312460	PARK RIDGE	08/24/2022	Monitoring and Reporting (DBP)
TTHM	IL0312460	PARK RIDGE	08/24/2022	Monitoring and Reporting (DBP)
TTHM	IL0312460	PARK RIDGE	08/24/2022	Monitoring and Reporting (DBP)

TTHM	IL0313000	STICKNEY		Monitoring and Reporting (DBP)
TTHM	IL0313000	STICKNEY		Monitoring and Reporting (DBP)
TTHM	IL0313000	STICKNEY		Monitoring and Reporting (DBP)
TTHM	IL0310060	SUMMIT	09/10/2022	Monitoring and Reporting (DBP)
TTHM	IL0310060	SUMMIT	09/10/2022	Monitoring and Reporting (DBP)
TTHM	IL0310060	SUMMIT	09/10/2022	Monitoring and Reporting (DBP)
TTHM	IL0570900	TABLE GROVE		Maximum Contaminant Level Violation, Average
TTHM	IL0570900	TABLE GROVE		Maximum Contaminant Level Violation, Average
TTHM	IL0570900	TABLE GROVE		Maximum Contaminant Level Violation, Average
TTHM	IL0570900	TABLE GROVE		Maximum Contaminant Level Violation, Average
TTHM	IL0570900	TABLE GROVE		Maximum Contaminant Level Violation, Average
TTHM	IL0570900	TABLE GROVE		Maximum Contaminant Level Violation, Average
TTHM	IL0570900	TABLE GROVE		Maximum Contaminant Level Violation, Average
TTHM	IL0191000	TOLONO	03/25/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL0191000	TOLONO	03/25/2022	Failure Submit IDSE/Subpart V Plan Rpt

TTHM	IL0191000	TOLONO	03/25/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL0191000	TOLONO	03/25/2022	Failure Submit IDSE/Subpart V Plan Rpt
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0270500	TRENTON	08/19/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0570950	VERMONT	05/12/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0570950	VERMONT	05/12/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0570950	VERMONT	05/12/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0570950	VERMONT	05/12/2022	Maximum Contaminant Level Violation, Average

TTHM	IL0570950	VERMONT	05/12/2022	Maximum Contaminant Level Violation, Average
TTHM	IL0570950	VERMONT	05/12/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1195350	VILLAGE GREEN MOBILE HOME PARK	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1195350	VILLAGE GREEN MOBILE HOME PARK	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1195350	VILLAGE GREEN MOBILE HOME PARK	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1195350	VILLAGE GREEN MOBILE HOME PARK	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1195350	VILLAGE GREEN MOBILE HOME PARK	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1195350	VILLAGE GREEN MOBILE HOME PARK	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1195350	VILLAGE GREEN MOBILE HOME PARK	08/22/2022	Maximum Contaminant Level Violation, Average
TTHM	IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT		Maximum Contaminant Level Violation, Average
TTHM	IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT		Maximum Contaminant Level Violation, Average
TTHM	IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT		Maximum Contaminant Level Violation, Average
TTHM	IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT		Maximum Contaminant Level Violation, Average

Appendix B
Illinois EPA 2022 Annual Compliance Report
Violations Sorted by Community Water Supplies

From U.S. EPA's CDX Reporting Services database

PWS ID	PWS Name	Contaminant Name	Resolved Date	Violation Type Description
IL0950050	ABINGDON	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL1590220	ACORN ACRES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1590220	ACORN ACRES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1590220	ACORN ACRES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1590220	ACORN ACRES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1590220	ACORN ACRES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1590220	ACORN ACRES MHP	Lead and Copper Rule		Initial Tap Sampling for Pb and Cu
IL1590220	ACORN ACRES MHP	Lead and Copper Rule		Initial Tap Sampling for Pb and Cu
IL1590220	ACORN ACRES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1590220	ACORN ACRES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1590220	ACORN ACRES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1590220	ACORN ACRES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)

IL1590220	ACORN ACRES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1590220	ACORN ACRES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1590220	ACORN ACRES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1590220	ACORN ACRES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1590220	ACORN ACRES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1950050	ALBANY	Lead and Copper Rule	04/29/2022	Lead Consumer Notice
IL1950050	ALBANY	Lead and Copper Rule	04/29/2022	Lead Consumer Notice
IL1950050	ALBANY	Lead and Copper Rule	04/27/2022	Lead Consumer Notice
IL1950050	ALBANY	Lead and Copper Rule	04/27/2022	Lead Consumer Notice
IL1950050	ALBANY	Public Notice	08/05/2022	Public Notification Violation for NPDWR Violation
IL1950050	ALBANY	Public Notice	08/05/2022	Public Notification Violation for NPDWR Violation
IL1950050	ALBANY	Public Notice	08/05/2022	Public Notification Violation for NPDWR Violation
IL1950050	ALBANY	Public Notice	08/05/2022	Public Notification Violation for NPDWR Violation
IL1834020	ALLERTON	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL1210050	ALMA	Consumer Confidence Rule	01/05/2022	Consumer Confidence Report Complete Failure to Report

IL1210050	ALMA	Consumer Confidence Rule	01/05/2022	Consumer Confidence Report Complete Failure to Report
IL1210050	ALMA	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL1210050	ALMA	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1210050	ALMA	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1210050	ALMA	Public Notice		Public Notification Violation for NPDWR Violation
IL1115250	AQUA ILLINOIS-EASTWOOD MANOR	Lead and Copper Rule		Lead Consumer Notice
IL1115250	AQUA ILLINOIS-EASTWOOD MANOR	Lead and Copper Rule		Lead Consumer Notice
IL1115250	AQUA ILLINOIS-EASTWOOD MANOR	Lead and Copper Rule		Lead Consumer Notice
IL1115250	AQUA ILLINOIS-EASTWOOD MANOR	Public Notice		Public Notification Violation for NPDWR Violation
IL1115250	AQUA ILLINOIS-EASTWOOD MANOR	Public Notice		Public Notification Violation for NPDWR Violation
IL1115250	AQUA ILLINOIS-EASTWOOD MANOR	Public Notice		Public Notification Violation for NPDWR Violation
IL1115250	AQUA ILLINOIS-EASTWOOD MANOR	Public Notice		Public Notification Violation for NPDWR Violation
IL1115600	AQUA ILLINOIS-NUNDA	Lead and Copper Rule		Lead Consumer Notice
IL1115600	AQUA ILLINOIS-NUNDA	Lead and Copper Rule		Lead Consumer Notice
IL0755389	ARCADIA CARE	Lead and Copper Rule		OCCT/SOWT Study/Recommendation

IL0755389	ARCADIA CARE	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL0410050	ARCOLA	Lead and Copper Rule	03/30/2022	OCCT/SOWT Study/Recommendation
IL0410050	ARCOLA	Lead and Copper Rule	03/30/2022	OCCT/SOWT Study/Recommendation
IL0410050	ARCOLA	Lead and Copper Rule	03/30/2022	OCCT/SOWT Study/Recommendation
IL0410050	ARCOLA	Lead and Copper Rule	03/30/2022	OCCT/SOWT Study/Recommendation
IL0410050	ARCOLA	Lead and Copper Rule	03/30/2022	OCCT/SOWT Study/Recommendation
IL0410050	ARCOLA	Lead and Copper Rule	03/30/2022	OCCT/SOWT Study/Recommendation
IL0410050	ARCOLA	Lead and Copper Rule	03/30/2022	OCCT/SOWT Study/Recommendation
IL0750050	ASHKUM	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0270100	AVISTON	Lead and Copper Rule	07/19/2022	Water Quality Parameter M/R
IL0270100	AVISTON	Lead and Copper Rule	07/19/2022	Water Quality Parameter M/R
IL0270100	AVISTON	Lead and Copper Rule	07/19/2022	Water Quality Parameter M/R
IL0855200	BAHL WATER CORP	Chlorine	08/19/2022	Monitoring and Reporting (DBP)
IL0855200	BAHL WATER CORP	Chlorine	08/19/2022	Monitoring and Reporting (DBP)
IL0855200	BAHL WATER CORP	Chlorine	08/19/2022	Monitoring and Reporting (DBP)
IL0855200	BAHL WATER CORP	Lead and Copper Rule		Lead Consumer Notice

IL0855200	BAHL WATER CORP	Public Notice		Public Notification Violation for NPDWR Violation
IL0855200	BAHL WATER CORP	Public Notice		Public Notification Violation for NPDWR Violation
IL0855200	BAHL WATER CORP	Public Notice		Public Notification Violation for NPDWR Violation
IL0855200	BAHL WATER CORP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0855200	BAHL WATER CORP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0270150	BARTELSON	Lead and Copper Rule	03/01/2022	Water Quality Parameter M/R
IL0270150	BARTELSON	Lead and Copper Rule	03/01/2022	Water Quality Parameter M/R
IL0270150	BARTELSON	Lead and Copper Rule	03/01/2022	Water Quality Parameter M/R
IL0755125	BEAVER CREEK VILLAGE MHP	Lead and Copper Rule	02/09/2022	Lead Consumer Notice
IL0755125	BEAVER CREEK VILLAGE MHP	Lead and Copper Rule	02/09/2022	Lead Consumer Notice
IL0550050	BENTON	Lead and Copper Rule		Lead Consumer Notice
IL0550050	BENTON	Public Notice		Public Notification Violation for NPDWR Violation
IL0550050	BENTON	Public Notice		Public Notification Violation for NPDWR Violation
IL0550050	BENTON	Public Notice		Public Notification Violation for NPDWR Violation
IL1015300	BIRDS PINKSTAFF WATER DISTRICT	Consumer Confidence Rule	08/26/2022	Consumer Confidence Report Complete Failure to Report

IL1015300	BIRDS PINKSTAFF WATER DISTRICT	Consumer Confidence Rule	08/26/2022	Consumer Confidence Report Complete Failure to Report
IL1015300	BIRDS PINKSTAFF WATER DISTRICT	Public Notice		Public Notification Violation for NPDWR Violation
IL1015300	BIRDS PINKSTAFF WATER DISTRICT	Public Notice		Public Notification Violation for NPDWR Violation
IL1015300	BIRDS PINKSTAFF WATER DISTRICT	Public Notice		Public Notification Violation for NPDWR Violation
IL1015300	BIRDS PINKSTAFF WATER DISTRICT	Public Notice		Public Notification Violation for NPDWR Violation
IL0317765	BLACKHAWK ESTATES LLC	Combined Radium (- 226 and -228)	09/06/2022	Monitoring, Regular
IL0317765	BLACKHAWK ESTATES LLC	Combined Radium (- 226 and -228)	09/06/2022	Monitoring, Regular
IL0310240	BLUE ISLAND	Consumer Confidence Rule	07/27/2022	Consumer Confidence Report Complete Failure to Report
IL0310240	BLUE ISLAND	Consumer Confidence Rule	07/27/2022	Consumer Confidence Report Complete Failure to Report
IL1150100	BLUE MOUND	Chlorine	03/04/2022	Monitoring and Reporting (DBP)
IL1150100	BLUE MOUND	Chlorine	03/04/2022	Monitoring and Reporting (DBP)
IL1150100	BLUE MOUND	Chlorine	03/04/2022	Monitoring and Reporting (DBP)
IL1150100	BLUE MOUND	Revised Total Coliform Rule	03/04/2022	Monitoring, Routine (RTCR)
IL1150100	BLUE MOUND	Revised Total Coliform Rule	03/04/2022	Monitoring, Routine (RTCR)
IL0810150	BONNIE	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

IL0810150	BONNIE	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0670200	BOWEN	Lead and Copper Rule		WQP Entry Point/Tap Treatment Technique Non-Compliance
IL0670200	BOWEN	Lead and Copper Rule		WQP Entry Point/Tap Treatment Technique Non-Compliance
IL0450050	BROCTON	Public Notice		Public Notification Violation for NPDWR Violation
IL0130100	BRUSSELS	Lead and Copper Rule	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration
IL0130100	BRUSSELS	Lead and Copper Rule	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration
IL0130100	BRUSSELS	Lead and Copper Rule	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration
IL0130100	BRUSSELS	Lead and Copper Rule	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration
IL0130100	BRUSSELS	Lead and Copper Rule	04/29/2022	OCCT/SOWT Treatment Installation/Demonstration
IL1430080	BUFFALO HOLLOW FARMS WATER ASSOC	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0010050	CAMP POINT	Lead and Copper Rule		WQP Entry Point/Tap Treatment Technique Non-Compliance
IL0010050	CAMP POINT	Lead and Copper Rule		WQP Entry Point/Tap Treatment Technique Non-Compliance
IL0315175	CANDLELIGHT VILLAGE MHP	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0570250	CANTON	Consumer Confidence Rule	08/01/2022	Consumer Confidence Report Complete Failure to Report
IL0570250	CANTON	Consumer Confidence Rule	08/01/2022	Consumer Confidence Report Complete Failure to Report

IL0570250	CANTON	Consumer Confidence Rule	08/01/2022	Consumer Confidence Report Complete Failure to Report
IL1990150	CARTERVILLE	TTHM	08/26/2022	Monitoring and Reporting (DBP)
IL1990150	CARTERVILLE	TTHM	08/26/2022	Monitoring and Reporting (DBP)
IL1990150	CARTERVILLE	TTHM	08/26/2022	Monitoring and Reporting (DBP)
IL1615170	CEDAR BROOK ESTATES SUBDIVISION	Lead and Copper Rule	02/21/2022	Initial, Follow-up, or Routine Source Water M/R
IL1615170	CEDAR BROOK ESTATES SUBDIVISION	Lead and Copper Rule	02/21/2022	Initial, Follow-up, or Routine Source Water M/R
IL1615170	CEDAR BROOK ESTATES SUBDIVISION	Lead and Copper Rule	02/21/2022	Initial, Follow-up, or Routine Source Water M/R
IL0150020	CENTURY PINES APARTMENTS	Chlorine	05/02/2022	Monitoring and Reporting (DBP)
IL0150020	CENTURY PINES APARTMENTS	Chlorine	05/02/2022	Monitoring and Reporting (DBP)
IL0150020	CENTURY PINES APARTMENTS	Chlorine	05/02/2022	Monitoring and Reporting (DBP)
IL0150020	CENTURY PINES APARTMENTS	Chlorine	05/02/2022	Monitoring and Reporting (DBP)
IL0150020	CENTURY PINES APARTMENTS	Chlorine	06/06/2022	Monitoring and Reporting (DBP)
IL0150020	CENTURY PINES APARTMENTS	Chlorine	06/06/2022	Monitoring and Reporting (DBP)
IL0150020	CENTURY PINES APARTMENTS	Chlorine	06/06/2022	Monitoring and Reporting (DBP)
IL0150020	CENTURY PINES APARTMENTS	Chlorine	08/30/2022	Monitoring and Reporting (DBP)

IL0150020	CENTURY PINES APARTMENTS	Chlorine	08/30/2022	Monitoring and Reporting (DBP)
IL0150020	CENTURY PINES APARTMENTS	Chlorine	08/30/2022	Monitoring and Reporting (DBP)
IL0150020	CENTURY PINES APARTMENTS	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0150020	CENTURY PINES APARTMENTS	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0150020	CENTURY PINES APARTMENTS	Revised Total Coliform Rule	05/02/2022	Monitoring, Routine (RTCR)
IL0150020	CENTURY PINES APARTMENTS	Revised Total Coliform Rule	05/02/2022	Monitoring, Routine (RTCR)
IL0150020	CENTURY PINES APARTMENTS	Revised Total Coliform Rule	05/02/2022	Monitoring, Routine (RTCR)
IL0150020	CENTURY PINES APARTMENTS	Revised Total Coliform Rule	05/02/2022	Monitoring, Routine (RTCR)
IL0150020	CENTURY PINES APARTMENTS	Revised Total Coliform Rule	05/02/2022	Monitoring, Routine (RTCR)
IL0150020	CENTURY PINES APARTMENTS	Revised Total Coliform Rule	05/02/2022	Monitoring, Routine (RTCR)
IL0150020	CENTURY PINES APARTMENTS	Revised Total Coliform Rule	05/02/2022	Monitoring, Routine (RTCR)
IL0150020	CENTURY PINES APARTMENTS	Revised Total Coliform Rule	05/02/2022	Monitoring, Routine (RTCR)
IL0150020	CENTURY PINES APARTMENTS	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0316000	CHICAGO	Lead and Copper Rule	02/01/2022	Lead Consumer Notice
IL0316000	CHICAGO	Lead and Copper Rule	02/01/2022	Lead Consumer Notice
IL0316000	CHICAGO	Total Polychlorinated Biphenyls (PCB)		Monitoring, Regular

IL0316000	CHICAGO	Total Polychlorinated Biphenyls (PCB)		Monitoring, Regular
IL0450100	CHRISMAN	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0450100	CHRISMAN	Lead and Copper Rule	07/01/2022	Lead Consumer Notice
IL0450100	CHRISMAN	Lead and Copper Rule	07/01/2022	Lead Consumer Notice
IL0450100	CHRISMAN	Lead and Copper Rule	07/01/2022	Lead Consumer Notice
IL0450100	CHRISMAN	Lead and Copper Rule		Lead Consumer Notice
IL0450100	CHRISMAN	Lead and Copper Rule		Lead Consumer Notice
IL0450100	CHRISMAN	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0450100	CHRISMAN	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0450100	CHRISMAN	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0450100	CHRISMAN	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL0450100	CHRISMAN	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL0450100	CHRISMAN	Lead and Copper Rule		Public Education
IL0450100	CHRISMAN	Public Notice	07/15/2022	Public Notification Violation for NPDWR Violation
IL0450100	CHRISMAN	Public Notice	07/15/2022	Public Notification Violation for NPDWR Violation

IL0550150	CHRISTOPHER	Lead and Copper Rule	01/28/2022	Lead Consumer Notice
IL0550150	CHRISTOPHER	Lead and Copper Rule	01/28/2022	Lead Consumer Notice
IL0310510	CICERO	Chlorine	03/01/2022	Monitoring and Reporting (DBP)
IL0310510	CICERO	Chlorine	03/01/2022	Monitoring and Reporting (DBP)
IL0310510	CICERO	Chlorine	03/01/2022	Monitoring and Reporting (DBP)
IL0310510	CICERO	Revised Total Coliform Rule	03/01/2022	Monitoring, Routine (RTCR)
IL0310510	CICERO	Revised Total Coliform Rule	03/01/2022	Monitoring, Routine (RTCR)
IL0310510	CICERO	Revised Total Coliform Rule	03/01/2022	Monitoring, Routine (RTCR)
IL0250020	CLAY COUNTY WATER INC	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL1610160	CLOVER LEAF VILLAGE MHP	Consumer Confidence Rule	09/05/2022	Consumer Confidence Report Complete Failure to Report
IL1610160	CLOVER LEAF VILLAGE MHP	Consumer Confidence Rule	09/05/2022	Consumer Confidence Report Complete Failure to Report
IL1610160	CLOVER LEAF VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1610160	CLOVER LEAF VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1610160	CLOVER LEAF VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1610160	CLOVER LEAF VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

IL1610160	CLOVER LEAF VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1610160	CLOVER LEAF VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1610160	CLOVER LEAF VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1610160	CLOVER LEAF VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0630200	COAL CITY	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation
IL0630200	COAL CITY	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation
IL0630200	COAL CITY	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation
IL0630200	COAL CITY	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation
IL0630200	COAL CITY	Public Notice	04/20/2022	Public Notification Violation for NPDWR Violation
IL0630200	COAL CITY	Public Notice	04/20/2022	Public Notification Violation for NPDWR Violation
IL1030150	COMPTON	Public Notice	06/09/2022	Public Notification Violation for NPDWR Violation
IL1030150	COMPTON	Public Notice	06/09/2022	Public Notification Violation for NPDWR Violation
IL1030150	COMPTON	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average

IL1030150	COMPTON	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1030150	COMPTON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL0375125	CORTLAND CORNERS MHP	Chlorine		Monitoring and Reporting (DBP)
IL0375125	CORTLAND CORNERS MHP	Chlorine		Monitoring and Reporting (DBP)
IL0375125	CORTLAND CORNERS MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

IL0375125	CORTLAND CORNERS MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0375125	CORTLAND CORNERS MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0375125	CORTLAND CORNERS MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0375125	CORTLAND CORNERS MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0375125	CORTLAND CORNERS MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0375125	CORTLAND CORNERS MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995365	COUNTRY ACRES MHP (LA SALLE COUNTY)	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0735700	COUNTRY CLUB ESTATES SUBDIVISION	Lead and Copper Rule		Lead Consumer Notice
IL0735050	COUNTRY ESTATES SUBDIVISION	Lead and Copper Rule		Lead Consumer Notice

IL0310600	CRESTWOOD	Consumer Confidence Rule	07/18/2022	Consumer Confidence Report Complete Failure to Report
IL0310600	CRESTWOOD	Consumer Confidence Rule	07/18/2022	Consumer Confidence Report Complete Failure to Report
IL1975105	CRISWELL COURT MHP	1,1,1-Trichloroethane	04/25/2022	Monitoring, Regular
IL1975105	CRISWELL COURT MHP	1,1,1-Trichloroethane	04/25/2022	Monitoring, Regular
IL1975105	CRISWELL COURT MHP	1,1,1-Trichloroethane	04/25/2022	Monitoring, Regular
IL1975105	CRISWELL COURT MHP	1,1,1-Trichloroethane	04/25/2022	Monitoring, Regular
IL1975105	CRISWELL COURT MHP	1,1,1-Trichloroethane	04/25/2022	Monitoring, Regular
IL1975105	CRISWELL COURT MHP	1,1,1-Trichloroethane	04/25/2022	Monitoring, Regular
IL1975105	CRISWELL COURT MHP	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
IL1975105	CRISWELL COURT MHP	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
IL1975105	CRISWELL COURT MHP	Chlorine	03/07/2022	Monitoring and Reporting (DBP)
IL1975105	CRISWELL COURT MHP	Chlorine	03/07/2022	Monitoring and Reporting (DBP)
IL1975105	CRISWELL COURT MHP	Chlorine	03/07/2022	Monitoring and Reporting (DBP)
IL1975105	CRISWELL COURT MHP	Chlorine	08/03/2022	Monitoring and Reporting (DBP)
IL1975105	CRISWELL COURT MHP	Chlorine	08/03/2022	Monitoring and Reporting (DBP)
IL1975105	CRISWELL COURT MHP	Chlorine	08/03/2022	Monitoring and Reporting (DBP)

IL1975105	CRISWELL COURT MHP	Lead and Copper Rule		Lead Consumer Notice
IL1975105	CRISWELL COURT MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1975105	CRISWELL COURT MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1975105	CRISWELL COURT MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1975105	CRISWELL COURT MHP	Revised Total Coliform Rule	03/07/2022	Monitoring, Routine (RTCR)
IL1975105	CRISWELL COURT MHP	Revised Total Coliform Rule	03/07/2022	Monitoring, Routine (RTCR)
IL1975105	CRISWELL COURT MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1975105	CRISWELL COURT MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	Lead and Copper Rule		Lead Consumer Notice
IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	Public Notice		Public Notification Violation for NPDWR Violation
IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	Public Notice	06/03/2022	Public Notification Violation for NPDWR Violation

IL1135150	CROPSEY MUTUAL WATER ASSOCIATION	Public Notice	06/03/2022	Public Notification Violation for NPDWR Violation
IL1975480	CRYSTAL LAWNS ADDITION IMPROVEMENT ASSOC	Public Notice	03/10/2022	Public Notification Violation for NPDWR Violation
IL1975480	CRYSTAL LAWNS ADDITION IMPROVEMENT ASSOC	Public Notice	03/10/2022	Public Notification Violation for NPDWR Violation
IL1670400	DAWSON	Lead and Copper Rule	01/24/2022	Initial, Follow-up, or Routine Source Water M/R
IL1670400	DAWSON	Lead and Copper Rule	01/24/2022	Initial, Follow-up, or Routine Source Water M/R
IL1670400	DAWSON	Lead and Copper Rule	01/24/2022	Initial, Follow-up, or Routine Source Water M/R
IL1670400	DAWSON	Lead and Copper Rule	01/24/2022	Initial, Follow-up, or Routine Source Water M/R
IL1470200	DE LAND	Arsenic		Maximum Contaminant Level Violation, Average
IL1470200	DE LAND	Arsenic		Maximum Contaminant Level Violation, Average
IL1470200	DE LAND	Arsenic		Maximum Contaminant Level Violation, Average
IL1470200	DE LAND	Arsenic		Maximum Contaminant Level Violation, Average
IL1470200	DE LAND	Arsenic		Maximum Contaminant Level Violation, Average
IL1790150	DELAVAN	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1790150	DELAVAN	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0310660	DIXMOOR	Public Notice		Public Notification Violation for NPDWR Violation

IL1030200	DIXON	Combined Radium (-226 and -228)	07/20/2022	Monitoring, Regular
IL1030200	DIXON	Combined Radium (-226 and -228)	07/20/2022	Monitoring, Regular
IL0054360	DONNELSON	Public Notice	07/15/2022	Public Notification Violation for NPDWR Violation
IL0054360	DONNELSON	Public Notice	07/15/2022	Public Notification Violation for NPDWR Violation
IL0054360	DONNELSON	Public Notice	07/15/2022	Public Notification Violation for NPDWR Violation
IL0054360	DONNELSON	Public Notice		Public Notification Violation for NPDWR Violation
IL0054360	DONNELSON	TTHM		Maximum Contaminant Level Violation, Average
IL0054360	DONNELSON	TTHM		Maximum Contaminant Level Violation, Average
IL0054360	DONNELSON	TTHM		Maximum Contaminant Level Violation, Average
IL0054360	DONNELSON	TTHM		Maximum Contaminant Level Violation, Average
IL0054360	DONNELSON	TTHM		Maximum Contaminant Level Violation, Average
IL0054360	DONNELSON	TTHM		Maximum Contaminant Level Violation, Average
IL0054360	DONNELSON	TTHM		Maximum Contaminant Level Violation, Average
IL0054360	DONNELSON	TTHM		Maximum Contaminant Level Violation, Average
IL0054360	DONNELSON	TTHM		Maximum Contaminant Level Violation, Average

IL0054360	DONNELLSON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL0054360	DONNELLSON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL0054360	DONNELLSON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL0054360	DONNELLSON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL0054360	DONNELLSON	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL0750400	DONOVAN	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL0750400	DONOVAN	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL0750400	DONOVAN	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL0750400	DONOVAN	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL1615100	EAST LAWN WATER ASSOCIATION	Consumer Confidence Rule	08/05/2022	Consumer Confidence Report Complete Failure to Report
IL1615100	EAST LAWN WATER ASSOCIATION	Consumer Confidence Rule	08/05/2022	Consumer Confidence Report Complete Failure to Report
IL0335100	EATON PWD	Lead and Copper Rule	02/01/2022	Lead Consumer Notice
IL0335100	EATON PWD	Lead and Copper Rule	02/01/2022	Lead Consumer Notice
IL0415150	EGYPTIAN TRAIL WATER CORP	Lead and Copper Rule	01/27/2022	Lead Consumer Notice
IL0415150	EGYPTIAN TRAIL WATER CORP	Lead and Copper Rule	01/27/2022	Lead Consumer Notice

IL0610100	ELDRED	Lead and Copper Rule	02/08/2022	Initial, Follow-up, or Routine Source Water M/R
IL0610100	ELDRED	Lead and Copper Rule	02/08/2022	Initial, Follow-up, or Routine Source Water M/R
IL0610100	ELDRED	Lead and Copper Rule	02/08/2022	Initial, Follow-up, or Routine Source Water M/R
IL0610100	ELDRED	Lead and Copper Rule	02/08/2022	Initial, Follow-up, or Routine Source Water M/R
IL0894380	ELGIN	Lead and Copper Rule		Initial, Follow-up, or Routine Source Water M/R
IL0894380	ELGIN	Lead and Copper Rule		Initial, Follow-up, or Routine Source Water M/R
IL0590050	EQUALITY	Lead and Copper Rule	01/25/2022	Lead Consumer Notice
IL0590050	EQUALITY	Lead and Copper Rule	01/25/2022	Lead Consumer Notice
IL1617635	FALCON FARMS	Consumer Confidence Rule	08/12/2022	Consumer Confidence Report Complete Failure to Report
IL1617635	FALCON FARMS	Consumer Confidence Rule	08/12/2022	Consumer Confidence Report Complete Failure to Report
IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	Chlorine	09/07/2022	Monitoring and Reporting (DBP)
IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	Chlorine	09/07/2022	Monitoring and Reporting (DBP)
IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	Chlorine	09/07/2022	Monitoring and Reporting (DBP)
IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	Consumer Confidence Rule	08/01/2022	Consumer Confidence Report Complete Failure to Report
IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	Consumer Confidence Rule	08/01/2022	Consumer Confidence Report Complete Failure to Report

IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0995150	FIELDS HILL IMPROVEMENT ASSOCIATION	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1730100	FINDLAY	Chlorine	08/09/2022	Monitoring and Reporting (DBP)
IL1730100	FINDLAY	Chlorine	08/09/2022	Monitoring and Reporting (DBP)
IL1730100	FINDLAY	Chlorine	08/09/2022	Monitoring and Reporting (DBP)
IL1730100	FINDLAY	Chlorine	08/09/2022	Monitoring and Reporting (DBP)
IL1730100	FINDLAY	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1730100	FINDLAY	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1730100	FINDLAY	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0310720	FORD HEIGHTS	Public Notice		Public Notification Violation for NPDWR Violation
IL0310720	FORD HEIGHTS	Public Notice		Public Notification Violation for NPDWR Violation
IL0195945	FOUNTAIN VALLEY MHP	Lead and Copper Rule	02/07/2022	Lead Consumer Notice
IL0195945	FOUNTAIN VALLEY MHP	Lead and Copper Rule	02/07/2022	Lead Consumer Notice
IL0990060	FOUR STAR CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL1650150	GALATIA	Chloramine	08/26/2022	Monitoring and Reporting (DBP)

IL1650150	GALATIA	Chloramine	08/26/2022	Monitoring and Reporting (DBP)
IL1650150	GALATIA	Chloramine	08/26/2022	Monitoring and Reporting (DBP)
IL1650150	GALATIA	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1650150	GALATIA	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0735600	GENESEO HILLS SUBDIVISION	Lead and Copper Rule	04/12/2022	Initial, Follow-up, or Routine Source Water M/R
IL0735600	GENESEO HILLS SUBDIVISION	Lead and Copper Rule	04/12/2022	Initial, Follow-up, or Routine Source Water M/R
IL0735600	GENESEO HILLS SUBDIVISION	Lead and Copper Rule	04/12/2022	Initial, Follow-up, or Routine Source Water M/R
IL0735600	GENESEO HILLS SUBDIVISION	Lead and Copper Rule	04/12/2022	Initial, Follow-up, or Routine Source Water M/R
IL0311050	GLENWOOD	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0311050	GLENWOOD	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0311050	GLENWOOD	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0311050	GLENWOOD	Public Notice		Public Notification Violation for NPDWR Violation
IL1035165	GREEN ACRES MHP	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC	Combined Radium (-226 and -228)		Maximum Contaminant Level Violation, Average
IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC	Combined Radium (-226 and -228)		Maximum Contaminant Level Violation, Average

IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL2015495	GREEN MEADOW ESTATES OF ROCKFORD LLC	Combined Radium (- 226 and -228)		Monitoring, Regular
IL0610150	GREENFIELD	Lead and Copper Rule		Lead Consumer Notice
IL0610150	GREENFIELD	Public Notice	01/25/2022	Public Notification Violation for NPDWR Violation
IL0610150	GREENFIELD	Public Notice	01/25/2022	Public Notification Violation for NPDWR Violation
IL0610150	GREENFIELD	Public Notice	01/25/2022	Public Notification Violation for NPDWR Violation
IL0610150	GREENFIELD	Public Notice	01/25/2022	Public Notification Violation for NPDWR Violation
IL0610150	GREENFIELD	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation
IL0610150	GREENFIELD	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation
IL0610150	GREENFIELD	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation
IL0610150	GREENFIELD	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation
IL0350050	GREENUP	Lead and Copper Rule	01/18/2022	Lead Consumer Notice
IL0350050	GREENUP	Lead and Copper Rule	01/18/2022	Lead Consumer Notice

IL1470250	HAMMOND	Consumer Confidence Rule	07/26/2022	Consumer Confidence Report Complete Failure to Report
IL1470250	HAMMOND	Consumer Confidence Rule	07/26/2022	Consumer Confidence Report Complete Failure to Report
IL1030300	HARMON	Consumer Confidence Rule	09/14/2022	Consumer Confidence Report Complete Failure to Report
IL1030300	HARMON	Consumer Confidence Rule	09/14/2022	Consumer Confidence Report Complete Failure to Report
IL1030300	HARMON	Public Notice		Public Notification Violation for NPDWR Violation
IL1030300	HARMON	Public Notice	03/25/2022	Public Notification Violation for NPDWR Violation
IL1030300	HARMON	Public Notice	03/25/2022	Public Notification Violation for NPDWR Violation
IL0950250	HENDERSON	Public Notice		Public Notification Violation for NPDWR Violation
IL0950250	HENDERSON	Public Notice		Public Notification Violation for NPDWR Violation
IL1350010	HENDERSON PWD	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL1730150	HERRICK	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN	Arsenic		Maximum Contaminant Level Violation, Average
IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN	Arsenic		Maximum Contaminant Level Violation, Average
IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN	Arsenic		Maximum Contaminant Level Violation, Average
IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN	Arsenic		Maximum Contaminant Level Violation, Average

IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN	Arsenic		Maximum Contaminant Level Violation, Average
IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN	Arsenic		Maximum Contaminant Level Violation, Average
IL0730080	HICKORY HILLS 2ND ADDITION WATER ASSN	Arsenic		Maximum Contaminant Level Violation, Average
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation

IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0970255	HIGHLAND LAKE WATER COMPANY	Public Notice	03/09/2022	Public Notification Violation for NPDWR Violation
IL0975700	HILLDALE MANOR SUBDIVISION	Consumer Confidence Rule	07/25/2022	Consumer Confidence Report Complete Failure to Report
IL0975700	HILLDALE MANOR SUBDIVISION	Consumer Confidence Rule	07/25/2022	Consumer Confidence Report Complete Failure to Report
IL1130080	HILLTOP MHP	Chloramine	06/28/2022	Monitoring and Reporting (DBP)
IL1130080	HILLTOP MHP	Chloramine	06/28/2022	Monitoring and Reporting (DBP)
IL1130080	HILLTOP MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1130080	HILLTOP MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1130080	HILLTOP MHP	Public Notice		Public Notification Violation for NPDWR Violation
IL0610200	HILLVIEW	Lead and Copper Rule		Lead Consumer Notice
IL0311260	HODGKINS	Lead and Copper Rule	02/08/2022	Lead Consumer Notice
IL0311260	HODGKINS	Lead and Copper Rule	02/08/2022	Lead Consumer Notice

IL0975245	HOLLY HOCK HILL MHP	Public Notice		Public Notification Violation for NPDWR Violation
IL1955225	HONEYCUTT HILL MHP LLC	Pentachlorophenol	06/13/2022	Monitoring, Regular
IL1955225	HONEYCUTT HILL MHP LLC	Pentachlorophenol	06/13/2022	Monitoring, Regular
IL1955225	HONEYCUTT HILL MHP LLC	Pentachlorophenol	06/13/2022	Monitoring, Regular
IL1955225	HONEYCUTT HILL MHP LLC	Pentachlorophenol	06/13/2022	Monitoring, Regular
IL1790300	HOPEDALE	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0910040	HOPKINS PARK	Public Notice		Public Notification Violation for NPDWR Violation
IL0910040	HOPKINS PARK	Public Notice	04/08/2022	Public Notification Violation for NPDWR Violation
IL0910040	HOPKINS PARK	Public Notice	04/08/2022	Public Notification Violation for NPDWR Violation
IL0410350	IL AMERICAN-VILLA GROVE	Lead and Copper Rule	02/10/2022	Lead Consumer Notice
IL0410350	IL AMERICAN-VILLA GROVE	Lead and Copper Rule	02/10/2022	Lead Consumer Notice
IL0410350	IL AMERICAN-VILLA GROVE	Lead and Copper Rule	02/10/2022	Lead Consumer Notice
IL0410350	IL AMERICAN-VILLA GROVE	Lead and Copper Rule	02/10/2022	Lead Consumer Notice
IL1610120	ILCV CANDLE MHP, LLC	Lead and Copper Rule		Lead Consumer Notice
IL1610120	ILCV CANDLE MHP, LLC	Public Notice		Public Notification Violation for NPDWR Violation

IL1670550	ILLIOPOLIS	TTHM		Maximum Contaminant Level Violation, Average
IL1670550	ILLIOPOLIS	TTHM		Maximum Contaminant Level Violation, Average
IL1670550	ILLIOPOLIS	TTHM		Maximum Contaminant Level Violation, Average
IL1670550	ILLIOPOLIS	TTHM		Maximum Contaminant Level Violation, Average
IL1670550	ILLIOPOLIS	TTHM		Maximum Contaminant Level Violation, Average
IL1670550	ILLIOPOLIS	TTHM		Maximum Contaminant Level Violation, Average
IL1670550	ILLIOPOLIS	TTHM		Maximum Contaminant Level Violation, Average
IL1670550	ILLIOPOLIS	TTHM		Maximum Contaminant Level Violation, Average
IL0195350	ILUR PORTFOLIOS - CARRIAGE ESTATES LLC	Lead and Copper Rule	01/25/2022	Lead Consumer Notice
IL0195350	ILUR PORTFOLIOS - CARRIAGE ESTATES LLC	Lead and Copper Rule	01/25/2022	Lead Consumer Notice
IL1090300	INDUSTRY	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL1810250	JONESBORO	TTHM	08/24/2022	Maximum Contaminant Level Violation, Average
IL1810250	JONESBORO	TTHM	08/24/2022	Maximum Contaminant Level Violation, Average
IL1810250	JONESBORO	TTHM	08/24/2022	Maximum Contaminant Level Violation, Average
IL1810250	JONESBORO	TTHM	08/24/2022	Maximum Contaminant Level Violation, Average
IL1810250	JONESBORO	TTHM	08/24/2022	Maximum Contaminant Level Violation, Average

IL1435220	JUBILEE WATER COMPANY, INC.	Chlorine	03/09/2022	Monitoring and Reporting (DBP)
IL1435220	JUBILEE WATER COMPANY, INC.	Chlorine	03/09/2022	Monitoring and Reporting (DBP)
IL1435220	JUBILEE WATER COMPANY, INC.	Chlorine	03/09/2022	Monitoring and Reporting (DBP)
IL1435220	JUBILEE WATER COMPANY, INC.	Chlorine	03/09/2022	Monitoring and Reporting (DBP)
IL1435220	JUBILEE WATER COMPANY, INC.	Revised Total Coliform Rule	03/09/2022	Monitoring, Routine (RTCR)
IL1435220	JUBILEE WATER COMPANY, INC.	Revised Total Coliform Rule	03/09/2022	Monitoring, Routine (RTCR)
IL1435220	JUBILEE WATER COMPANY, INC.	Revised Total Coliform Rule	03/09/2022	Monitoring, Routine (RTCR)
IL0450200	KANSAS	Lead and Copper Rule		Lead Consumer Notice
IL0730650	KEWANEE	Lead and Copper Rule	01/14/2022	Lead Consumer Notice
IL0730650	KEWANEE	Lead and Copper Rule	01/14/2022	Lead Consumer Notice
IL0370250	KINGSTON	Lead and Copper Rule	01/21/2022	Lead Service Line Replacement (LSLR)
IL0370250	KINGSTON	Lead and Copper Rule	01/21/2022	Lead Service Line Replacement (LSLR)
IL0370250	KINGSTON	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL0370250	KINGSTON	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL0370250	KINGSTON	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration

IL1210300	KINMUNDY	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1210300	KINMUNDY	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1210300	KINMUNDY	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0630450	KINSMAN	Combined Radium (-226 and -228)	07/20/2022	Monitoring, Regular
IL0630450	KINSMAN	Combined Radium (-226 and -228)	07/20/2022	Monitoring, Regular
IL0990300	LA SALLE	TTHM		Maximum Contaminant Level Violation, Average
IL0990300	LA SALLE	TTHM		Maximum Contaminant Level Violation, Average
IL0990300	LA SALLE	TTHM		Maximum Contaminant Level Violation, Average
IL0990300	LA SALLE	TTHM		Maximum Contaminant Level Violation, Average
IL0990300	LA SALLE	TTHM		Maximum Contaminant Level Violation, Average
IL0990300	LA SALLE	TTHM		Maximum Contaminant Level Violation, Average
IL0990300	LA SALLE	TTHM		Maximum Contaminant Level Violation, Average
IL0990300	LA SALLE	TTHM		Maximum Contaminant Level Violation, Average
IL0990300	LA SALLE	TTHM		Maximum Contaminant Level Violation, Average
IL1750100	LAFAYETTE	Public Notice		Public Notification Violation for NPDWR Violation
IL1750100	LAFAYETTE	Public Notice		Public Notification Violation for NPDWR Violation

IL0975345	LAKE VIEW MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0975345	LAKE VIEW MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1190120	LAKESHORE ESTATES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1190120	LAKESHORE ESTATES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1190120	LAKESHORE ESTATES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1190120	LAKESHORE ESTATES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1190120	LAKESHORE ESTATES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1190120	LAKESHORE ESTATES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1190120	LAKESHORE ESTATES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1190120	LAKESHORE ESTATES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1190120	LAKESHORE ESTATES MHP	Chloramine		Monitoring and Reporting (DBP)
IL1190120	LAKESHORE ESTATES MHP	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL1190120	LAKESHORE ESTATES MHP	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL1190120	LAKESHORE ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1190120	LAKESHORE ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1190120	LAKESHORE ESTATES MHP	Public Notice		Public Notification Violation for NPDWR Violation

IL1190120	LAKESHORE ESTATES MHP	Public Notice		Public Notification Violation for NPDWR Violation
IL1190120	LAKESHORE ESTATES MHP	Public Notice		Public Notification Violation for NPDWR Violation
IL1190120	LAKESHORE ESTATES MHP	Public Notice		Public Notification Violation for NPDWR Violation
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)

IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1190120	LAKESHORE ESTATES MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0150100	LANARK	Lead and Copper Rule	01/31/2022	Lead Consumer Notice
IL0150100	LANARK	Lead and Copper Rule	01/31/2022	Lead Consumer Notice
IL0995050	LAND AND WTR ASSN	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995050	LAND AND WTR ASSN	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995050	LAND AND WTR ASSN	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995050	LAND AND WTR ASSN	Combined Radium (- 226 and -228)		Maximum Contaminant Level Violation, Average
IL0995050	LAND AND WTR ASSN	Public Notice	07/23/2022	Public Notification Violation for NPDWR Violation
IL0995050	LAND AND WTR ASSN	Public Notice	07/23/2022	Public Notification Violation for NPDWR Violation
IL1130750	LE ROY	Arsenic		Monitoring, Regular
IL1130750	LE ROY	Arsenic		Monitoring, Regular
IL0310370	LINDENTREE TOWNHOMES	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM	Lead and Copper Rule		OCCT/SOWT Study/Recommendation

IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL1978100	LOCKPORT TOWNSHIP WATER SYSTEM	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL0290010	LONGACRE ESTATES MHP	Chloramine	07/29/2022	Monitoring and Reporting (DBP)
IL0290010	LONGACRE ESTATES MHP	Chloramine	07/29/2022	Monitoring and Reporting (DBP)
IL0290010	LONGACRE ESTATES MHP	Chloramine	07/29/2022	Monitoring and Reporting (DBP)
IL0010450	LORAINE	Chlorine	02/28/2022	Monitoring and Reporting (DBP)
IL0010450	LORAINE	Chlorine	02/28/2022	Monitoring and Reporting (DBP)
IL0010450	LORAINE	Chlorine	02/28/2022	Monitoring and Reporting (DBP)
IL0010450	LORAINE	Chlorine	02/28/2022	Monitoring and Reporting (DBP)
IL0010450	LORAINE	Revised Total Coliform Rule	02/28/2022	Monitoring, Routine (RTCR)
IL0010450	LORAINE	Revised Total Coliform Rule	02/28/2022	Monitoring, Routine (RTCR)
IL0010450	LORAINE	Revised Total Coliform Rule	02/28/2022	Monitoring, Routine (RTCR)
IL0311680	LYNWOOD	Consumer Confidence Rule	06/10/2022	Consumer Confidence Report Complete Failure to Report
IL0311680	LYNWOOD	Consumer Confidence Rule	06/10/2022	Consumer Confidence Report Complete Failure to Report

IL0311680	LYNWOOD	Consumer Confidence Rule	06/10/2022	Consumer Confidence Report Complete Failure to Report
IL0311680	LYNWOOD	Consumer Confidence Rule	06/10/2022	Consumer Confidence Report Complete Failure to Report
IL0311680	LYNWOOD	Lead and Copper Rule	01/28/2022	Lead Consumer Notice
IL0311680	LYNWOOD	Lead and Copper Rule	01/28/2022	Lead Consumer Notice
IL0311680	LYNWOOD	Lead and Copper Rule	01/28/2022	Lead Consumer Notice
IL0554640	MACEDONIA	Consumer Confidence Rule	08/03/2022	Consumer Confidence Report Complete Failure to Report
IL0554640	MACEDONIA	Consumer Confidence Rule	08/03/2022	Consumer Confidence Report Complete Failure to Report
IL0190450	MAHOMET	Lead and Copper Rule	03/23/2022	Lead Consumer Notice
IL0190450	MAHOMET	Lead and Copper Rule	03/23/2022	Lead Consumer Notice
IL0110550	MALDEN	Public Notice		Public Notification Violation for NPDWR Violation
IL1710250	MANCHESTER	Lead and Copper Rule		Lead Consumer Notice
IL0110600	MANLIUS	Chlorine		Monitoring and Reporting (DBP)
IL1430500	MAPLETON	Lead and Copper Rule	07/21/2022	Lead Consumer Notice
IL1430500	MAPLETON	Lead and Copper Rule	07/21/2022	Lead Consumer Notice
IL1430500	MAPLETON	Lead and Copper Rule	07/21/2022	Lead Consumer Notice

IL1430500	MAPLETON	Lead and Copper Rule	07/21/2022	Lead Consumer Notice
IL1550250	MARK	TTHM	09/09/2022	Maximum Contaminant Level Violation, Average
IL1550250	MARK	TTHM	09/09/2022	Maximum Contaminant Level Violation, Average
IL1550250	MARK	TTHM	09/09/2022	Maximum Contaminant Level Violation, Average
IL1550250	MARK	TTHM	09/09/2022	Maximum Contaminant Level Violation, Average
IL1550250	MARK	TTHM	09/09/2022	Maximum Contaminant Level Violation, Average
IL1550250	MARK	TTHM	09/09/2022	Maximum Contaminant Level Violation, Average
IL0311770	MARKHAM	Chlorine	06/23/2022	Monitoring and Reporting (DBP)
IL0311770	MARKHAM	Chlorine	06/23/2022	Monitoring and Reporting (DBP)
IL0311770	MARKHAM	Chlorine	06/23/2022	Monitoring and Reporting (DBP)
IL0311770	MARKHAM	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0311770	MARKHAM	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0230100	MARSHALL	Lead and Copper Rule	01/26/2022	Lead Consumer Notice
IL0230100	MARSHALL	Lead and Copper Rule	01/26/2022	Lead Consumer Notice
IL0750600	MARTINTON	Chlorine	07/11/2022	Monitoring and Reporting (DBP)
IL0750600	MARTINTON	Chlorine	07/11/2022	Monitoring and Reporting (DBP)

IL0750600	MARTINTON	Chlorine	07/11/2022	Monitoring and Reporting (DBP)
IL0750600	MARTINTON	Chlorine	07/11/2022	Monitoring and Reporting (DBP)
IL0750600	MARTINTON	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0750600	MARTINTON	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0750600	MARTINTON	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0311830	MAYWOOD	Lead and Copper Rule	02/01/2022	Lead Consumer Notice
IL0311830	MAYWOOD	Lead and Copper Rule	02/01/2022	Lead Consumer Notice
IL0650200	MCLEANSBORO	Lead and Copper Rule	01/24/2022	Lead Consumer Notice
IL0650200	MCLEANSBORO	Lead and Copper Rule	01/24/2022	Lead Consumer Notice
IL1550150	MCNABB	Chlorine	09/07/2022	Monitoring and Reporting (DBP)
IL1550150	MCNABB	Chlorine	09/07/2022	Monitoring and Reporting (DBP)
IL1550150	MCNABB	Chlorine	09/07/2022	Monitoring and Reporting (DBP)
IL1550150	MCNABB	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1550150	MCNABB	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0710250	MEDIA	Lead and Copper Rule	03/31/2022	Lead Consumer Notice

IL0710250	MEDIA	Lead and Copper Rule	03/31/2022	Lead Consumer Notice
IL1515050	MILLSTONE PWD	Lead and Copper Rule	03/16/2022	Public Education
IL1515050	MILLSTONE PWD	Lead and Copper Rule	03/16/2022	Public Education
IL1515050	MILLSTONE PWD	Lead and Copper Rule	04/27/2022	OCCT/SOWT Study/Recommendation
IL1515050	MILLSTONE PWD	Lead and Copper Rule	04/27/2022	OCCT/SOWT Study/Recommendation
IL1515050	MILLSTONE PWD	Lead and Copper Rule	04/27/2022	OCCT/SOWT Study/Recommendation
IL1515050	MILLSTONE PWD	Lead and Copper Rule	04/27/2022	OCCT/SOWT Study/Recommendation
IL1515050	MILLSTONE PWD	Lead and Copper Rule	04/27/2022	OCCT/SOWT Study/Recommendation
IL1515050	MILLSTONE PWD	TTHM	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1515050	MILLSTONE PWD	TTHM	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1515050	MILLSTONE PWD	TTHM	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1515050	MILLSTONE PWD	TTHM	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1515050	MILLSTONE PWD	TTHM	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1515050	MILLSTONE PWD	TTHM	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1515050	MILLSTONE PWD	TTHM	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1515050	MILLSTONE PWD	TTHM	04/18/2022	Failure Submit IDSE/Subpart V Plan Rpt

IL1610350	MISSISSIPPI MANUFACTURED HOME COMMUNITY	Consumer Confidence Rule	07/27/2022	Consumer Confidence Report Complete Failure to Report
IL1195210	MITCHELL PWD	TTHM	09/09/2022	Monitoring and Reporting (DBP)
IL1195210	MITCHELL PWD	TTHM	09/09/2022	Monitoring and Reporting (DBP)
IL1195210	MITCHELL PWD	TTHM	09/09/2022	Monitoring and Reporting (DBP)
IL1530150	MOUNDS	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1530150	MOUNDS	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1530150	MOUNDS	Public Notice		Public Notification Violation for NPDWR Violation
IL1150350	MOUNT ZION	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL1150350	MOUNT ZION	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL1150350	MOUNT ZION	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL1150350	MOUNT ZION	Lead and Copper Rule		OCCT/SOWT Treatment Installation/Demonstration
IL1150350	MOUNT ZION	Public Notice	01/04/2022	Public Notification Violation for NPDWR Violation
IL1150350	MOUNT ZION	Public Notice	01/04/2022	Public Notification Violation for NPDWR Violation
IL1150350	MOUNT ZION	TTHM	02/10/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1150350	MOUNT ZION	TTHM	02/10/2022	Failure Submit IDSE/Subpart V Plan Rpt

IL1150350	MOUNT ZION	TTHM	02/10/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1150350	MOUNT ZION	TTHM	02/10/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1150350	MOUNT ZION	TTHM		Maximum Contaminant Level Violation, Average
IL1650250	MUDDY	Chlorine	05/31/2022	Monitoring and Reporting (DBP)
IL1650250	MUDDY	Chlorine	05/31/2022	Monitoring and Reporting (DBP)
IL1650250	MUDDY	Chlorine	05/31/2022	Monitoring and Reporting (DBP)
IL1650250	MUDDY	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1650250	MUDDY	Revised Total Coliform Rule		Monitoring, Routine (RTCR)

IL0050100	MULBERRY GROVE	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL0050100	MULBERRY GROVE	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL0050100	MULBERRY GROVE	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL0050100	MULBERRY GROVE	Total Haloacetic Acids (HAA5)		Maximum Contaminant Level Violation, Average
IL1490500	NEBO	Consumer Confidence Rule	01/18/2022	Consumer Confidence Report Complete Failure to Report
IL1490500	NEBO	Consumer Confidence Rule	01/18/2022	Consumer Confidence Report Complete Failure to Report
IL1490500	NEBO	Consumer Confidence Rule	01/18/2022	Consumer Confidence Report Complete Failure to Report
IL1490500	NEBO	Lead and Copper Rule	01/06/2022	Lead Consumer Notice
IL1490500	NEBO	Lead and Copper Rule	01/06/2022	Lead Consumer Notice
IL1490500	NEBO	Lead and Copper Rule	01/06/2022	Lead Consumer Notice
IL1490500	NEBO	Lead and Copper Rule	04/21/2022	Follow-up Or Routine LCR Tap M/R
IL1490500	NEBO	Lead and Copper Rule	04/21/2022	Follow-up Or Routine LCR Tap M/R
IL1490500	NEBO	Lead and Copper Rule	01/06/2022	Lead Consumer Notice
IL1490500	NEBO	Lead and Copper Rule	01/06/2022	Lead Consumer Notice
IL1490500	NEBO	Lead and Copper Rule	01/06/2022	Lead Consumer Notice

IL1490500	NEBO	Lead and Copper Rule	01/06/2022	Lead Consumer Notice
IL1490500	NEBO	Lead and Copper Rule		Lead Consumer Notice
IL1490500	NEBO	Public Notice	07/08/2022	Public Notification Violation for NPDWR Violation
IL1490500	NEBO	Public Notice	07/06/2022	Public Notification Violation for NPDWR Violation
IL1490500	NEBO	Public Notice	07/06/2022	Public Notification Violation for NPDWR Violation
IL0110700	NEPONSET	Lead and Copper Rule	02/11/2022	Lead Consumer Notice
IL0110700	NEPONSET	Lead and Copper Rule	02/11/2022	Lead Consumer Notice
IL0110700	NEPONSET	Public Notice		Public Notification Violation for NPDWR Violation
IL0110700	NEPONSET	Public Notice		Public Notification Violation for NPDWR Violation
IL0110700	NEPONSET	Public Notice		Public Notification Violation for NPDWR Violation
IL0110700	NEPONSET	Public Notice		Public Notification Violation for NPDWR Violation
IL1150400	NIANTIC	Public Notice	06/16/2022	Public Notification Violation for NPDWR Violation
IL1150400	NIANTIC	Public Notice	06/16/2022	Public Notification Violation for NPDWR Violation
IL1170750	NILWOOD	Lead and Copper Rule	05/06/2022	Lead Consumer Notice
IL1170750	NILWOOD	Lead and Copper Rule	05/06/2022	Lead Consumer Notice

IL1170750	NILWOOD	Public Notice	03/28/2022	Public Notification Violation for NPDWR Violation
IL1170750	NILWOOD	Public Notice	03/28/2022	Public Notification Violation for NPDWR Violation
IL1170750	NILWOOD	Public Notice	03/28/2022	Public Notification Violation for NPDWR Violation
IL1170750	NILWOOD	Public Notice	03/28/2022	Public Notification Violation for NPDWR Violation
IL1590150	NOBLE	TTHM		Maximum Contaminant Level Violation, Average
IL1590150	NOBLE	TTHM		Maximum Contaminant Level Violation, Average
IL1930350	NORRIS CITY	Consumer Confidence Rule	08/19/2022	Consumer Confidence Report Complete Failure to Report
IL1930350	NORRIS CITY	Consumer Confidence Rule	08/19/2022	Consumer Confidence Report Complete Failure to Report
IL1130060	NORTH MEADOW VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1130060	NORTH MEADOW VILLAGE MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1130060	NORTH MEADOW VILLAGE MHP	Public Notice		Public Notification Violation for NPDWR Violation
IL1795780	NORTH TAZEWELL PWD	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL1795780	NORTH TAZEWELL PWD	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL1795780	NORTH TAZEWELL PWD	Public Notice		Public Notification Violation for NPDWR Violation
IL0075275	OAK LAWN MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)

IL0075275	OAK LAWN MHP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0895400	OGDEN GARDENS SUBDIVISION	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0895400	OGDEN GARDENS SUBDIVISION	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0895400	OGDEN GARDENS SUBDIVISION	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0312280	OLYMPIA FIELDS	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0312280	OLYMPIA FIELDS	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0312280	OLYMPIA FIELDS	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0312280	OLYMPIA FIELDS	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0312280	OLYMPIA FIELDS	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation
IL0312280	OLYMPIA FIELDS	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation
IL0750700	ONARGA	Lead and Copper Rule	02/15/2022	Initial, Follow-up, or Routine Source Water M/R
IL0750700	ONARGA	Lead and Copper Rule	02/15/2022	Initial, Follow-up, or Routine Source Water M/R
IL0750700	ONARGA	Lead and Copper Rule	02/15/2022	Initial, Follow-up, or Routine Source Water M/R
IL0735150	OPHIEM PWS	Lead and Copper Rule	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
IL0735150	OPHIEM PWS	Lead and Copper Rule	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration

IL0735150	OPHIEM PWS	Lead and Copper Rule	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
IL0735150	OPHIEM PWS	Lead and Copper Rule	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
IL0735150	OPHIEM PWS	Lead and Copper Rule	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
IL0735150	OPHIEM PWS	Lead and Copper Rule	03/07/2022	OCCT/SOWT Treatment Installation/Demonstration
IL0735150	OPHIEM PWS	Lead and Copper Rule		Lead Consumer Notice
IL0975575	PARK CITY MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0975575	PARK CITY MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0312460	PARK RIDGE	Consumer Confidence Rule	07/14/2022	Consumer Confidence Report Complete Failure to Report
IL0312460	PARK RIDGE	Consumer Confidence Rule	07/14/2022	Consumer Confidence Report Complete Failure to Report
IL0312460	PARK RIDGE	TTHM	08/24/2022	Monitoring and Reporting (DBP)
IL0312460	PARK RIDGE	TTHM	08/24/2022	Monitoring and Reporting (DBP)
IL0312460	PARK RIDGE	TTHM	08/24/2022	Monitoring and Reporting (DBP)
IL0610450	PATTERSON (INC AS WILMINGTON)	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0610450	PATTERSON (INC AS WILMINGTON)	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1770400	PEARL CITY	Chlorine	08/18/2022	Monitoring and Reporting (DBP)

IL1770400	PEARL CITY	Chlorine	08/18/2022	Monitoring and Reporting (DBP)
IL1770400	PEARL CITY	Chlorine	08/18/2022	Monitoring and Reporting (DBP)
IL1770400	PEARL CITY	Public Notice	04/04/2022	Public Notification Violation for NPDWR Violation
IL1770400	PEARL CITY	Public Notice	04/04/2022	Public Notification Violation for NPDWR Violation
IL1770400	PEARL CITY	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1770400	PEARL CITY	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0910010	PEMBROKE TOWNSHIP	Consumer Confidence Rule	08/22/2022	Consumer Confidence Report Complete Failure to Report
IL0910010	PEMBROKE TOWNSHIP	Consumer Confidence Rule	08/22/2022	Consumer Confidence Report Complete Failure to Report
IL0910010	PEMBROKE TOWNSHIP	Public Notice		Public Notification Violation for NPDWR Violation
IL2015625	PHIL-AIRE ESTATES MHP	Combined Radium (-226 and -228)	07/28/2022	Maximum Contaminant Level Violation, Average
IL2015625	PHIL-AIRE ESTATES MHP	Combined Radium (-226 and -228)	07/28/2022	Maximum Contaminant Level Violation, Average
IL2015625	PHIL-AIRE ESTATES MHP	Combined Radium (-226 and -228)	07/28/2022	Maximum Contaminant Level Violation, Average
IL2015625	PHIL-AIRE ESTATES MHP	Combined Radium (-226 and -228)	07/28/2022	Maximum Contaminant Level Violation, Average
IL2015625	PHIL-AIRE ESTATES MHP	Combined Radium (-226 and -228)	07/28/2022	Maximum Contaminant Level Violation, Average
IL2015625	PHIL-AIRE ESTATES MHP	Combined Radium (-226 and -228)	09/06/2022	Monitoring, Regular

IL2015625	PHIL-AIRE ESTATES MHP	Combined Radium (- 226 and -228)	09/06/2022	Monitoring, Regular
IL2015625	PHIL-AIRE ESTATES MHP	Public Notice	06/29/2022	Public Notification Violation for NPDWR Violation
IL2015625	PHIL-AIRE ESTATES MHP	Public Notice	06/29/2022	Public Notification Violation for NPDWR Violation
IL0312490	PHOENIX	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0312490	PHOENIX	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0312490	PHOENIX	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0312490	PHOENIX	Public Notice		Public Notification Violation for NPDWR Violation
IL0312490	PHOENIX	Public Notice		Public Notification Violation for NPDWR Violation
IL0312490	PHOENIX	Public Notice	09/08/2022	Public Notification Violation for NPDWR Violation
IL0312490	PHOENIX	Public Notice	09/08/2022	Public Notification Violation for NPDWR Violation
IL0312490	PHOENIX	Public Notice	09/08/2022	Public Notification Violation for NPDWR Violation
IL0312490	PHOENIX	Public Notice	09/08/2022	Public Notification Violation for NPDWR Violation
IL0890160	PINGREE GROVE	Combined Radium (- 226 and -228)	04/29/2022	Monitoring, Regular
IL0890160	PINGREE GROVE	Combined Radium (- 226 and -228)	04/29/2022	Monitoring, Regular
IL1970800	PLAINFIELD	Lead and Copper Rule	03/30/2022	Lead Consumer Notice

IL1970800	PLAINFIELD	Lead and Copper Rule	03/30/2022	Lead Consumer Notice
IL1490800	PLEASANT HILL	Public Notice	03/15/2022	Public Notification Violation for NPDWR Violation
IL1490800	PLEASANT HILL	Public Notice	03/15/2022	Public Notification Violation for NPDWR Violation
IL1490800	PLEASANT HILL	Public Notice	03/15/2022	Public Notification Violation for NPDWR Violation
IL1490800	PLEASANT HILL	Public Notice	03/15/2022	Public Notification Violation for NPDWR Violation
IL1830650	POTOMAC	Public Notice		Public Notification Violation for NPDWR Violation
IL1830650	POTOMAC	Public Notice	06/13/2022	Public Notification Violation for NPDWR Violation
IL1830650	POTOMAC	Public Notice	06/13/2022	Public Notification Violation for NPDWR Violation
IL1830650	POTOMAC	Public Notice	06/13/2022	Public Notification Violation for NPDWR Violation
IL1830650	POTOMAC	Public Notice	06/13/2022	Public Notification Violation for NPDWR Violation
IL1830650	POTOMAC	Public Notice	06/13/2022	Public Notification Violation for NPDWR Violation
IL1830650	POTOMAC	Public Notice	06/13/2022	Public Notification Violation for NPDWR Violation
IL1830650	POTOMAC	Public Notice	06/13/2022	Public Notification Violation for NPDWR Violation
IL0895550	POWERS WATER CO, INC.	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0895550	POWERS WATER CO, INC.	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0895550	POWERS WATER CO, INC.	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

IL0895550	POWERS WATER CO, INC.	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0895550	POWERS WATER CO, INC.	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0895550	POWERS WATER CO, INC.	Public Notice		Public Notification Violation for NPDWR Violation
IL1115800	PRAIRIE PATH WATER COMPANY-WALK UP WOODS	Lead and Copper Rule	05/31/2022	Lead Consumer Notice
IL1115800	PRAIRIE PATH WATER COMPANY-WALK UP WOODS	Lead and Copper Rule	05/31/2022	Lead Consumer Notice
IL1530300	PULASKI	Chlorine	07/29/2022	Monitoring and Reporting (DBP)
IL1530300	PULASKI	Chlorine	07/29/2022	Monitoring and Reporting (DBP)
IL0510200	RAMSEY	Lead and Copper Rule	02/08/2022	Lead Consumer Notice
IL0510200	RAMSEY	Lead and Copper Rule	02/08/2022	Lead Consumer Notice
IL0510200	RAMSEY	Lead and Copper Rule	02/08/2022	Lead Consumer Notice
IL0510200	RAMSEY	Lead and Copper Rule	02/08/2022	Lead Consumer Notice
IL1570450	RED BUD	Lead and Copper Rule	02/11/2022	Initial, Follow-up, or Routine Source Water M/R
IL1570450	RED BUD	Lead and Copper Rule	02/11/2022	Initial, Follow-up, or Routine Source Water M/R
IL1570450	RED BUD	Lead and Copper Rule	02/11/2022	Initial, Follow-up, or Routine Source Water M/R
IL1570450	RED BUD	Lead and Copper Rule	02/11/2022	Initial, Follow-up, or Routine Source Water M/R

IL1570450	RED BUD	Lead and Copper Rule	02/11/2022	Initial, Follow-up, or Routine Source Water M/R
IL1570450	RED BUD	Lead and Copper Rule	06/29/2022	OCCT/SOWT Study/Recommendation
IL1570450	RED BUD	Lead and Copper Rule	06/29/2022	OCCT/SOWT Study/Recommendation
IL1570450	RED BUD	Lead and Copper Rule	06/29/2022	OCCT/SOWT Study/Recommendation
IL1570450	RED BUD	Lead and Copper Rule	06/29/2022	OCCT/SOWT Study/Recommendation
IL1570450	RED BUD	Lead and Copper Rule	06/29/2022	OCCT/SOWT Study/Recommendation
IL1570450	RED BUD	Lead and Copper Rule		WQP Entry Point/Tap Treatment Technique Non-Compliance
IL1570450	RED BUD	Lead and Copper Rule		WQP Entry Point/Tap Treatment Technique Non-Compliance
IL1570450	RED BUD	Lead and Copper Rule		WQP Entry Point/Tap Treatment Technique Non-Compliance
IL0312550	RIGHTON PARK	Public Notice		Public Notification Violation for NPDWR Violation
IL0635250	RIDGECREST NORTH SUBDIVISION	Ethylbenzene		Monitoring, Regular
IL0635250	RIDGECREST NORTH SUBDIVISION	Ethylbenzene		Monitoring, Regular
IL0590300	RIDGWAY	Lead and Copper Rule	01/25/2022	Lead Consumer Notice
IL0590300	RIDGWAY	Lead and Copper Rule	01/25/2022	Lead Consumer Notice
IL1955165	RIVERSIDE ESTATES MHP	Lead and Copper Rule	05/04/2022	Lead Consumer Notice
IL1955165	RIVERSIDE ESTATES MHP	Lead and Copper Rule	05/04/2022	Lead Consumer Notice

IL1955165	RIVERSIDE ESTATES MHP	Public Notice		Public Notification Violation for NPDWR Violation
IL1670950	RIVERTON	Chlorine	07/07/2022	Monitoring and Reporting (DBP)
IL1670950	RIVERTON	Chlorine	07/07/2022	Monitoring and Reporting (DBP)
IL1670950	RIVERTON	Chlorine	07/07/2022	Monitoring and Reporting (DBP)
IL1670950	RIVERTON	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1670950	RIVERTON	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1950450	ROCK FALLS	Consumer Confidence Rule	06/30/2022	Consumer Confidence Report Complete Failure to Report
IL1950450	ROCK FALLS	Consumer Confidence Rule	06/30/2022	Consumer Confidence Report Complete Failure to Report
IL1970850	ROCKDALE	Combined Radium (- 226 and -228)	07/01/2022	Monitoring, Regular
IL1970850	ROCKDALE	Combined Radium (- 226 and -228)	07/01/2022	Monitoring, Regular
IL1970850	ROCKDALE	Combined Radium (- 226 and -228)	07/01/2022	Monitoring, Regular
IL1970850	ROCKDALE	Consumer Confidence Rule	08/04/2022	Consumer Confidence Report Complete Failure to Report
IL1970850	ROCKDALE	Consumer Confidence Rule	08/04/2022	Consumer Confidence Report Complete Failure to Report
IL1970850	ROCKDALE	Public Notice		Public Notification Violation for NPDWR Violation
IL0735500	RUSTIC ACRES WATER ASSOCIATION	Lead and Copper Rule	03/03/2022	Initial, Follow-up, or Routine Source Water M/R

IL0735500	RUSTIC ACRES WATER ASSOCIATION	Lead and Copper Rule	03/03/2022	Initial, Follow-up, or Routine Source Water M/R
IL0735500	RUSTIC ACRES WATER ASSOCIATION	Lead and Copper Rule	03/03/2022	Initial, Follow-up, or Routine Source Water M/R
IL0312790	SAUK	Consumer Confidence Rule	07/14/2022	Consumer Confidence Report Complete Failure to Report
IL0312790	SAUK	Consumer Confidence Rule	07/14/2022	Consumer Confidence Report Complete Failure to Report
IL1170010	SCOTTVILLE RURAL WATER COMPANY, INC.	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1170010	SCOTTVILLE RURAL WATER COMPANY, INC.	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1170010	SCOTTVILLE RURAL WATER COMPANY, INC.	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL2030600	SECOR	Lead and Copper Rule	03/07/2022	Public Education
IL2030600	SECOR	Lead and Copper Rule	03/07/2022	Public Education
IL0150300	SHANNON	Consumer Confidence Rule	08/01/2022	Consumer Confidence Report Complete Failure to Report
IL0150300	SHANNON	Consumer Confidence Rule	08/01/2022	Consumer Confidence Report Complete Failure to Report
IL0750800	SHELDON	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0750800	SHELDON	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0750800	SHELDON	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0750800	SHELDON	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

IL0750800	SHELDON	Public Notice	01/06/2022	Public Notification Violation for NPDWR Violation
IL0750800	SHELDON	Public Notice	01/06/2022	Public Notification Violation for NPDWR Violation
IL0312970	SOUTH HOLLAND	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0312970	SOUTH HOLLAND	Lead and Copper Rule	03/07/2022	Public Education
IL0312970	SOUTH HOLLAND	Lead and Copper Rule	03/07/2022	Public Education
IL0312970	SOUTH HOLLAND	Lead and Copper Rule	06/28/2022	Public Education
IL0312970	SOUTH HOLLAND	Lead and Copper Rule	06/28/2022	Public Education
IL1370400	SOUTH JACKSONVILLE	Public Notice		Public Notification Violation for NPDWR Violation
IL1370400	SOUTH JACKSONVILLE	Public Notice		Public Notification Violation for NPDWR Violation
IL0310140	SOUTH PALOS TWSP SANITARY DIST	Lead and Copper Rule	01/20/2022	Lead Consumer Notice
IL0310140	SOUTH PALOS TWSP SANITARY DIST	Lead and Copper Rule	01/20/2022	Lead Consumer Notice
IL1190970	SOUTH ROXANA	Chlorine	09/12/2022	Monitoring and Reporting (DBP)
IL1190970	SOUTH ROXANA	Chlorine	09/12/2022	Monitoring and Reporting (DBP)
IL1190970	SOUTH ROXANA	Chlorine	09/12/2022	Monitoring and Reporting (DBP)
IL1190970	SOUTH ROXANA	Revised Total Coliform Rule		Monitoring, Routine (RTCR)

IL1190970	SOUTH ROXANA	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0630650	SOUTH WILMINGTON	Combined Radium (-226 and -228)	07/29/2022	Monitoring, Regular
IL0630650	SOUTH WILMINGTON	Combined Radium (-226 and -228)	07/29/2022	Monitoring, Regular
IL0630650	SOUTH WILMINGTON	Combined Uranium	07/29/2022	Monitoring, Regular
IL1570600	SPARTA	Chloramine	08/26/2022	Monitoring and Reporting (DBP)
IL1570600	SPARTA	Chloramine	08/26/2022	Monitoring and Reporting (DBP)
IL1570600	SPARTA	Chloramine	08/26/2022	Monitoring and Reporting (DBP)
IL1570600	SPARTA	Lead and Copper Rule	01/14/2022	Lead Consumer Notice
IL1570600	SPARTA	Lead and Copper Rule	01/14/2022	Lead Consumer Notice
IL1570600	SPARTA	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1570600	SPARTA	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL1977910	STATEVILLE CORRECTIONAL CENTER	Lead and Copper Rule	07/29/2022	OCCT/SOWT Study/Recommendation
IL1977910	STATEVILLE CORRECTIONAL CENTER	Lead and Copper Rule	07/29/2022	OCCT/SOWT Study/Recommendation
IL1977910	STATEVILLE CORRECTIONAL CENTER	Lead and Copper Rule	07/29/2022	OCCT/SOWT Study/Recommendation
IL1977910	STATEVILLE CORRECTIONAL CENTER	Lead and Copper Rule	07/29/2022	OCCT/SOWT Study/Recommendation

IL1775235	STEPHENSON MOBILE ESTATES	Consumer Confidence Rule	07/27/2022	Consumer Confidence Report Complete Failure to Report
IL1775235	STEPHENSON MOBILE ESTATES	Consumer Confidence Rule	07/27/2022	Consumer Confidence Report Complete Failure to Report
IL0315850	STERLING ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0315850	STERLING ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0315850	STERLING ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0315850	STERLING ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0315850	STERLING ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0315850	STERLING ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0315850	STERLING ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0315850	STERLING ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0315850	STERLING ESTATES MHP	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0313000	STICKNEY	TTHM		Monitoring and Reporting (DBP)
IL0313000	STICKNEY	TTHM		Monitoring and Reporting (DBP)
IL0313000	STICKNEY	TTHM		Monitoring and Reporting (DBP)
IL1795345	STONETOWN EDGEWOOD TERRACE, LLC	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1795345	STONETOWN EDGEWOOD TERRACE, LLC	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

IL1795345	STONETOWN EDGEWOOD TERRACE, LLC	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1795345	STONETOWN EDGEWOOD TERRACE, LLC	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1795345	STONETOWN EDGEWOOD TERRACE, LLC	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1795345	STONETOWN EDGEWOOD TERRACE, LLC	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1795345	STONETOWN EDGEWOOD TERRACE, LLC	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL1095200	STRATFORD WEST ASSOCIATION, INC.	Public Notice	06/14/2022	Public Notification Violation for NPDWR Violation
IL1095200	STRATFORD WEST ASSOCIATION, INC.	Public Notice	06/14/2022	Public Notification Violation for NPDWR Violation
IL1095200	STRATFORD WEST ASSOCIATION, INC.	Revised Total Coliform Rule	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
IL1095200	STRATFORD WEST ASSOCIATION, INC.	Revised Total Coliform Rule	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
IL1095200	STRATFORD WEST ASSOCIATION, INC.	Revised Total Coliform Rule	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
IL1095200	STRATFORD WEST ASSOCIATION, INC.	Revised Total Coliform Rule	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
IL1095200	STRATFORD WEST ASSOCIATION, INC.	Revised Total Coliform Rule	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
IL1095200	STRATFORD WEST ASSOCIATION, INC.	Revised Total Coliform Rule	01/16/2022	Treatment Technique, Level 1 Assessment (RTCR)
IL0313060	STREAMWOOD	Consumer Confidence Rule	08/16/2022	Consumer Confidence Report Complete Failure to Report
IL0313060	STREAMWOOD	Consumer Confidence Rule	08/16/2022	Consumer Confidence Report Complete Failure to Report

IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	Chlorine	04/05/2022	Monitoring and Reporting (DBP)
IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	Chlorine	04/05/2022	Monitoring and Reporting (DBP)
IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	Chlorine	04/05/2022	Monitoring and Reporting (DBP)
IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	Chlorine	04/05/2022	Monitoring and Reporting (DBP)
IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	Revised Total Coliform Rule	04/05/2022	Monitoring, Routine (RTCR)
IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	Revised Total Coliform Rule	04/05/2022	Monitoring, Routine (RTCR)
IL0375148	SUBURBAN APARTMENTS (DE KALB UNIV DVL)	Revised Total Coliform Rule	04/05/2022	Monitoring, Routine (RTCR)
IL0890850	SUGAR GROVE	Combined Radium (-226 and -228)	07/18/2022	Monitoring, Regular
IL0890850	SUGAR GROVE	Combined Radium (-226 and -228)	07/18/2022	Monitoring, Regular
IL0310060	SUMMIT	TTHM	09/10/2022	Monitoring and Reporting (DBP)
IL0310060	SUMMIT	TTHM	09/10/2022	Monitoring and Reporting (DBP)
IL0310060	SUMMIT	TTHM	09/10/2022	Monitoring and Reporting (DBP)
IL0735300	SUNNY HILL ESTATES SUBDIVISION	Lead and Copper Rule	01/24/2022	Lead Consumer Notice
IL0735300	SUNNY HILL ESTATES SUBDIVISION	Lead and Copper Rule	01/24/2022	Lead Consumer Notice
IL0370550	SYCAMORE	Combined Radium (-226 and -228)	09/21/2022	Monitoring, Regular

IL0370550	SYCAMORE	Combined Radium (-226 and -228)	09/21/2022	Monitoring, Regular
IL0570900	TABLE GROVE	TTHM		Maximum Contaminant Level Violation, Average
IL0570900	TABLE GROVE	TTHM		Maximum Contaminant Level Violation, Average
IL0570900	TABLE GROVE	TTHM		Maximum Contaminant Level Violation, Average
IL0570900	TABLE GROVE	TTHM		Maximum Contaminant Level Violation, Average
IL0570900	TABLE GROVE	TTHM		Maximum Contaminant Level Violation, Average
IL0570900	TABLE GROVE	TTHM		Maximum Contaminant Level Violation, Average
IL0570900	TABLE GROVE	TTHM		Maximum Contaminant Level Violation, Average
IL0570900	TABLE GROVE	TTHM		Maximum Contaminant Level Violation, Average
IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	Lead and Copper Rule	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	Lead and Copper Rule	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	Lead and Copper Rule	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	Lead and Copper Rule	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	Lead and Copper Rule	03/02/2022	Public Education
IL0971130	TANNERON BAY HOMEOWNERS ASSOCIATION	Lead and Copper Rule	03/02/2022	Public Education
IL0750850	THAWVILLE	Public Notice		Public Notification Violation for NPDWR Violation

IL0750850	THAWVILLE	Public Notice		Public Notification Violation for NPDWR Violation
IL0313090	THORNTON	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0735470	TIMBER RIDGE SBDV	Lead and Copper Rule	01/27/2022	Lead Consumer Notice
IL0735470	TIMBER RIDGE SBDV	Lead and Copper Rule	01/27/2022	Lead Consumer Notice
IL2035225	TIMBERLINE MHP	Chlorine	07/27/2022	Monitoring and Reporting (DBP)
IL2035225	TIMBERLINE MHP	Chlorine	07/27/2022	Monitoring and Reporting (DBP)
IL2035225	TIMBERLINE MHP	Chlorine	07/27/2022	Monitoring and Reporting (DBP)
IL0191000	TOLONO	TTHM	03/25/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL0191000	TOLONO	TTHM	03/25/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL0191000	TOLONO	TTHM	03/25/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL0191000	TOLONO	TTHM	03/25/2022	Failure Submit IDSE/Subpart V Plan Rpt
IL1750150	TOULON	Public Notice		Public Notification Violation for NPDWR Violation
IL1750150	TOULON	Public Notice		Public Notification Violation for NPDWR Violation
IL1615780	TOWER RIDGE SUBDIVISION	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average

IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0270500	TRENTON	TTHM	08/19/2022	Maximum Contaminant Level Violation, Average
IL0515500	VANDALIA CORRECTIONAL CENTER	Lead and Copper Rule	01/06/2022	Lead Consumer Notice
IL0515500	VANDALIA CORRECTIONAL CENTER	Lead and Copper Rule	01/06/2022	Lead Consumer Notice
IL1795050	VENADO LAKES-ARGYLL WATER ASSOCIATION	Lead and Copper Rule	04/14/2022	Initial, Follow-up, or Routine Source Water M/R
IL1795050	VENADO LAKES-ARGYLL WATER ASSOCIATION	Lead and Copper Rule	04/14/2022	Initial, Follow-up, or Routine Source Water M/R
IL1795050	VENADO LAKES-ARGYLL WATER ASSOCIATION	Lead and Copper Rule	04/14/2022	Initial, Follow-up, or Routine Source Water M/R
IL1795050	VENADO LAKES-ARGYLL WATER ASSOCIATION	Lead and Copper Rule	04/14/2022	Initial, Follow-up, or Routine Source Water M/R
IL0770550	VERGENNES	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation

IL0770550	VERGENNES	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation
IL0770550	VERGENNES	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation
IL0770550	VERGENNES	Public Notice	03/03/2022	Public Notification Violation for NPDWR Violation
IL0570950	VERMONT	Public Notice		Public Notification Violation for NPDWR Violation
IL0570950	VERMONT	TTHM	05/12/2022	Maximum Contaminant Level Violation, Average
IL0570950	VERMONT	TTHM	05/12/2022	Maximum Contaminant Level Violation, Average
IL0570950	VERMONT	TTHM	05/12/2022	Maximum Contaminant Level Violation, Average
IL0570950	VERMONT	TTHM	05/12/2022	Maximum Contaminant Level Violation, Average
IL0570950	VERMONT	TTHM	05/12/2022	Maximum Contaminant Level Violation, Average
IL0570950	VERMONT	TTHM	05/12/2022	Maximum Contaminant Level Violation, Average
IL0570950	VERMONT	TTHM	05/12/2022	Maximum Contaminant Level Violation, Average
IL0875510	VIENNA CORRECTIONAL CENTER	CARBON, TOTAL		Monitoring and Reporting (DBP)
IL0875510	VIENNA CORRECTIONAL CENTER	CARBON, TOTAL		Monitoring and Reporting (DBP)
IL1195350	VILLAGE GREEN MOBILE HOME PARK	Lead and Copper Rule		Initial Tap Sampling for Pb and Cu
IL1195350	VILLAGE GREEN MOBILE HOME PARK	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average
IL1195350	VILLAGE GREEN MOBILE HOME PARK	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average

IL1195350	VILLAGE GREEN MOBILE HOME PARK	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average
IL1195350	VILLAGE GREEN MOBILE HOME PARK	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average
IL1195350	VILLAGE GREEN MOBILE HOME PARK	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average
IL1195350	VILLAGE GREEN MOBILE HOME PARK	TTHM	08/22/2022	Maximum Contaminant Level Violation, Average
IL1350700	WAGGONER	Lead and Copper Rule	06/29/2022	Lead Consumer Notice
IL1350700	WAGGONER	Lead and Copper Rule	06/29/2022	Lead Consumer Notice
IL1350700	WAGGONER	Public Notice	03/24/2022	Public Notification Violation for NPDWR Violation
IL1350700	WAGGONER	Public Notice	03/24/2022	Public Notification Violation for NPDWR Violation
IL1350700	WAGGONER	Public Notice	03/24/2022	Public Notification Violation for NPDWR Violation
IL1350700	WAGGONER	Public Notice	03/24/2022	Public Notification Violation for NPDWR Violation
IL1350700	WAGGONER	Public Notice	03/24/2022	Public Notification Violation for NPDWR Violation
IL1350700	WAGGONER	Public Notice	03/24/2022	Public Notification Violation for NPDWR Violation
IL0111100	WALNUT	Lead and Copper Rule	07/29/2022	Water Quality Parameter M/R
IL0111100	WALNUT	Lead and Copper Rule	07/29/2022	Water Quality Parameter M/R
IL0111100	WALNUT	Lead and Copper Rule	07/29/2022	Water Quality Parameter M/R

IL0111100	WALNUT	Lead and Copper Rule	07/29/2022	Water Quality Parameter M/R
IL1214920	WAMAC	Consumer Confidence Rule	07/27/2022	Consumer Confidence Report Complete Failure to Report
IL1214920	WAMAC	Consumer Confidence Rule	07/27/2022	Consumer Confidence Report Complete Failure to Report
IL0850500	WARREN	Chlorine	06/17/2022	Monitoring and Reporting (DBP)
IL0850500	WARREN	Chlorine	06/17/2022	Monitoring and Reporting (DBP)
IL0850500	WARREN	Chlorine	06/17/2022	Monitoring and Reporting (DBP)
IL1790750	WASHINGTON	Lead and Copper Rule	01/26/2022	Lead Consumer Notice
IL1790750	WASHINGTON	Lead and Copper Rule	01/26/2022	Lead Consumer Notice
IL0390350	WELDON	Lead and Copper Rule	02/08/2022	Lead Consumer Notice
IL0390350	WELDON	Lead and Copper Rule	02/08/2022	Lead Consumer Notice
IL0550650	WEST CITY	Chloramine	08/08/2022	Monitoring and Reporting (DBP)
IL0550650	WEST CITY	Chloramine	08/08/2022	Monitoring and Reporting (DBP)
IL0550650	WEST CITY	Chloramine	08/08/2022	Monitoring and Reporting (DBP)
IL0550650	WEST CITY	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL0550650	WEST CITY	Revised Total Coliform Rule		Monitoring, Routine (RTCR)

IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT	Public Notice	08/10/2022	Public Notification Violation for NPDWR Violation
IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT	Public Notice	08/10/2022	Public Notification Violation for NPDWR Violation
IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT	TTHM		Maximum Contaminant Level Violation, Average
IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT	TTHM		Maximum Contaminant Level Violation, Average
IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT	TTHM		Maximum Contaminant Level Violation, Average
IL1595050	WEST LIBERTY-DUNDAS WATER DISTRICT	TTHM		Maximum Contaminant Level Violation, Average
IL0395225	WEST SIDE MHP	Lead and Copper Rule	02/28/2022	Initial, Follow-up, or Routine Source Water M/R
IL0395225	WEST SIDE MHP	Lead and Copper Rule	02/28/2022	Initial, Follow-up, or Routine Source Water M/R
IL0395225	WEST SIDE MHP	Lead and Copper Rule	02/28/2022	Initial, Follow-up, or Routine Source Water M/R
IL0395225	WEST SIDE MHP	Lead and Copper Rule	02/28/2022	Initial, Follow-up, or Routine Source Water M/R
IL0230200	WESTFIELD	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0230200	WESTFIELD	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0230200	WESTFIELD	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL0230200	WESTFIELD	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL0230200	WESTFIELD	Lead and Copper Rule		Water Quality Parameter M/R

IL0230200	WESTFIELD	Lead and Copper Rule		Water Quality Parameter M/R
IL0230200	WESTFIELD	Lead and Copper Rule	04/13/2022	Lead Consumer Notice
IL0230200	WESTFIELD	Lead and Copper Rule	04/13/2022	Lead Consumer Notice
IL0230200	WESTFIELD	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL0230200	WESTFIELD	Lead and Copper Rule		OCCT/SOWT Study/Recommendation
IL0230200	WESTFIELD	Public Notice		Public Notification Violation for NPDWR Violation
IL1610170	WHISPERING HILLS MHP	Consumer Confidence Rule	08/12/2022	Consumer Confidence Report Complete Failure to Report
IL1610170	WHISPERING HILLS MHP	Consumer Confidence Rule	08/12/2022	Consumer Confidence Report Complete Failure to Report
IL0610400	WHITE HALL	Consumer Confidence Rule	08/03/2022	Consumer Confidence Report Complete Failure to Report
IL0610400	WHITE HALL	Consumer Confidence Rule	08/03/2022	Consumer Confidence Report Complete Failure to Report
IL0610400	WHITE HALL	Lead and Copper Rule	05/14/2022	Lead Consumer Notice
IL0610400	WHITE HALL	Lead and Copper Rule	05/14/2022	Lead Consumer Notice
IL1450300	WILLISVILLE	Lead and Copper Rule	02/02/2022	Lead Consumer Notice
IL1450300	WILLISVILLE	Lead and Copper Rule	02/02/2022	Lead Consumer Notice
IL1971100	WILMINGTON	CARBON, TOTAL		Monitoring and Reporting (DBP)

IL1971100	WILMINGTON	CARBON, TOTAL		Monitoring and Reporting (DBP)
IL1730550	WINDSOR	Lead and Copper Rule	04/22/2022	OCCT/SOWT Study/Recommendation
IL1730550	WINDSOR	Lead and Copper Rule	04/22/2022	OCCT/SOWT Study/Recommendation
IL1730550	WINDSOR	Lead and Copper Rule	04/22/2022	OCCT/SOWT Study/Recommendation
IL1730550	WINDSOR	Lead and Copper Rule	04/22/2022	OCCT/SOWT Study/Recommendation
IL1730550	WINDSOR	Lead and Copper Rule	04/22/2022	OCCT/SOWT Study/Recommendation
IL1770550	WINSLOW	Consumer Confidence Rule	08/03/2022	Consumer Confidence Report Complete Failure to Report
IL1770550	WINSLOW	Consumer Confidence Rule	08/03/2022	Consumer Confidence Report Complete Failure to Report
IL0971950	WINTHROP HARBOR	Lead and Copper Rule		Lead Consumer Notice
IL0971950	WINTHROP HARBOR	Public Notice		Public Notification Violation for NPDWR Violation
IL0437245	WOOD DALE ESTATES	Consumer Confidence Rule		Consumer Confidence Report Complete Failure to Report
IL0437245	WOOD DALE ESTATES	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0437245	WOOD DALE ESTATES	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0437245	WOOD DALE ESTATES	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0437245	WOOD DALE ESTATES	Lead and Copper Rule	05/02/2022	Lead Consumer Notice

IL0437245	WOOD DALE ESTATES	Lead and Copper Rule	05/02/2022	Lead Consumer Notice
IL0751000	WOODLAND	Lead and Copper Rule	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
IL0751000	WOODLAND	Lead and Copper Rule	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
IL0751000	WOODLAND	Lead and Copper Rule	02/10/2022	Initial, Follow-up, or Routine Source Water M/R
IL0751000	WOODLAND	Lead and Copper Rule	04/20/2022	OCCT/SOWT Study/Recommendation
IL0751000	WOODLAND	Lead and Copper Rule	04/20/2022	OCCT/SOWT Study/Recommendation
IL0751000	WOODLAND	Lead and Copper Rule	04/20/2022	OCCT/SOWT Study/Recommendation
IL0250300	XENIA	Consumer Confidence Rule	07/14/2022	Consumer Confidence Report Complete Failure to Report
IL0250300	XENIA	Consumer Confidence Rule	07/14/2022	Consumer Confidence Report Complete Failure to Report
IL0550750	ZEIGLER	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0550750	ZEIGLER	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL0550750	ZEIGLER	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

Appendix C
Illinois EPA 2022 Annual Compliance Report
Transient Non-Community Violations Sorted by Contaminant

From U.S. EPA's CDX Reporting Services database

Contaminant Name	PWS ID	PWS Name	Resolved Date	Violation Type Description
1,1,1-Trichloroethane	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
1,1,2-Trichloroethane	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
1,1-Dichloroethylene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
1,2,4-Trichlorobenzene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
1,2,4-Trichlorobenzene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
1,2-Dichloroethane	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
1,2-Dichloropropane	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
2,4,5-TP	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
2,4,5-TP	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
2,4-D	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular

2,4-D	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Atrazine	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Atrazine	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Benzene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Benzo(a)pyrene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Benzo(a)pyrene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
BHC-GAMMA	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Carbofuran	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Carbofuran	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Carbon tetrachloride	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Chlordane	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Chlordane	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
CHLOROBENZENE	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
cis-1,2-Dichloroethylene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
cis-1,2-Dichloroethylene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular

Dalapon	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Di(2-ethylhexyl) adipate	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Di(2-ethylhexyl) adipate	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Di(2-ethylhexyl) phthalate	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Di(2-ethylhexyl) phthalate	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
DICHLOROMETHANE	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
DICHLOROMETHANE	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Dinoseb	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Dinoseb	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Diquat	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Diquat	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
E. COLI	IL3001875	CAMP AKITA/A FRAME WELL	03/29/2022	Monitoring, Source Water (GWR)
E. COLI	IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS		Monitoring, Source Water (GWR)
E. COLI	IL3116160	WOODLAND HILLS CAMPING & RECREATION	09/06/2022	Monitoring, Source Water (GWR)
E. COLI	IL3124164	THE GOOSE PIT		Monitoring, Source Water (GWR)

Endothall	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Endothall	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Endrin	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Ethylbenzene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
ETHYLENE DIBROMIDE	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
ETHYLENE DIBROMIDE	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Glyphosate	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Glyphosate	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Heptachlor	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Heptachlor	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Heptachlor epoxide	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Heptachlor epoxide	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
HEXACHLOROBENZENE	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
HEXACHLOROBENZENE	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Hexachlorocyclopentadiene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular

Hexachlorocyclopentadiene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
LASSO	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
LASSO	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Lead and Copper Rule	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Initial Tap Sampling for Pb and Cu
Lead and Copper Rule	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Initial Tap Sampling for Pb and Cu
Methoxychlor	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Nitrate	IL3003608	EVENING STAR CAMPING RESORT(3608)	09/07/2022	Monitoring, Regular
Nitrate	IL3006866	MACKTOWN GOLF COURSE CLUBHOUSE	08/09/2022	Monitoring, Regular
Nitrate	IL3046532	TRAVLUR MOTEL	08/16/2022	Monitoring, Regular
Nitrate	IL3085233	CRUISERS PIT STOP	08/01/2022	Monitoring, Regular
Nitrate	IL3090035	STROPE'S CAMPGROUND	08/09/2022	Monitoring, Regular
Nitrate	IL3117317	EXPRESS LANE GAS & FOOD MART	01/31/2022	Monitoring, Regular
o-Dichlorobenzene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
o-Dichlorobenzene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
OXAMYL	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular

OXAMYL	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
p-Dichlorobenzene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
p-Dichlorobenzene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Pentachlorophenol	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Pentachlorophenol	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Picloram	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Picloram	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Public Notice	IL3001164	PEORIA SPORTSMENS CLUB		Public Notification Violation for NPDWR Violation
Public Notice	IL3001248	HICKORY GROVE LAKE COMPANY	08/18/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3001354	HICKORY GROVE CAMPGROUND		Public Notification Violation for NPDWR Violation
Public Notice	IL3001420	CAMP ROBERT DRAKE		Public Notification Violation for NPDWR Violation
Public Notice	IL3001552	LITTLE GALILEE CHRISTIAN ASMBY		Public Notification Violation for NPDWR Violation
Public Notice	IL3002105	CAMP TAPAWINGO		Public Notification Violation for NPDWR Violation

Public Notice	IL3003509	UNCLE PAULIES		Public Notification Violation for NPDWR Violation
Public Notice	IL3003673	LINCOLN TRAIL FAMILY CAMPGROUND		Public Notification Violation for NPDWR Violation
Public Notice	IL3003673	LINCOLN TRAIL FAMILY CAMPGROUND		Public Notification Violation for NPDWR Violation
Public Notice	IL3003921	CAMP GRESHIEM CHRISTIAN RETREA		Public Notification Violation for NPDWR Violation
Public Notice	IL3003921	CAMP GRESHIEM CHRISTIAN RETREA		Public Notification Violation for NPDWR Violation
Public Notice	IL3004101	PIONEER POINT CAMPERS CLUB		Public Notification Violation for NPDWR Violation
Public Notice	IL3005876	LAST CHANCE SALOON (5876)		Public Notification Violation for NPDWR Violation
Public Notice	IL3006940	MARSHALL CO SPORTSMENS CLUB (6940)		Public Notification Violation for NPDWR Violation
Public Notice	IL3008797	PILGRIM PARK CAMP #3 POOL WELL		Public Notification Violation for NPDWR Violation
Public Notice	IL3008979	PILGRIM PARK CAMP #2 WASHHOUSE/EAST WELL		Public Notification Violation for NPDWR Violation
Public Notice	IL3009157	THE KITCHEN TABLE	08/31/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3010611	PONDEROSA WILDERNESS AREA		Public Notification Violation for

				NPDWR Violation
Public Notice	IL3014266	FOREST GLEN - POND WATER		Public Notification Violation for NPDWR Violation
Public Notice	IL3015222	NEWARK SPORTSMENS CLUB		Public Notification Violation for NPDWR Violation
Public Notice	IL3015404	BURNIDGE FOREST PRESERVE		Public Notification Violation for NPDWR Violation
Public Notice	IL3015420	LONE GROVE FOREST PRESERVE		Public Notification Violation for NPDWR Violation
Public Notice	IL3015420	LONE GROVE FOREST PRESERVE		Public Notification Violation for NPDWR Violation
Public Notice	IL3015446	FABYAN FOREST PRESERVE		Public Notification Violation for NPDWR Violation
Public Notice	IL3015503	ELBURN FOREST PRESERVE		Public Notification Violation for NPDWR Violation
Public Notice	IL3015602	SOUTH WILMINGTON FIREMANS #2		Public Notification Violation for NPDWR Violation
Public Notice	IL3015842	FOSSIL ROCK RECREATION CLUB		Public Notification Violation for NPDWR Violation
Public Notice	IL3015867	ENCHANTED SHORES /EAST WELL		Public Notification Violation for NPDWR Violation
Public Notice	IL3016865	SOUTH WILMINGTON FIREMANS #1		Public Notification Violation for NPDWR Violation

Public Notice	IL3017681	TIMBERLAKE RESORT		Public Notification Violation for NPDWR Violation
Public Notice	IL3017814	OFF THE STREET CLUB-CAMP MATHIEU		Public Notification Violation for NPDWR Violation
Public Notice	IL3019166	GALESBURG EAST KOA		Public Notification Violation for NPDWR Violation
Public Notice	IL3019455	PILGRIM PARK CAMP #1 MAIN WELL		Public Notification Violation for NPDWR Violation
Public Notice	IL3019455	PILGRIM PARK CAMP #1 MAIN WELL		Public Notification Violation for NPDWR Violation
Public Notice	IL3019604	AYERS LANDING	08/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3022251	NEW LENOX SPORTSMANS CLUB		Public Notification Violation for NPDWR Violation
Public Notice	IL3022285	NEW LENOX SPORTSMANS CLUB (22285)		Public Notification Violation for NPDWR Violation
Public Notice	IL3023564	JACK AND LIDIAS RESORT		Public Notification Violation for NPDWR Violation
Public Notice	IL3028480	BOBS MARINA		Public Notification Violation for NPDWR Violation
Public Notice	IL3029611	FOX RANCH TAVERN		Public Notification Violation for NPDWR Violation
Public Notice	IL3030890	JERUSALEM UNITED METHODIST CHURCH		Public Notification Violation for

				NPDWR Violation
Public Notice	IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)		Public Notification Violation for NPDWR Violation
Public Notice	IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)		Public Notification Violation for NPDWR Violation
Public Notice	IL3032920	OHANA VENTURES/SHADY LAKES		Public Notification Violation for NPDWR Violation
Public Notice	IL3033837	CAMP TUCKABATCHEE		Public Notification Violation for NPDWR Violation
Public Notice	IL3034595	THE STABLES, LLC		Public Notification Violation for NPDWR Violation
Public Notice	IL3046532	TRAVLUR MOTEL		Public Notification Violation for NPDWR Violation
Public Notice	IL3047472	TOLLWAY INN	08/19/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3057646	WILDWOOD CAMPGROUND		Public Notification Violation for NPDWR Violation
Public Notice	IL3058628	EUREKA SPORTSMENS CLUB		Public Notification Violation for NPDWR Violation
Public Notice	IL3062307	AMBE GASOLINE		Public Notification Violation for NPDWR Violation
Public Notice	IL3065706	SPRING LAKE MARINA LIMITED		Public Notification Violation for NPDWR Violation

Public Notice	IL3066399	OLD STARKS TAVERN	Public Notification Violation for NPDWR Violation
Public Notice	IL3069096	GIANT GOOSE RANCH LLC	Public Notification Violation for NPDWR Violation
Public Notice	IL3069104	GAMBER COVE	Public Notification Violation for NPDWR Violation
Public Notice	IL3069104	GAMBER COVE	Public Notification Violation for NPDWR Violation
Public Notice	IL3073056	GLENWOOD FOREST PRESERVE	Public Notification Violation for NPDWR Violation
Public Notice	IL3075960	TIERRA MAR	Public Notification Violation for NPDWR Violation
Public Notice	IL3078162	KNOX CO SPORTSMENS CLUB	Public Notification Violation for NPDWR Violation
Public Notice	IL3085233	CRUISERS PIT STOP	Public Notification Violation for NPDWR Violation
Public Notice	IL3085746	SUNSET LAKES RESORT (85746) HOUSE WELL	Public Notification Violation for NPDWR Violation
Public Notice	IL3085795	CAMP HAUBERG (85795) SOUTH WELL	Public Notification Violation for NPDWR Violation
Public Notice	IL3085803	CAMP HAUBERG (85803) NORTH WELL	Public Notification Violation for NPDWR Violation
Public Notice	IL3085894	LOUD THUNDER FP-W SHW BLD-A	Public Notification Violation for

				NPDWR Violation
Public Notice	IL3085902	LOUD THUNDER FP-RIVERVIEW-B		Public Notification Violation for NPDWR Violation
Public Notice	IL3086207	BSA-LOUD THUNDER UPPER		Public Notification Violation for NPDWR Violation
Public Notice	IL3090282	FAITH BIBLE CAMP		Public Notification Violation for NPDWR Violation
Public Notice	IL3090282	FAITH BIBLE CAMP		Public Notification Violation for NPDWR Violation
Public Notice	IL3094011	MATTHIESSEN STATE PARK (94011)		Public Notification Violation for NPDWR Violation
Public Notice	IL3095117	CAMP HENRY HORNER/POOL PUMP HOUSE		Public Notification Violation for NPDWR Violation
Public Notice	IL3095133	CAMP DUNCAN SORENSON LODGE		Public Notification Violation for NPDWR Violation
Public Notice	IL3095299	SOUTH WILMINGTON SPORTSMAN CLU (95299)		Public Notification Violation for NPDWR Violation
Public Notice	IL3095653	JUBILEE ST PK #1 QUAIL MEADOWS		Public Notification Violation for NPDWR Violation
Public Notice	IL3095828	SILVER SPRINGS STATE PARK (95828)		Public Notification Violation for NPDWR Violation
Public Notice	IL3103135	JIMBOS TAVERN		Public Notification Violation for NPDWR Violation

Public Notice	IL3104679	USFS GARDEN OF THE GODS CAMPGD		Public Notification Violation for NPDWR Violation
Public Notice	IL3105544	LENS HIDEAWAY		Public Notification Violation for NPDWR Violation
Public Notice	IL3111039	FRANCIS PARK		Public Notification Violation for NPDWR Violation
Public Notice	IL3111039	FRANCIS PARK		Public Notification Violation for NPDWR Violation
Public Notice	IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS		Public Notification Violation for NPDWR Violation
Public Notice	IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS		Public Notification Violation for NPDWR Violation
Public Notice	IL3115287	WOODFORD COUNTY IZAAK WALTON	09/25/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3115287	WOODFORD COUNTY IZAAK WALTON		Public Notification Violation for NPDWR Violation
Public Notice	IL3115295	GENESEO CAMPGROUND		Public Notification Violation for NPDWR Violation
Public Notice	IL3115451	RADNOR ROD AND GUN CLUB		Public Notification Violation for NPDWR Violation
Public Notice	IL3115493	MALLARD BEND RESORT LLC WEST WELL		Public Notification Violation for NPDWR Violation
Public Notice	IL3117523	CACTUS COUNTRY	04/18/2022	Public Notification Violation for

				NPDWR Violation
Public Notice	IL3122275	WEBBS VALLEY VIEW CAMPGROUND		Public Notification Violation for NPDWR Violation
Public Notice	IL3122275	WEBBS VALLEY VIEW CAMPGROUND		Public Notification Violation for NPDWR Violation
Public Notice	IL3126573	ROLLING OAKS CAMPGROUND (126573)		Public Notification Violation for NPDWR Violation
Public Notice	IL3130849	TIMBER PNTE OTDR CNTR-MAIN CAM	08/15/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3132449	LUCKY FIFTY CLUB		Public Notification Violation for NPDWR Violation
Public Notice	IL3132829	PLANK ROAD TAP ROOM		Public Notification Violation for NPDWR Violation
Public Notice	IL3134403	COMLARA PARK SHOWERHOUSE		Public Notification Violation for NPDWR Violation
Public Notice	IL3134635	BLACK MARINE INC CAMPGROUND		Public Notification Violation for NPDWR Violation
Public Notice	IL3134957	COSMAN BIKE TRAIL 1250		Public Notification Violation for NPDWR Violation
Public Notice	IL3136192	LITTLE JOHN CONSERVATION CLUB		Public Notification Violation for NPDWR Violation
Public Notice	IL3138552	LOGAN PARK		Public Notification Violation for NPDWR Violation

Public Notice	IL3139139	WELDON SPRINGS SP SHWRHSE	Public Notification Violation for NPDWR Violation
Public Notice	IL3139485	AURORA WEST FOREST PRESERVE	Public Notification Violation for NPDWR Violation
Public Notice	IL3142638	CAMP AKITA LODGE WELL	Public Notification Violation for NPDWR Violation
Public Notice	IL3147322	MACKTOWN GOLF COURSE #14 TEE	Public Notification Violation for NPDWR Violation
Public Notice	IL3149229	WESTERN ILLINOIS NATURE GROUP	Public Notification Violation for NPDWR Violation
Public Notice	IL3149484	DEER CREEK CAMPGROUND	Public Notification Violation for NPDWR Violation
Public Notice	IL3149484	DEER CREEK CAMPGROUND	Public Notification Violation for NPDWR Violation
Public Notice	IL3150979	SAUER FAMILY FARM FOREST PRESERVE	Public Notification Violation for NPDWR Violation
Public Notice	IL3151183	STONE CITY SOFTBALL CONCESSION	Public Notification Violation for NPDWR Violation
Public Notice	IL3156117	SUNSET RIDGE MX CAMPGROUND	Public Notification Violation for NPDWR Violation
Public Notice	IL3156117	SUNSET RIDGE MX CAMPGROUND	Public Notification Violation for NPDWR Violation
Public Notice	IL3156562	FAITH COMMUNITY WORSHIP CENTER	Public Notification Violation for

				NPDWR Violation
Revised Total Coliform Rule	IL3000406	RICE LAKE WILDLIFE AREA	03/30/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3000406	RICE LAKE WILDLIFE AREA		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3000554	HICKORY SHORES RESORT	09/29/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3000711	GLENWOOD RV RESORT	04/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3000711	GLENWOOD RV RESORT	04/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3000737	TROLL HOLLOW - WEST	04/25/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3000828	ROLLING OAKS OFFICE WELL	04/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3000828	ROLLING OAKS OFFICE WELL	04/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3000844	NATURE'S WAY RV PARK	06/21/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3000992	FISH N FUN CLUB	04/04/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3001230	YOUNGS LAKE	08/23/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3001230	YOUNGS LAKE	08/23/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3001230	YOUNGS LAKE	08/23/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3001230	YOUNGS LAKE		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3001248	HICKORY GROVE LAKE COMPANY		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3001354	HICKORY GROVE CAMPGROUND		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3001420	CAMP ROBERT DRAKE	09/20/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3001420	CAMP ROBERT DRAKE	04/14/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3001420	CAMP ROBERT DRAKE	09/20/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3001420	CAMP ROBERT DRAKE	04/14/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3001875	CAMP AKITA/A FRAME WELL	05/16/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3002097	CAMP MANITOUMI		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3002097	CAMP MANITOUMI		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3002121	TRENTON SPORTSMAN CLUB	07/13/2022	Monitoring, Additional Routine (RTCR)

Revised Total Coliform Rule	IL3003020	WALNUT PT SP WELL2 CONCESSIONS/CAMPGRND	07/07/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3003020	WALNUT PT SP WELL2 CONCESSIONS/CAMPGRND	07/07/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3003087	KINGSTON TOWNSHIP PARK		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3003426	TRI-COUNTY COUNTRY CLUB	04/18/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3003475	HICKORY LANE CAMPING	05/02/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3003608	EVENING STAR CAMPING RESORT(3608)	09/07/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3003608	EVENING STAR CAMPING RESORT(3608)	09/28/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3003608	EVENING STAR CAMPING RESORT(3608)	09/07/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3003657	SAND RIDGE STATE FOREST (3657)	09/12/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3003673	LINCOLN TRAIL FAMILY CAMPGROUND	03/29/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3003863	SPRINGFIELD KOA KAMPGROUND INC	06/13/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3004101	PIONEER POINT CAMPERS CLUB	04/03/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3004150	EVENING STAR CAMPING RESORT (4150)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3004150	EVENING STAR CAMPING RESORT (4150)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3004408	LAZ CLUB INC DRILLED WELL		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3004408	LAZ CLUB INC DRILLED WELL		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3004549	BARRINGTON POND HP 1201	04/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3004903	CONDITS RANCH WEST WELL	05/01/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3004903	CONDITS RANCH WEST WELL	05/01/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3005876	LAST CHANCE SALOON (5876)		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3006940	MARSHALL CO SPORTSMENS CLUB (6940)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3006940	MARSHALL CO SPORTSMENS CLUB (6940)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3007302	GIANT GOOSE C E W	05/04/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3008417	CAMP PALOS RUSTIC CABIN BNK HS	05/26/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3008797	PILGRIM PARK CAMP #3 POOL WELL		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3008797	PILGRIM PARK CAMP #3 POOL WELL		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3008979	PILGRIM PARK CAMP #2 WASHHOUSE/EAST WELL		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3008979	PILGRIM PARK CAMP #2 WASHHOUSE/EAST WELL		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3009647	LAKE ALEXANDER CAMPGROUND	05/13/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3010611	PONDEROSA WILDERNESS AREA		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3010611	PONDEROSA WILDERNESS AREA		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3010868	CAMP EMMANUEL	06/17/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3010868	CAMP EMMANUEL	08/08/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3012542	FOX RIVER REC EAST WELL	01/01/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3014449	RAINBOW COUNCIL SCOUT RES MAIN	07/11/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3014464	WAUPECON VALLEY PARK #1	06/02/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3014506	KAMP KOMFORT	07/05/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3014514	COMLARA PARK BEACH WELL		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3014514	COMLARA PARK BEACH WELL		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015099	CAPTAINS QUARTERS	06/28/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015222	NEWARK SPORTSMENS CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015305	KANKAKEE RIVER ST PARK OFFICE	07/19/2022	Maximum Contaminant Level Violation, E. coli (RTCR)
Revised Total Coliform Rule	IL3015420	LONE GROVE FOREST PRESERVE	05/23/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015420	LONE GROVE FOREST PRESERVE	07/21/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3015420	LONE GROVE FOREST PRESERVE	05/23/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015446	FABYAN FOREST PRESERVE	05/23/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015503	ELBURN FOREST PRESERVE	05/23/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015503	ELBURN FOREST PRESERVE	05/23/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3015602	SOUTH WILMINGTON FIREMANS #2		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015602	SOUTH WILMINGTON FIREMANS #2		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015610	WAUPECAN VALLEY GROCERY	06/02/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015842	FOSSIL ROCK RECREATION CLUB	05/04/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015867	ENCHANTED SHORES /EAST WELL	05/26/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3015867	ENCHANTED SHORES /EAST WELL	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3015933	TROY SPORTSMENS CLUB	06/14/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3016113	CHICAGO NW KOA KAMPGROUND	04/19/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3016162	MARENGO RIDGE (16162)	04/19/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3016865	SOUTH WILMINGTON FIREMANS #1		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3016865	SOUTH WILMINGTON FIREMANS #1		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3017020	INDIAN CREEK POOL WELL	04/14/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3017665	PALISADES GOLF COURSE	06/03/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3017681	TIMBERLAKE RESORT	08/16/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3017814	OFF THE STREET CLUB- CAMP MATHIEU		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3017814	OFF THE STREET CLUB- CAMP MATHIEU		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3018143	GOOSE LAKE CLUB	04/26/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3018226	MARY ANN BEEBE CTR/ACTIVITY CTR (18226)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3018226	MARY ANN BEEBE CTR/ACTIVITY CTR (18226)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3018242	ILLINOIS TURNER CAMP POOL	04/29/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3019166	GALESBURG EAST KOA		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3019166	GALESBURG EAST KOA		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3019604	AYERS LANDING	06/17/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3022038	WILMINGTON REC CLUB BEACH BATHHOUSE	06/10/2022	Treatment Technique Startup

				Procedures (RTCR)
Revised Total Coliform Rule	IL3022251	NEW LENOX SPORTSMANS CLUB	09/29/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3022251	NEW LENOX SPORTSMANS CLUB	09/29/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3022285	NEW LENOX SPORTSMANS CLUB (22285)	09/29/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3022285	NEW LENOX SPORTSMANS CLUB (22285)	09/29/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3022327	DEER CREEK RECREATIONAL CLUB	03/27/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3023325	PETITE LAKE RESORT	06/27/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3023564	JACK AND LIDIAS RESORT		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3023564	JACK AND LIDIAS RESORT		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3024976	LAKE WILL	04/22/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3025031	AREA #1 OUTDOOR CLUB	06/17/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3028480	BOBS MARINA		Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3028480	BOBS MARINA		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3029611	FOX RANCH TAVERN		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3029611	FOX RANCH TAVERN		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)	07/12/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3031500	COAL CITY AREA CLUB #1	04/11/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3031500	COAL CITY AREA CLUB #1	04/11/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3032359	MILLPOINT CAMPGROUND	06/21/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3032441	FULTON COUNTY CAMPING&REC AREA	04/13/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3032920	OHANA VENTURES/SHADY LAKES	05/01/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3032920	OHANA VENTURES/SHADY LAKES	05/01/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3033001	HIDDEN LAKE CAMPGROUND	04/19/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3033449	P N A YOUTH CAMP ASSN		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3033449	P N A YOUTH CAMP ASSN		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3033837	CAMP TUCKABATCHEE		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3033837	CAMP TUCKABATCHEE		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3035519	ST SEBASTIAN CHURCH	06/15/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3049122	INLAND HARBOR	06/14/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3057646	WILDWOOD CAMPGROUND		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3058628	EUREKA SPORTSMENS CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3058628	EUREKA SPORTSMENS CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3060285	WALNUT GR UNITED METHODIST CHU		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3060954	HICKORY HILL CAMPGROUND	03/29/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3063222	KIEFS REEF		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3064071	MC HENRY OUTDOOR THEATRE	05/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3064980	ST JOHNS UNITED CHURCH	06/14/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3065706	SPRING LAKE MARINA LIMITED		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3065706	SPRING LAKE MARINA LIMITED		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3066399	OLD STARKS TAVERN		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3066399	OLD STARKS TAVERN		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3066399	OLD STARKS TAVERN		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3069096	GIANT GOOSE RANCH LLC		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3069096	GIANT GOOSE RANCH LLC		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3069096	GIANT GOOSE RANCH LLC		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3069104	GAMBER COVE		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3069104	GAMBER COVE		Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3073056	GLENWOOD FOREST PRESERVE	05/23/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3073056	GLENWOOD FOREST PRESERVE	07/12/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3073056	GLENWOOD FOREST PRESERVE	05/23/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3075507	BIG ROCK PLOWING MATCH	05/24/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3076406	PUTNAM CO CONSERVATION DIST	04/01/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3078162	KNOX CO SPORTSMENS CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3078162	KNOX CO SPORTSMENS CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085738	OAK RUN CAMPING AREA	03/28/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085746	SUNSET LAKES RESORT (85746) HOUSE WELL	04/22/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085746	SUNSET LAKES RESORT (85746) HOUSE WELL	04/22/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085746	SUNSET LAKES RESORT (85746) HOUSE WELL		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3085795	CAMP HAUBERG (85795) SOUTH WELL	09/13/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3085795	CAMP HAUBERG (85795) SOUTH WELL	08/25/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3085795	CAMP HAUBERG (85795) SOUTH WELL	09/13/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085803	CAMP HAUBERG (85803) NORTH WELL	08/25/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3085803	CAMP HAUBERG (85803) NORTH WELL		Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3085837	INGERSOLL SCOUT RESERV/E WELL	06/16/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085845	INGERSOLL SCOUT RESERVATION	06/16/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085852	ILLINIWEK BALL FIELD WELL	04/09/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085860	ILLINIWEK FOREST OFFICE WELL	04/06/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085860	ILLINIWEK FOREST OFFICE WELL	07/25/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3085894	LOUD THUNDER FP-W SHW BLD-A	03/30/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085902	LOUD THUNDER FP- RIVERVIEW-B	03/30/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3085902	LOUD THUNDER FP- RIVERVIEW-B	07/21/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3086132	ALLENDALE CONSERVATION CLUB (86132)	04/12/2022	Treatment Technique Startup

				Procedures (RTCR)
Revised Total Coliform Rule	IL3086207	BSA-LOUD THUNDER UPPER	04/19/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3086207	BSA-LOUD THUNDER UPPER	04/19/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3090282	FAITH BIBLE CAMP		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3093047	SCAPECCHIS	08/09/2022	Maximum Contaminant Level Violation, E. coli (RTCR)
Revised Total Coliform Rule	IL3094672	ANO DEL GALLO		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3095117	CAMP HENRY HORNER/POOL PUMP HOUSE		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3095117	CAMP HENRY HORNER/POOL PUMP HOUSE		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3095299	SOUTH WILMINGTON SPORTSMAN CLU (95299)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3095299	SOUTH WILMINGTON SPORTSMAN CLU (95299)		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3095653	JUBILEE ST PK #1 QUAIL MEADOWS	04/12/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3095653	JUBILEE ST PK #1 QUAIL MEADOWS	07/19/2022	Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL3095653	JUBILEE ST PK #1 QUAIL MEADOWS	04/12/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3095828	SILVER SPRINGS STATE PARK (95828)	06/28/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3095828	SILVER SPRINGS STATE PARK (95828)	06/28/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3097709	CHAIN O LAKES/HORSE RENTAL #6	04/13/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3099994	LA CHATEAU PARK INC	06/27/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3103325	SAND RIDGE STATE FOREST (103325)	09/12/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3103333	SAND RIDGE STATE FOREST (103333)	09/12/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3103713	IDEAL HUNTING AND FISHING CLUB	03/01/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3103713	IDEAL HUNTING AND FISHING CLUB	03/01/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3105544	LENS HIDEAWAY		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3105544	LENS HIDEAWAY		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3105585	INDIAN CREEK LOWER WELL	04/14/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3106054	INDIAN CREEK OFFICE WELL	04/14/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3107029	PAUL WOLFF CAMPGROUNDS	06/16/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3108951	MORAINÉ VIEW SP	05/04/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3109090	WELDON SPRINGS STATE PARK CONCESN		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3110338	THE ISLAND ON THE CHAIN	04/30/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3110353	MUTINY BOAT CLUB CAMP AREA	04/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3110932	DOUBLE TREE HILLS	04/19/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3110932	DOUBLE TREE HILLS	04/19/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3111013	SHOREWOOD SHELL EXPRESS	09/30/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3111039	FRANCIS PARK		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3111039	FRANCIS PARK		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS		Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3112953	PELICAN BAY MARINA	06/16/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3113142	BEN WATTS MARINA	05/01/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3113555	ROLLING OAKS CAMPGROUND (113555)	05/25/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3113555	ROLLING OAKS CAMPGROUND (113555)	05/25/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3113613	FISH LAKE BEACH	06/17/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3114470	HIRAM WALKER ROD & GUN CLUB	04/27/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3115287	WOODFORD COUNTY IZAAK WALTON	06/06/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3115295	GENESEO CAMPGROUND		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3115295	GENESEO CAMPGROUND		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3115451	RADNOR ROD AND GUN CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3115451	RADNOR ROD AND GUN CLUB	08/03/2022	Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL3115451	RADNOR ROD AND GUN CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3115493	MALLARD BEND RESORT LLC WEST WELL	04/11/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3115493	MALLARD BEND RESORT LLC WEST WELL	04/11/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3115584	LUPAS RESORT 2		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3116897	CHILLICOTHE REC AREA OFFICE #1	06/17/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3117564	CROWS MILL PUB	06/25/2022	Maximum Contaminant Level Violation, E. coli (RTCR)
Revised Total Coliform Rule	IL3120642	LAWRENCEVILLE ROD & GUN CLUB	08/01/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3120782	GRASS LAKE MARINA		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3120782	GRASS LAKE MARINA		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3120832	GLENWOOD RV RESORT (120832)	04/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3120832	GLENWOOD RV RESORT (120832)	04/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3122275	WEBBS VALLEY VIEW CAMPGROUND		Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3122275	WEBBS VALLEY VIEW CAMPGROUND		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3122275	WEBBS VALLEY VIEW CAMPGROUND		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3122275	WEBBS VALLEY VIEW CAMPGROUND		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3122473	CHICAGO NW KOA	04/19/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3126573	ROLLING OAKS CAMPGROUND (126573)	04/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3126573	ROLLING OAKS CAMPGROUND (126573)	04/20/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3126821	SHERIDAN ROD & GUN		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3127597	DETWELLER PARK PINE AND DOGWOOD SHELTER	06/14/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3130500	CHILLICOTHE REC AREA CAMP #2	05/06/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3132449	LUCKY FIFTY CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3132449	LUCKY FIFTY CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3132464	SHAW WA NAS SEE 4H CAMP-WELL3	05/09/2022	Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3132829	PLANK ROAD TAP ROOM		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3132829	PLANK ROAD TAP ROOM		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3132860	EAGLE CREST CAMPGROUND- CAMPGROUND WELL	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3134403	COMLARA PARK SHOWERHOUSE		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3134403	COMLARA PARK SHOWERHOUSE		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3134635	BLACK MARINE INC CAMPGROUND		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3134635	BLACK MARINE INC CAMPGROUND		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3134635	BLACK MARINE INC CAMPGROUND		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3134635	BLACK MARINE INC CAMPGROUND		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3134817	1885 FARE FARM TO TABLE OF ILLINOIS		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3135947	DICK YOUNG FOREST PRESERVE	05/23/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3136192	LITTLE JOHN CONSERVATION CLUB		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3136192	LITTLE JOHN CONSERVATION CLUB		Treatment Technique Startup Procedures (RTCR)

Revised Total Coliform Rule	IL3137455	LOUD THUNDER FP-EAST WELL-E	04/01/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3138362	SWANSON PARK		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3138420	COUGAR CAMPGROUND	05/02/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3138552	LOGAN PARK		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3138552	LOGAN PARK		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3138594	CONDITS RANCH EAST WELL	08/18/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3138594	CONDITS RANCH EAST WELL	08/18/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3138859	BRISTOL TAP	04/12/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3139139	WELDON SPRINGS SP SHWRHSE		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3139485	AURORA WEST FOREST PRESERVE	05/23/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3140764	MCCD GLACIER PARK HORSE LOT	07/07/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3141721	ROCKFOR ROTARY FOREST PRESERVE		Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL3142349	FOREST HILLS DIAMONDS	08/18/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3147322	MACKTOWN GOLF COURSE #14 TEE		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3149229	WESTERN ILLINOIS NATURE GROUP	08/15/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3149484	DEER CREEK CAMPGROUND		Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3149567	WESTERN ILLINOIS BOAT CLUB	06/16/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3151183	STONE CITY SOFTBALL CONCESSION	04/29/2022	Treatment Technique Startup Procedures (RTCR)
Revised Total Coliform Rule	IL3151183	STONE CITY SOFTBALL CONCESSION		Monitoring, Routine (RTCR)
Simazine	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Simazine	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Styrene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Tetrachloroethylene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Toluene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Total Polychlorinated Biphenyls (PCB)	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular

Total Polychlorinated Biphenyls (PCB)	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Toxaphene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
trans-1,2-Dichloroethylene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Trichloroethylene	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Vinyl chloride	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Vinyl chloride	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular
Xylenes, Total	IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	08/18/2022	Monitoring, Regular

Appendix D
Illinois EPA 2022 Annual Compliance Report
Violations Sorted by TNCWS

From U.S. EPA's CDX Reporting Services database

PWS ID	PWS Name	Contaminant Name	Resolved Date	Violation Type Description
IL3134817	1885 FARE FARM TO TABLE OF ILLINOIS	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3086132	ALLENDALE CONSERVATION CLUB (86132)	Revised Total Coliform Rule	04/12/2022	Treatment Technique Startup Procedures (RTCR)
IL3062307	AMBE GASOLINE	Public Notice		Public Notification Violation for NPDWR Violation
IL3094672	ANO DEL GALLO	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3025031	AREA #1 OUTDOOR CLUB	Revised Total Coliform Rule	06/17/2022	Treatment Technique Startup Procedures (RTCR)
IL3139485	AURORA WEST FOREST PRESERVE	Public Notice		Public Notification Violation for NPDWR Violation
IL3139485	AURORA WEST FOREST PRESERVE	Revised Total Coliform Rule	05/23/2022	Treatment Technique Startup Procedures (RTCR)
IL3019604	AYERS LANDING	Public Notice	08/15/2022	Public Notification Violation for NPDWR Violation
IL3019604	AYERS LANDING	Revised Total Coliform Rule	06/17/2022	Treatment Technique Startup Procedures (RTCR)
IL3004549	BARRINGTON POND HP 1201	Revised Total Coliform Rule	04/05/2022	Monitoring, Routine (RTCR)

IL3113142	BEN WATTS MARINA	Revised Total Coliform Rule	05/01/2022	Treatment Technique Startup Procedures (RTCR)
IL3075507	BIG ROCK PLOWING MATCH	Revised Total Coliform Rule	05/24/2022	Treatment Technique Startup Procedures (RTCR)
IL3134635	BLACK MARINE INC CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3134635	BLACK MARINE INC CAMPGROUND	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3134635	BLACK MARINE INC CAMPGROUND	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3134635	BLACK MARINE INC CAMPGROUND	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3134635	BLACK MARINE INC CAMPGROUND	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3028480	BOBS MARINA	Public Notice		Public Notification Violation for NPDWR Violation
IL3028480	BOBS MARINA	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3028480	BOBS MARINA	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3138859	BRISTOL TAP	Revised Total Coliform Rule	04/12/2022	Monitoring, Routine (RTCR)
IL3086207	BSA-LOUD THUNDER UPPER	Public Notice		Public Notification Violation for NPDWR Violation

IL3086207	BSA-LOUD THUNDER UPPER	Revised Total Coliform Rule	04/19/2022	Treatment Technique Startup Procedures (RTCR)
IL3086207	BSA-LOUD THUNDER UPPER	Revised Total Coliform Rule	04/19/2022	Treatment Technique Startup Procedures (RTCR)
IL3015404	BURNIDGE FOREST PRESERVE	Public Notice		Public Notification Violation for NPDWR Violation
IL3117523	CACTUS COUNTRY	Public Notice	04/18/2022	Public Notification Violation for NPDWR Violation
IL3142638	CAMP AKITA LODGE WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3001875	CAMP AKITA/A FRAME WELL	E. COLI	03/29/2022	Monitoring, Source Water (GWR)
IL3001875	CAMP AKITA/A FRAME WELL	Revised Total Coliform Rule	05/16/2022	Monitoring, Additional Routine (RTCR)
IL3095133	CAMP DUNCAN SORENSON LODGE	Public Notice		Public Notification Violation for NPDWR Violation
IL3010868	CAMP EMMANUEL	Revised Total Coliform Rule	06/17/2022	Treatment Technique Startup Procedures (RTCR)
IL3010868	CAMP EMMANUEL	Revised Total Coliform Rule	08/08/2022	Monitoring, Routine (RTCR)
IL3003921	CAMP GRESHIEM CHRISTIAN RETREA	Public Notice		Public Notification Violation for NPDWR Violation
IL3003921	CAMP GRESHIEM CHRISTIAN RETREA	Public Notice		Public Notification Violation for NPDWR Violation

IL3085795	CAMP HAUBERG (85795) SOUTH WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3085795	CAMP HAUBERG (85795) SOUTH WELL	Revised Total Coliform Rule	09/13/2022	Treatment Technique Startup Procedures (RTCR)
IL3085795	CAMP HAUBERG (85795) SOUTH WELL	Revised Total Coliform Rule	08/25/2022	Monitoring, Routine (RTCR)
IL3085795	CAMP HAUBERG (85795) SOUTH WELL	Revised Total Coliform Rule	09/13/2022	Treatment Technique Startup Procedures (RTCR)
IL3085803	CAMP HAUBERG (85803) NORTH WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3085803	CAMP HAUBERG (85803) NORTH WELL	Revised Total Coliform Rule	08/25/2022	Monitoring, Routine (RTCR)
IL3085803	CAMP HAUBERG (85803) NORTH WELL	Revised Total Coliform Rule		Monitoring, Additional Routine (RTCR)
IL3095117	CAMP HENRY HORNER/POOL PUMP HOUSE	Public Notice		Public Notification Violation for NPDWR Violation
IL3095117	CAMP HENRY HORNER/POOL PUMP HOUSE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3095117	CAMP HENRY HORNER/POOL PUMP HOUSE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3002097	CAMP MANITOUMI	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3002097	CAMP MANITOUMI	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)

IL3008417	CAMP PALOS RUSTIC CABIN BNK HS	Revised Total Coliform Rule	05/26/2022	Treatment Technique Startup Procedures (RTCR)
IL3001420	CAMP ROBERT DRAKE	Public Notice		Public Notification Violation for NPDWR Violation
IL3001420	CAMP ROBERT DRAKE	Revised Total Coliform Rule	09/20/2022	Monitoring, Routine (RTCR)
IL3001420	CAMP ROBERT DRAKE	Revised Total Coliform Rule	04/14/2022	Treatment Technique Startup Procedures (RTCR)
IL3001420	CAMP ROBERT DRAKE	Revised Total Coliform Rule	09/20/2022	Monitoring, Routine (RTCR)
IL3001420	CAMP ROBERT DRAKE	Revised Total Coliform Rule	04/14/2022	Treatment Technique Startup Procedures (RTCR)
IL3002105	CAMP TAPAWINGO	Public Notice		Public Notification Violation for NPDWR Violation
IL3033837	CAMP TUCKABATCHEE	Public Notice		Public Notification Violation for NPDWR Violation
IL3033837	CAMP TUCKABATCHEE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3033837	CAMP TUCKABATCHEE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3015099	CAPTAINS QUARTERS	Revised Total Coliform Rule	06/28/2022	Treatment Technique Startup Procedures (RTCR)
IL3097709	CHAIN O LAKES/HORSE RENTAL #6	Revised Total Coliform Rule	04/13/2022	Treatment Technique Startup Procedures (RTCR)

IL3122473	CHICAGO NW KOA	Revised Total Coliform Rule	04/19/2022	Treatment Technique Startup Procedures (RTCR)
IL3016113	CHICAGO NW KOA KAMPGROUND	Revised Total Coliform Rule	04/19/2022	Treatment Technique Startup Procedures (RTCR)
IL3130500	CHILLICOTHE REC AREA CAMP #2	Revised Total Coliform Rule	05/06/2022	Treatment Technique Startup Procedures (RTCR)
IL3116897	CHILLICOTHE REC AREA OFFICE #1	Revised Total Coliform Rule	06/17/2022	Treatment Technique Startup Procedures (RTCR)
IL3031500	COAL CITY AREA CLUB #1	Revised Total Coliform Rule	04/11/2022	Treatment Technique Startup Procedures (RTCR)
IL3031500	COAL CITY AREA CLUB #1	Revised Total Coliform Rule	04/11/2022	Treatment Technique Startup Procedures (RTCR)
IL3014514	COMLARA PARK BEACH WELL	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3014514	COMLARA PARK BEACH WELL	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3134403	COMLARA PARK SHOWERHOUSE	Public Notice		Public Notification Violation for NPDWR Violation
IL3134403	COMLARA PARK SHOWERHOUSE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3134403	COMLARA PARK SHOWERHOUSE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3138594	CONDITS RANCH EAST WELL	Revised Total Coliform Rule	08/18/2022	Treatment Technique Startup

				Procedures (RTCR)
IL3138594	CONDITS RANCH EAST WELL	Revised Total Coliform Rule	08/18/2022	Treatment Technique Startup Procedures (RTCR)
IL3004903	CONDITS RANCH WEST WELL	Revised Total Coliform Rule	05/01/2022	Treatment Technique Startup Procedures (RTCR)
IL3004903	CONDITS RANCH WEST WELL	Revised Total Coliform Rule	05/01/2022	Treatment Technique Startup Procedures (RTCR)
IL3134957	COSMAN BIKE TRAIL 1250	Public Notice		Public Notification Violation for NPDWR Violation
IL3138420	COUGAR CAMPGROUND	Revised Total Coliform Rule	05/02/2022	Treatment Technique Startup Procedures (RTCR)
IL3117564	CROWS MILL PUB	Revised Total Coliform Rule	06/25/2022	Maximum Contaminant Level Violation, E. coli (RTCR)
IL3085233	CRUISERS PIT STOP	Nitrate	08/01/2022	Monitoring, Regular
IL3085233	CRUISERS PIT STOP	Public Notice		Public Notification Violation for NPDWR Violation
IL3149484	DEER CREEK CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3149484	DEER CREEK CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3149484	DEER CREEK CAMPGROUND	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)

IL3022327	DEER CREEK RECREATIONAL CLUB	Revised Total Coliform Rule	03/27/2022	Treatment Technique Startup Procedures (RTCR)
IL3127597	DETWEILLER PARK PINE AND DOGWOOD SHELTER	Revised Total Coliform Rule	06/14/2022	Treatment Technique Startup Procedures (RTCR)
IL3135947	DICK YOUNG FOREST PRESERVE	Revised Total Coliform Rule	05/23/2022	Treatment Technique Startup Procedures (RTCR)
IL3110932	DOUBLE TREE HILLS	Revised Total Coliform Rule	04/19/2022	Treatment Technique Startup Procedures (RTCR)
IL3110932	DOUBLE TREE HILLS	Revised Total Coliform Rule	04/19/2022	Treatment Technique Startup Procedures (RTCR)
IL3132860	EAGLE CREST CAMPGROUND- CAMPGROUND WELL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
IL3015503	ELBURN FOREST PRESERVE	Public Notice		Public Notification Violation for NPDWR Violation
IL3015503	ELBURN FOREST PRESERVE	Revised Total Coliform Rule	05/23/2022	Treatment Technique Startup Procedures (RTCR)
IL3015503	ELBURN FOREST PRESERVE	Revised Total Coliform Rule	05/23/2022	Treatment Technique Startup Procedures (RTCR)
IL3015867	ENCHANTED SHORES /EAST WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3015867	ENCHANTED SHORES /EAST WELL	Revised Total Coliform Rule	05/26/2022	Treatment Technique Startup Procedures (RTCR)
IL3015867	ENCHANTED SHORES /EAST WELL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)

IL3058628	EUREKA SPORTSMENS CLUB	Public Notice		Public Notification Violation for NPDWR Violation
IL3058628	EUREKA SPORTSMENS CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3058628	EUREKA SPORTSMENS CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3004150	EVENING STAR CAMPING RESORT (4150)	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3004150	EVENING STAR CAMPING RESORT (4150)	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3003608	EVENING STAR CAMPING RESORT(3608)	Nitrate	09/07/2022	Monitoring, Regular
IL3003608	EVENING STAR CAMPING RESORT(3608)	Revised Total Coliform Rule	09/07/2022	Treatment Technique Startup Procedures (RTCR)
IL3003608	EVENING STAR CAMPING RESORT(3608)	Revised Total Coliform Rule	09/28/2022	Monitoring, Routine (RTCR)
IL3003608	EVENING STAR CAMPING RESORT(3608)	Revised Total Coliform Rule	09/07/2022	Treatment Technique Startup Procedures (RTCR)
IL3117317	EXPRESS LANE GAS & FOOD MART	Nitrate	01/31/2022	Monitoring, Regular
IL3015446	FABYAN FOREST PRESERVE	Public Notice		Public Notification Violation for NPDWR Violation
IL3015446	FABYAN FOREST PRESERVE	Revised Total Coliform Rule	05/23/2022	Treatment Technique Startup Procedures (RTCR)

IL3090282	FAITH BIBLE CAMP	Public Notice		Public Notification Violation for NPDWR Violation
IL3090282	FAITH BIBLE CAMP	Public Notice		Public Notification Violation for NPDWR Violation
IL3090282	FAITH BIBLE CAMP	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3156562	FAITH COMMUNITY WORSHIP CENTER	Public Notice		Public Notification Violation for NPDWR Violation
IL3113613	FISH LAKE BEACH	Revised Total Coliform Rule	06/17/2022	Treatment Technique Startup Procedures (RTCR)
IL3000992	FISH N FUN CLUB	Revised Total Coliform Rule	04/04/2022	Treatment Technique Startup Procedures (RTCR)
IL3014266	FOREST GLEN - POND WATER	Public Notice		Public Notification Violation for NPDWR Violation
IL3142349	FOREST HILLS DIAMONDS	Revised Total Coliform Rule	08/18/2022	Treatment Technique Startup Procedures (RTCR)
IL3015842	FOSSIL ROCK RECREATION CLUB	Public Notice		Public Notification Violation for NPDWR Violation
IL3015842	FOSSIL ROCK RECREATION CLUB	Revised Total Coliform Rule	05/04/2022	Treatment Technique Startup Procedures (RTCR)
IL3029611	FOX RANCH TAVERN	Public Notice		Public Notification Violation for NPDWR Violation
IL3029611	FOX RANCH TAVERN	Revised Total Coliform Rule		Monitoring, Routine (RTCR)

IL3029611	FOX RANCH TAVERN	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3012542	FOX RIVER REC EAST WELL	Revised Total Coliform Rule	01/01/2022	Treatment Technique Startup Procedures (RTCR)
IL3111039	FRANCIS PARK	Public Notice		Public Notification Violation for NPDWR Violation
IL3111039	FRANCIS PARK	Public Notice		Public Notification Violation for NPDWR Violation
IL3111039	FRANCIS PARK	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3111039	FRANCIS PARK	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3032441	FULTON COUNTY CAMPING&REC AREA	Revised Total Coliform Rule	04/13/2022	Treatment Technique Startup Procedures (RTCR)
IL3019166	GALESBURG EAST KOA	Public Notice		Public Notification Violation for NPDWR Violation
IL3019166	GALESBURG EAST KOA	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3019166	GALESBURG EAST KOA	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3069104	GAMBER COVE	Public Notice		Public Notification Violation for NPDWR Violation
IL3069104	GAMBER COVE	Public Notice		Public Notification Violation for NPDWR Violation

IL3069104	GAMBER COVE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3069104	GAMBER COVE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3115295	GENESEO CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3115295	GENESEO CAMPGROUND	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3115295	GENESEO CAMPGROUND	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3007302	GIANT GOOSE C E W	Revised Total Coliform Rule	05/04/2022	Treatment Technique Startup Procedures (RTCR)
IL3069096	GIANT GOOSE RANCH LLC	Public Notice		Public Notification Violation for NPDWR Violation
IL3069096	GIANT GOOSE RANCH LLC	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3069096	GIANT GOOSE RANCH LLC	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3069096	GIANT GOOSE RANCH LLC	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3073056	GLENWOOD FOREST PRESERVE	Public Notice		Public Notification Violation for NPDWR Violation
IL3073056	GLENWOOD FOREST PRESERVE	Revised Total Coliform Rule	05/23/2022	Treatment Technique Startup Procedures (RTCR)

IL3073056	GLENWOOD FOREST PRESERVE	Revised Total Coliform Rule	07/12/2022	Monitoring, Routine (RTCR)
IL3073056	GLENWOOD FOREST PRESERVE	Revised Total Coliform Rule	05/23/2022	Treatment Technique Startup Procedures (RTCR)
IL3000711	GLENWOOD RV RESORT	Revised Total Coliform Rule	04/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3000711	GLENWOOD RV RESORT	Revised Total Coliform Rule	04/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3120832	GLENWOOD RV RESORT (120832)	Revised Total Coliform Rule	04/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3120832	GLENWOOD RV RESORT (120832)	Revised Total Coliform Rule	04/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3018143	GOOSE LAKE CLUB	Revised Total Coliform Rule	04/26/2022	Treatment Technique Startup Procedures (RTCR)
IL3120782	GRASS LAKE MARINA	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3120782	GRASS LAKE MARINA	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3001354	HICKORY GROVE CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3001354	HICKORY GROVE CAMPGROUND	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3001248	HICKORY GROVE LAKE COMPANY	Public Notice	08/18/2022	Public Notification Violation for NPDWR Violation

IL3001248	HICKORY GROVE LAKE COMPANY	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3060954	HICKORY HILL CAMPGROUND	Revised Total Coliform Rule	03/29/2022	Treatment Technique Startup Procedures (RTCR)
IL3003475	HICKORY LANE CAMPING	Revised Total Coliform Rule	05/02/2022	Treatment Technique Startup Procedures (RTCR)
IL3000554	HICKORY SHORES RESORT	Revised Total Coliform Rule	09/29/2022	Monitoring, Additional Routine (RTCR)
IL3033001	HIDDEN LAKE CAMPGROUND	Revised Total Coliform Rule	04/19/2022	Treatment Technique Startup Procedures (RTCR)
IL3114470	HIRAM WALKER ROD & GUN CLUB	Revised Total Coliform Rule	04/27/2022	Treatment Technique Startup Procedures (RTCR)
IL3103713	IDEAL HUNTING AND FISHING CLUB	Revised Total Coliform Rule	03/01/2022	Treatment Technique Startup Procedures (RTCR)
IL3103713	IDEAL HUNTING AND FISHING CLUB	Revised Total Coliform Rule	03/01/2022	Treatment Technique Startup Procedures (RTCR)
IL3085852	ILLINIWEK BALL FIELD WELL	Revised Total Coliform Rule	04/09/2022	Treatment Technique Startup Procedures (RTCR)
IL3085860	ILLINIWEK FOREST OFFICE WELL	Revised Total Coliform Rule	04/06/2022	Treatment Technique Startup Procedures (RTCR)
IL3085860	ILLINIWEK FOREST OFFICE WELL	Revised Total Coliform Rule	07/25/2022	Monitoring, Routine (RTCR)
IL3018242	ILLINOIS TURNER CAMP POOL	Revised Total Coliform Rule	04/29/2022	Treatment Technique Startup Procedures (RTCR)

IL3105585	INDIAN CREEK LOWER WELL	Revised Total Coliform Rule	04/14/2022	Treatment Technique Startup Procedures (RTCR)
IL3106054	INDIAN CREEK OFFICE WELL	Revised Total Coliform Rule	04/14/2022	Treatment Technique Startup Procedures (RTCR)
IL3017020	INDIAN CREEK POOL WELL	Revised Total Coliform Rule	04/14/2022	Treatment Technique Startup Procedures (RTCR)
IL3085837	INGERSOLL SCOUT RESERV/E WELL	Revised Total Coliform Rule	06/16/2022	Treatment Technique Startup Procedures (RTCR)
IL3085845	INGERSOLL SCOUT RESERVATION	Revised Total Coliform Rule	06/16/2022	Treatment Technique Startup Procedures (RTCR)
IL3049122	INLAND HARBOR	Revised Total Coliform Rule	06/14/2022	Treatment Technique Startup Procedures (RTCR)
IL3023564	JACK AND LIDIAS RESORT	Public Notice		Public Notification Violation for NPDWR Violation
IL3023564	JACK AND LIDIAS RESORT	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3023564	JACK AND LIDIAS RESORT	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3030890	JERUSALEM UNITED METHODIST CHURCH	Public Notice		Public Notification Violation for NPDWR Violation
IL3103135	JIMBOS TAVERN	Public Notice		Public Notification Violation for NPDWR Violation
IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)	Public Notice		Public Notification Violation for

				NPDWR Violation
IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)	Public Notice		Public Notification Violation for NPDWR Violation
IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)	Revised Total Coliform Rule	07/12/2022	Monitoring, Routine (RTCR)
IL3031021	JOHNSONS MOUND FOREST PRESERVE (31021)	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3095653	JUBILEE ST PK #1 QUAIL MEADOWS	Public Notice		Public Notification Violation for NPDWR Violation
IL3095653	JUBILEE ST PK #1 QUAIL MEADOWS	Revised Total Coliform Rule	04/12/2022	Treatment Technique Startup Procedures (RTCR)
IL3095653	JUBILEE ST PK #1 QUAIL MEADOWS	Revised Total Coliform Rule	07/19/2022	Monitoring, Routine (RTCR)
IL3095653	JUBILEE ST PK #1 QUAIL MEADOWS	Revised Total Coliform Rule	04/12/2022	Treatment Technique Startup Procedures (RTCR)
IL3014506	KAMP KOMFORT	Revised Total Coliform Rule	07/05/2022	Monitoring, Additional Routine (RTCR)
IL3015305	KANKAKEE RIVER ST PARK OFFICE	Revised Total Coliform Rule	07/19/2022	Maximum Contaminant Level Violation, E. coli (RTCR)
IL3063222	KIEFS REEF	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3003087	KINGSTON TOWNSHIP PARK	Revised Total Coliform Rule		Treatment Technique Startup

				Procedures (RTCR)
IL3078162	KNOX CO SPORTSMENS CLUB	Public Notice		Public Notification Violation for NPDWR Violation
IL3078162	KNOX CO SPORTSMENS CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3078162	KNOX CO SPORTSMENS CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3099994	LA CHATEAU PARK INC	Revised Total Coliform Rule	06/27/2022	Monitoring, Additional Routine (RTCR)
IL3009647	LAKE ALEXANDER CAMPGROUND	Revised Total Coliform Rule	05/13/2022	Treatment Technique Startup Procedures (RTCR)
IL3024976	LAKE WILL	Revised Total Coliform Rule	04/22/2022	Treatment Technique Startup Procedures (RTCR)
IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS	E. COLI		Monitoring, Source Water (GWR)
IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS	Public Notice		Public Notification Violation for NPDWR Violation
IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS	Public Notice		Public Notification Violation for NPDWR Violation
IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3111070	LAKEPOINT CLUB C/O GEORGE KAPPOS	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)

IL3005876	LAST CHANCE SALOON (5876)	Public Notice		Public Notification Violation for NPDWR Violation
IL3005876	LAST CHANCE SALOON (5876)	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3120642	LAWRENCEVILLE ROD & GUN CLUB	Revised Total Coliform Rule	08/01/2022	Monitoring, Routine (RTCR)
IL3004408	LAZ CLUB INC DRILLED WELL	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3004408	LAZ CLUB INC DRILLED WELL	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3105544	LENS HIDEAWAY	Public Notice		Public Notification Violation for NPDWR Violation
IL3105544	LENS HIDEAWAY	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3105544	LENS HIDEAWAY	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3003673	LINCOLN TRAIL FAMILY CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3003673	LINCOLN TRAIL FAMILY CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3003673	LINCOLN TRAIL FAMILY CAMPGROUND	Revised Total Coliform Rule	03/29/2022	Treatment Technique Startup Procedures (RTCR)
IL3001552	LITTLE GALILEE CHRISTIAN ASMBY	Public Notice		Public Notification Violation for NPDWR Violation

IL3136192	LITTLE JOHN CONSERVATION CLUB	Public Notice		Public Notification Violation for NPDWR Violation
IL3136192	LITTLE JOHN CONSERVATION CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3136192	LITTLE JOHN CONSERVATION CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3138552	LOGAN PARK	Public Notice		Public Notification Violation for NPDWR Violation
IL3138552	LOGAN PARK	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3138552	LOGAN PARK	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3015420	LONE GROVE FOREST PRESERVE	Public Notice		Public Notification Violation for NPDWR Violation
IL3015420	LONE GROVE FOREST PRESERVE	Public Notice		Public Notification Violation for NPDWR Violation
IL3015420	LONE GROVE FOREST PRESERVE	Revised Total Coliform Rule	05/23/2022	Treatment Technique Startup Procedures (RTCR)
IL3015420	LONE GROVE FOREST PRESERVE	Revised Total Coliform Rule	07/21/2022	Monitoring, Routine (RTCR)
IL3015420	LONE GROVE FOREST PRESERVE	Revised Total Coliform Rule	05/23/2022	Treatment Technique Startup Procedures (RTCR)
IL3137455	LOUD THUNDER FP-EAST WELL-E	Revised Total Coliform Rule	04/01/2022	Treatment Technique Startup Procedures (RTCR)

IL3085902	LOUD THUNDER FP-RIVERVIEW-B	Public Notice		Public Notification Violation for NPDWR Violation
IL3085902	LOUD THUNDER FP-RIVERVIEW-B	Revised Total Coliform Rule	03/30/2022	Treatment Technique Startup Procedures (RTCR)
IL3085902	LOUD THUNDER FP-RIVERVIEW-B	Revised Total Coliform Rule	07/21/2022	Monitoring, Additional Routine (RTCR)
IL3085894	LOUD THUNDER FP-W SHW BLD-A	Public Notice		Public Notification Violation for NPDWR Violation
IL3085894	LOUD THUNDER FP-W SHW BLD-A	Revised Total Coliform Rule	03/30/2022	Treatment Technique Startup Procedures (RTCR)
IL3132449	LUCKY FIFTY CLUB	Public Notice		Public Notification Violation for NPDWR Violation
IL3132449	LUCKY FIFTY CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3132449	LUCKY FIFTY CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3115584	LUPAS RESORT 2	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3147322	MACKTOWN GOLF COURSE #14 TEE	Public Notice		Public Notification Violation for NPDWR Violation
IL3147322	MACKTOWN GOLF COURSE #14 TEE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3006866	MACKTOWN GOLF COURSE CLUBHOUSE	Nitrate	08/09/2022	Monitoring, Regular

IL3115493	MALLARD BEND RESORT LLC WEST WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3115493	MALLARD BEND RESORT LLC WEST WELL	Revised Total Coliform Rule	04/11/2022	Treatment Technique Startup Procedures (RTCR)
IL3115493	MALLARD BEND RESORT LLC WEST WELL	Revised Total Coliform Rule	04/11/2022	Treatment Technique Startup Procedures (RTCR)
IL3016162	MARENGO RIDGE (16162)	Revised Total Coliform Rule	04/19/2022	Treatment Technique Startup Procedures (RTCR)
IL3006940	MARSHALL CO SPORTSMENS CLUB (6940)	Public Notice		Public Notification Violation for NPDWR Violation
IL3006940	MARSHALL CO SPORTSMENS CLUB (6940)	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3006940	MARSHALL CO SPORTSMENS CLUB (6940)	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3018226	MARY ANN BEEBE CTR/ACTIVITY CTR (18226)	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3018226	MARY ANN BEEBE CTR/ACTIVITY CTR (18226)	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3094011	MATTHIESSEN STATE PARK (94011)	Public Notice		Public Notification Violation for NPDWR Violation
IL3064071	MC HENRY OUTDOOR THEATRE	Revised Total Coliform Rule	05/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3140764	MCCD GLACIER PARK HORSE LOT	Revised Total Coliform Rule	07/07/2022	Monitoring, Additional

				Routine (RTCR)
IL3032359	MILLPOINT CAMPGROUND	Revised Total Coliform Rule	06/21/2022	Treatment Technique Startup Procedures (RTCR)
IL3108951	MORAINÉ VIEW SP	Revised Total Coliform Rule	05/04/2022	Monitoring, Routine (RTCR)
IL3110353	MUTINY BOAT CLUB CAMP AREA	Revised Total Coliform Rule	04/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3000844	NATURE'S WAY RV PARK	Revised Total Coliform Rule	06/21/2022	Treatment Technique Startup Procedures (RTCR)
IL3022251	NEW LENOX SPORTSMANS CLUB	Public Notice		Public Notification Violation for NPDWR Violation
IL3022251	NEW LENOX SPORTSMANS CLUB	Revised Total Coliform Rule	09/29/2022	Treatment Technique Startup Procedures (RTCR)
IL3022251	NEW LENOX SPORTSMANS CLUB	Revised Total Coliform Rule	09/29/2022	Treatment Technique Startup Procedures (RTCR)
IL3022285	NEW LENOX SPORTSMANS CLUB (22285)	Public Notice		Public Notification Violation for NPDWR Violation
IL3022285	NEW LENOX SPORTSMANS CLUB (22285)	Revised Total Coliform Rule	09/29/2022	Treatment Technique Startup Procedures (RTCR)
IL3022285	NEW LENOX SPORTSMANS CLUB (22285)	Revised Total Coliform Rule	09/29/2022	Treatment Technique Startup Procedures (RTCR)
IL3015222	NEWARK SPORTSMENS CLUB	Public Notice		Public Notification Violation for NPDWR Violation

IL3015222	NEWARK SPORTSMENS CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3085738	OAK RUN CAMPING AREA	Revised Total Coliform Rule	03/28/2022	Treatment Technique Startup Procedures (RTCR)
IL3017814	OFF THE STREET CLUB-CAMP MATHIEU	Public Notice		Public Notification Violation for NPDWR Violation
IL3017814	OFF THE STREET CLUB-CAMP MATHIEU	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3017814	OFF THE STREET CLUB-CAMP MATHIEU	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3032920	OHANA VENTURES/SHADY LAKES	Public Notice		Public Notification Violation for NPDWR Violation
IL3032920	OHANA VENTURES/SHADY LAKES	Revised Total Coliform Rule	05/01/2022	Treatment Technique Startup Procedures (RTCR)
IL3032920	OHANA VENTURES/SHADY LAKES	Revised Total Coliform Rule	05/01/2022	Treatment Technique Startup Procedures (RTCR)
IL3066399	OLD STARKS TAVERN	Public Notice		Public Notification Violation for NPDWR Violation
IL3066399	OLD STARKS TAVERN	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3066399	OLD STARKS TAVERN	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3066399	OLD STARKS TAVERN	Revised Total Coliform Rule		Monitoring, Routine (RTCR)

IL3033449	P N A YOUTH CAMP ASSN	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3033449	P N A YOUTH CAMP ASSN	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3017665	PALISADES GOLF COURSE	Revised Total Coliform Rule	06/03/2022	Treatment Technique Startup Procedures (RTCR)
IL3107029	PAUL WOLFF CAMPGROUNDS	Revised Total Coliform Rule	06/16/2022	Treatment Technique Startup Procedures (RTCR)
IL3112953	PELICAN BAY MARINA	Revised Total Coliform Rule	06/16/2022	Treatment Technique Startup Procedures (RTCR)
IL3001164	PEORIA SPORTSMENS CLUB	Public Notice		Public Notification Violation for NPDWR Violation
IL3023325	PETITE LAKE RESORT	Revised Total Coliform Rule	06/27/2022	Treatment Technique Startup Procedures (RTCR)
IL3019455	PILGRIM PARK CAMP #1 MAIN WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3019455	PILGRIM PARK CAMP #1 MAIN WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3008979	PILGRIM PARK CAMP #2 WASHHOUSE/EAST WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3008979	PILGRIM PARK CAMP #2 WASHHOUSE/EAST WELL	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3008979	PILGRIM PARK CAMP #2 WASHHOUSE/EAST WELL	Revised Total Coliform Rule		Treatment Technique Startup

				Procedures (RTCR)
IL3008797	PILGRIM PARK CAMP #3 POOL WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3008797	PILGRIM PARK CAMP #3 POOL WELL	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3008797	PILGRIM PARK CAMP #3 POOL WELL	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3004101	PIONEER POINT CAMPERS CLUB	Public Notice		Public Notification Violation for NPDWR Violation
IL3004101	PIONEER POINT CAMPERS CLUB	Revised Total Coliform Rule	04/03/2022	Treatment Technique Startup Procedures (RTCR)
IL3132829	PLANK ROAD TAP ROOM	Public Notice		Public Notification Violation for NPDWR Violation
IL3132829	PLANK ROAD TAP ROOM	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3132829	PLANK ROAD TAP ROOM	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3010611	PONDEROSA WILDERNESS AREA	Public Notice		Public Notification Violation for NPDWR Violation
IL3010611	PONDEROSA WILDERNESS AREA	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3010611	PONDEROSA WILDERNESS AREA	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)

IL3076406	PUTNAM CO CONSERVATION DIST	Revised Total Coliform Rule	04/01/2022	Treatment Technique Startup Procedures (RTCR)
IL3115451	RADNOR ROD AND GUN CLUB	Public Notice		Public Notification Violation for NPDWR Violation
IL3115451	RADNOR ROD AND GUN CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3115451	RADNOR ROD AND GUN CLUB	Revised Total Coliform Rule	08/03/2022	Monitoring, Routine (RTCR)
IL3115451	RADNOR ROD AND GUN CLUB	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3014449	RAINBOW COUNCIL SCOUT RES MAIN	Revised Total Coliform Rule	07/11/2022	Treatment Technique Startup Procedures (RTCR)
IL3000406	RICE LAKE WILDLIFE AREA	Revised Total Coliform Rule	03/30/2022	Treatment Technique Startup Procedures (RTCR)
IL3000406	RICE LAKE WILDLIFE AREA	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3141721	ROCKFOR ROTARY FOREST PRESERVE	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3113555	ROLLING OAKS CAMPGROUND (113555)	Revised Total Coliform Rule	05/25/2022	Treatment Technique Startup Procedures (RTCR)
IL3113555	ROLLING OAKS CAMPGROUND (113555)	Revised Total Coliform Rule	05/25/2022	Treatment Technique Startup Procedures (RTCR)
IL3126573	ROLLING OAKS CAMPGROUND (126573)	Public Notice		Public Notification Violation for NPDWR Violation

IL3126573	ROLLING OAKS CAMPGROUND (126573)	Revised Total Coliform Rule	04/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3126573	ROLLING OAKS CAMPGROUND (126573)	Revised Total Coliform Rule	04/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3000828	ROLLING OAKS OFFICE WELL	Revised Total Coliform Rule	04/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3000828	ROLLING OAKS OFFICE WELL	Revised Total Coliform Rule	04/20/2022	Treatment Technique Startup Procedures (RTCR)
IL3103325	SAND RIDGE STATE FOREST (103325)	Revised Total Coliform Rule	09/12/2022	Monitoring, Routine (RTCR)
IL3103333	SAND RIDGE STATE FOREST (103333)	Revised Total Coliform Rule	09/12/2022	Monitoring, Routine (RTCR)
IL3003657	SAND RIDGE STATE FOREST (3657)	Revised Total Coliform Rule	09/12/2022	Monitoring, Routine (RTCR)
IL3150979	SAUER FAMILY FARM FOREST PRESERVE	Public Notice		Public Notification Violation for NPDWR Violation
IL3093047	SCAPECCHIS	Revised Total Coliform Rule	08/09/2022	Maximum Contaminant Level Violation, E. coli (RTCR)
IL3132464	SHAW WA NAS SEE 4H CAMP-WELL3	Revised Total Coliform Rule	05/09/2022	Treatment Technique Startup Procedures (RTCR)
IL3126821	SHERIDAN ROD & GUN	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3111013	SHOREWOOD SHELL EXPRESS	Revised Total Coliform Rule	09/30/2022	Monitoring, Additional Routine (RTCR)

IL3095828	SILVER SPRINGS STATE PARK (95828)	Public Notice		Public Notification Violation for NPDWR Violation
IL3095828	SILVER SPRINGS STATE PARK (95828)	Revised Total Coliform Rule	06/28/2022	Treatment Technique Startup Procedures (RTCR)
IL3095828	SILVER SPRINGS STATE PARK (95828)	Revised Total Coliform Rule	06/28/2022	Treatment Technique Startup Procedures (RTCR)
IL3016865	SOUTH WILMINGTON FIREMANS #1	Public Notice		Public Notification Violation for NPDWR Violation
IL3016865	SOUTH WILMINGTON FIREMANS #1	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3016865	SOUTH WILMINGTON FIREMANS #1	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3015602	SOUTH WILMINGTON FIREMANS #2	Public Notice		Public Notification Violation for NPDWR Violation
IL3015602	SOUTH WILMINGTON FIREMANS #2	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3015602	SOUTH WILMINGTON FIREMANS #2	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3095299	SOUTH WILMINGTON SPORTSMAN CLU (95299)	Public Notice		Public Notification Violation for NPDWR Violation
IL3095299	SOUTH WILMINGTON SPORTSMAN CLU (95299)	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3095299	SOUTH WILMINGTON SPORTSMAN CLU (95299)	Revised Total Coliform Rule		Treatment Technique Startup

				Procedures (RTCR)
IL3065706	SPRING LAKE MARINA LIMITED	Public Notice		Public Notification Violation for NPDWR Violation
IL3065706	SPRING LAKE MARINA LIMITED	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3065706	SPRING LAKE MARINA LIMITED	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3003863	SPRINGFIELD KOA KAMPGROUND INC	Revised Total Coliform Rule	06/13/2022	Monitoring, Routine (RTCR)
IL3064980	ST JOHNS UNITED CHURCH	Revised Total Coliform Rule	06/14/2022	Monitoring, Additional Routine (RTCR)
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	1,1,1-Trichloroethane	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	1,1,2-Trichloroethane	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	1,1-Dichloroethylene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	1,2,4-Trichlorobenzene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	1,2,4-Trichlorobenzene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	1,2-DIBROMO-3-CHLOROPROPANE	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	1,2-DIBROMO-3-CHLOROPROPANE	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	1,2-Dichloroethane	08/18/2022	Monitoring, Regular

IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	1,2-Dichloropropane	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	2,4,5-TP	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	2,4,5-TP	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	2,4-D	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	2,4-D	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Atrazine	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Atrazine	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Benzene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Benzo(a)pyrene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Benzo(a)pyrene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	BHC-GAMMA	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Carbofuran	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Carbofuran	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Carbon tetrachloride	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Chlordane	08/18/2022	Monitoring, Regular

IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Chlordane	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	CHLOROBENZENE	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	cis-1,2-Dichloroethylene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	cis-1,2-Dichloroethylene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Dalapon	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Di(2-ethylhexyl) adipate	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Di(2-ethylhexyl) adipate	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Di(2-ethylhexyl) phthalate	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Di(2-ethylhexyl) phthalate	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	DICHLOROMETHANE	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	DICHLOROMETHANE	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Dinoseb	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Dinoseb	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Diquat	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Diquat	08/18/2022	Monitoring, Regular

IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Endothall	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Endothall	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Endrin	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Ethylbenzene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	ETHYLENE DIBROMIDE	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	ETHYLENE DIBROMIDE	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Glyphosate	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Glyphosate	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Heptachlor	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Heptachlor	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Heptachlor epoxide	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Heptachlor epoxide	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	HEXACHLOROBENZENE	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	HEXACHLOROBENZENE	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Hexachlorocyclopentadiene	08/18/2022	Monitoring, Regular

IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Hexachlorocyclopentadiene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	LASSO	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	LASSO	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Lead and Copper Rule	08/18/2022	Initial Tap Sampling for Pb and Cu
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Lead and Copper Rule	08/18/2022	Initial Tap Sampling for Pb and Cu
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Methoxychlor	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	o-Dichlorobenzene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	o-Dichlorobenzene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	OXAMYL	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	OXAMYL	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	p-Dichlorobenzene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	p-Dichlorobenzene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Pentachlorophenol	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Pentachlorophenol	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Picloram	08/18/2022	Monitoring, Regular

IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Picloram	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Simazine	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Simazine	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Styrene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Tetrachloroethylene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Toluene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Total Polychlorinated Biphenyls (PCB)	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Total Polychlorinated Biphenyls (PCB)	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Toxaphene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	trans-1,2-Dichloroethylene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Trichloroethylene	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Vinyl chloride	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Vinyl chloride	08/18/2022	Monitoring, Regular
IL3163360	ST PETER LUTHERAN CHURCH/SONSHINE CHRIST	Xylenes, Total	08/18/2022	Monitoring, Regular
IL3035519	ST SEBASTIAN CHURCH	Revised Total Coliform Rule	06/15/2022	Monitoring, Additional Routine (RTCR)

IL3151183	STONE CITY SOFTBALL CONCESSION	Public Notice		Public Notification Violation for NPDWR Violation
IL3151183	STONE CITY SOFTBALL CONCESSION	Revised Total Coliform Rule	04/29/2022	Treatment Technique Startup Procedures (RTCR)
IL3151183	STONE CITY SOFTBALL CONCESSION	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3090035	STROPE'S CAMPGROUND	Nitrate	08/09/2022	Monitoring, Regular
IL3085746	SUNSET LAKES RESORT (85746) HOUSE WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3085746	SUNSET LAKES RESORT (85746) HOUSE WELL	Revised Total Coliform Rule	04/22/2022	Treatment Technique Startup Procedures (RTCR)
IL3085746	SUNSET LAKES RESORT (85746) HOUSE WELL	Revised Total Coliform Rule	04/22/2022	Treatment Technique Startup Procedures (RTCR)
IL3085746	SUNSET LAKES RESORT (85746) HOUSE WELL	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3156117	SUNSET RIDGE MX CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3156117	SUNSET RIDGE MX CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3138362	SWANSON PARK	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3124164	THE GOOSE PIT	E. COLI		Monitoring, Source Water (GWR)

IL3110338	THE ISLAND ON THE CHAIN	Revised Total Coliform Rule	04/30/2022	Treatment Technique Startup Procedures (RTCR)
IL3009157	THE KITCHEN TABLE	Public Notice	08/31/2022	Public Notification Violation for NPDWR Violation
IL3034595	THE STABLES, LLC	Public Notice		Public Notification Violation for NPDWR Violation
IL3075960	TIERRA MAR	Public Notice		Public Notification Violation for NPDWR Violation
IL3130849	TIMBER PNTE OTDR CNTR-MAIN CAM	Public Notice	08/15/2022	Public Notification Violation for NPDWR Violation
IL3017681	TIMBERLAKE RESORT	Public Notice		Public Notification Violation for NPDWR Violation
IL3017681	TIMBERLAKE RESORT	Revised Total Coliform Rule	08/16/2022	Treatment Technique Startup Procedures (RTCR)
IL3047472	TOLLWAY INN	Public Notice	08/19/2022	Public Notification Violation for NPDWR Violation
IL3046532	TRAVLUR MOTEL	Nitrate	08/16/2022	Monitoring, Regular
IL3046532	TRAVLUR MOTEL	Public Notice		Public Notification Violation for NPDWR Violation
IL3002121	TRENTON SPORTSMAN CLUB	Revised Total Coliform Rule	07/13/2022	Monitoring, Additional Routine (RTCR)
IL3003426	TRI-COUNTY COUNTRY CLUB	Revised Total Coliform Rule	04/18/2022	Treatment Technique Startup Procedures (RTCR)

IL3000737	TROLL HOLLOW - WEST	Revised Total Coliform Rule	04/25/2022	Treatment Technique Startup Procedures (RTCR)
IL3015933	TROY SPORTSMENS CLUB	Revised Total Coliform Rule	06/14/2022	Treatment Technique Startup Procedures (RTCR)
IL3003509	UNCLE PAULIES	Public Notice		Public Notification Violation for NPDWR Violation
IL3104679	USFS GARDEN OF THE GODS CAMPGD	Public Notice		Public Notification Violation for NPDWR Violation
IL3060285	WALNUT GR UNITED METHODIST CHU	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3003020	WALNUT PT SP WELL2 CONCESSIONS/CAMPGRND	Revised Total Coliform Rule	07/07/2022	Treatment Technique Startup Procedures (RTCR)
IL3003020	WALNUT PT SP WELL2 CONCESSIONS/CAMPGRND	Revised Total Coliform Rule	07/07/2022	Treatment Technique Startup Procedures (RTCR)
IL3015610	WAUPECAN VALLEY GROCERY	Revised Total Coliform Rule	06/02/2022	Treatment Technique Startup Procedures (RTCR)
IL3014464	WAUPECON VALLEY PARK #1	Revised Total Coliform Rule	06/02/2022	Treatment Technique Startup Procedures (RTCR)
IL3122275	WEBBS VALLEY VIEW CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3122275	WEBBS VALLEY VIEW CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3122275	WEBBS VALLEY VIEW CAMPGROUND	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)

IL3122275	WEBBS VALLEY VIEW CAMPGROUND	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3122275	WEBBS VALLEY VIEW CAMPGROUND	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3122275	WEBBS VALLEY VIEW CAMPGROUND	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3139139	WELDON SPRINGS SP SHWRHSE	Public Notice		Public Notification Violation for NPDWR Violation
IL3139139	WELDON SPRINGS SP SHWRHSE	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3109090	WELDON SPRINGS STATE PARK CONCESN	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3149567	WESTERN ILLINOIS BOAT CLUB	Revised Total Coliform Rule	06/16/2022	Treatment Technique Startup Procedures (RTCR)
IL3149229	WESTERN ILLINOIS NATURE GROUP	Public Notice		Public Notification Violation for NPDWR Violation
IL3149229	WESTERN ILLINOIS NATURE GROUP	Revised Total Coliform Rule	08/15/2022	Monitoring, Additional Routine (RTCR)
IL3057646	WILDWOOD CAMPGROUND	Public Notice		Public Notification Violation for NPDWR Violation
IL3057646	WILDWOOD CAMPGROUND	Revised Total Coliform Rule		Treatment Technique Startup Procedures (RTCR)
IL3022038	WILMINGTON REC CLUB BEACH BATHHOUSE	Revised Total Coliform Rule	06/10/2022	Treatment Technique Startup Procedures (RTCR)

IL3115287	WOODFORD COUNTY IZAAK WALTON	Public Notice	09/25/2022	Public Notification Violation for NPDWR Violation
IL3115287	WOODFORD COUNTY IZAAK WALTON	Public Notice		Public Notification Violation for NPDWR Violation
IL3115287	WOODFORD COUNTY IZAAK WALTON	Revised Total Coliform Rule	06/06/2022	Monitoring, Routine (RTCR)
IL3116160	WOODLAND HILLS CAMPING & RECREATION	E. COLI	09/06/2022	Monitoring, Source Water (GWR)
IL3001230	YOUNGS LAKE	Revised Total Coliform Rule	08/23/2022	Treatment Technique Startup Procedures (RTCR)
IL3001230	YOUNGS LAKE	Revised Total Coliform Rule	08/23/2022	Monitoring, Routine (RTCR)
IL3001230	YOUNGS LAKE	Revised Total Coliform Rule	08/23/2022	Treatment Technique Startup Procedures (RTCR)
IL3001230	YOUNGS LAKE	Revised Total Coliform Rule		Monitoring, Routine (RTCR)

Appendix E
Illinois EPA 2022 Annual Compliance Report
Summary Non-Transient Non-Community Violations Sorted by Contaminant

From U.S. EPA's CDX Reporting Services database

Contaminant Name	PWS ID	PWS Name	Contaminant Name	Resolved Date	Violation Type Description
1,1,1-Trichloroethane	IL3039735	CARMEL MONTESSORI ACADEMY	1,1,1-Trichloroethane	05/25/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3039735	CARMEL MONTESSORI ACADEMY	1,1,1-Trichloroethane	05/25/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3039735	CARMEL MONTESSORI ACADEMY	1,1,1-Trichloroethane	05/25/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3039735	CARMEL MONTESSORI ACADEMY	1,1,1-Trichloroethane	05/25/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3088518	COG HILL COUNTRY CLUB	1,1,1-Trichloroethane	08/05/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3088518	COG HILL COUNTRY CLUB	1,1,1-Trichloroethane	08/05/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3088518	COG HILL COUNTRY CLUB	1,1,1-Trichloroethane	08/05/2022	Monitoring, Regular

1,1,1-Trichloroethane	IL3088518	COG HILL COUNTRY CLUB	1,1,1-Trichloroethane	08/05/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3152603	EDP RENEWABLES	1,1,1-Trichloroethane	06/21/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3152603	EDP RENEWABLES	1,1,1-Trichloroethane	06/21/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3152603	EDP RENEWABLES	1,1,1-Trichloroethane	07/19/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3152603	EDP RENEWABLES	1,1,1-Trichloroethane	07/19/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3102939	EMMONS GRADE SCHOOL	1,1,1-Trichloroethane	05/23/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3102939	EMMONS GRADE SCHOOL	1,1,1-Trichloroethane	05/23/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3102939	EMMONS GRADE SCHOOL	1,1,1-Trichloroethane	05/23/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3042127	HONEYWELL INTERNATIONAL INC	1,1,1-Trichloroethane	05/12/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3042127	HONEYWELL INTERNATIONAL INC	1,1,1-Trichloroethane	05/12/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3042127	HONEYWELL INTERNATIONAL INC	1,1,1-Trichloroethane	05/12/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3042127	HONEYWELL INTERNATIONAL INC	1,1,1-Trichloroethane	05/12/2022	Monitoring, Regular
1,1,1-Trichloroethane	IL3163097	LAUNCH ENRICHMENT L3C	1,1,1-Trichloroethane	09/07/2022	Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3158717	ALLOY SPECIALTIES (10500312)	1,2-DIBROMO-3-CHLOROPROPANE	08/24/2022	Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3158717	ALLOY SPECIALTIES (10500312)	1,2-DIBROMO-3-CHLOROPROPANE	08/24/2022	Monitoring, Regular

1,2-DIBROMO-3-CHLOROPROPANE	IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3152603	EDP RENEWABLES	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3152603	EDP RENEWABLES	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3152603	EDP RENEWABLES	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
1,2-DIBROMO-3-CHLOROPROPANE	IL3152603	EDP RENEWABLES	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
Antimony, Total	IL3050716	TITAN TIRE CORPORATION OF FREEPORT	Antimony, Total	09/06/2022	Monitoring, Regular
Antimony, Total	IL3050716	TITAN TIRE CORPORATION OF FREEPORT	Antimony, Total	09/06/2022	Monitoring, Regular
Antimony, Total	IL3050716	TITAN TIRE CORPORATION OF FREEPORT	Antimony, Total	09/06/2022	Monitoring, Regular
Antimony, Total	IL3050716	TITAN TIRE CORPORATION OF FREEPORT	Antimony, Total	09/06/2022	Monitoring, Regular
Arsenic	IL3148270	AG VIEW FS INC.	Arsenic		Monitoring, Regular

Arsenic	IL3148270	AG VIEW FS INC.	Arsenic		Monitoring, Regular
Arsenic	IL3141184	CORN BELT ENERGY CORP	Arsenic		Maximum Contaminant Level Violation, Average
Arsenic	IL3141184	CORN BELT ENERGY CORP	Arsenic		Maximum Contaminant Level Violation, Average
Arsenic	IL3141184	CORN BELT ENERGY CORP	Arsenic		Maximum Contaminant Level Violation, Average
Arsenic	IL3141184	CORN BELT ENERGY CORP	Arsenic		Monitoring, Regular
Arsenic	IL3141184	CORN BELT ENERGY CORP	Arsenic		Monitoring, Regular
Arsenic	IL3065383	NOURYON SURFACE CHEMISTRY LLC	Arsenic	04/19/2022	Monitoring, Regular
Arsenic	IL3065383	NOURYON SURFACE CHEMISTRY LLC	Arsenic	04/19/2022	Monitoring, Regular
Arsenic	IL3065383	NOURYON SURFACE CHEMISTRY LLC	Arsenic	04/19/2022	Monitoring, Regular
Arsenic	IL3065383	NOURYON SURFACE CHEMISTRY LLC	Arsenic	04/19/2022	Monitoring, Regular
Arsenic	IL3157933	PEARL VALLEY FARMS	Arsenic		Monitoring, Regular
Arsenic	IL3149963	PEARL VALLEY SPECIALTY EGG PRODUCTS	Arsenic		Monitoring, Regular
BHC-GAMMA	IL3139766	PEOTONE INTERMEDIATE CENTER	BHC-GAMMA	05/31/2022	Monitoring, Regular
BHC-GAMMA	IL3139766	PEOTONE INTERMEDIATE CENTER	BHC-GAMMA	05/31/2022	Monitoring, Regular

BHC-GAMMA	IL3139766	PEOTONE INTERMEDIATE CENTER	BHC-GAMMA	05/31/2022	Monitoring, Regular
Chlorine	IL3147652	CORNERSTONE CHRISTIAN ACADEMY	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3147652	CORNERSTONE CHRISTIAN ACADEMY	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3147652	CORNERSTONE CHRISTIAN ACADEMY	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3010702	KANELAND HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3010702	KANELAND HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3005256	PRAIRIEVIEW JR. HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3005256	PRAIRIEVIEW JR. HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3005256	PRAIRIEVIEW JR. HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3113985	RIVERDALE SCHOOL DISTRICT #100	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3113985	RIVERDALE SCHOOL DISTRICT #100	Chlorine		Monitoring and Reporting (DBP)
Chlorine	IL3155606	U OF I CHICAGO MEDICAL CENTER	Chlorine		Monitoring and Reporting (DBP)
CYANIDE	IL3137232	WEDRON SILICA SAND COMPANY	CYANIDE	04/18/2022	Monitoring, Regular
CYANIDE	IL3137232	WEDRON SILICA SAND COMPANY	CYANIDE	04/18/2022	Monitoring, Regular

CYANIDE	IL3137232	WEDRON SILICA SAND COMPANY	CYANIDE	04/18/2022	Monitoring, Regular
Di(2-ethylhexyl) phthalate	IL3008342	HARDING GRADE SCHOOL	Di(2-ethylhexyl) phthalate	05/17/2022	Monitoring, Regular
Di(2-ethylhexyl) phthalate	IL3008342	HARDING GRADE SCHOOL	Di(2-ethylhexyl) phthalate	05/17/2022	Monitoring, Regular
Di(2-ethylhexyl) phthalate	IL3008342	HARDING GRADE SCHOOL	Di(2-ethylhexyl) phthalate	08/08/2022	Monitoring, Regular
Di(2-ethylhexyl) phthalate	IL3008342	HARDING GRADE SCHOOL	Di(2-ethylhexyl) phthalate	08/08/2022	Monitoring, Regular
E. COLI	IL3155291	H B FULLER	E. COLI		Monitoring, Source Water (GWR)
E. COLI	IL3155291	H B FULLER	E. COLI		Monitoring, Source Water (GWR)
E. COLI	IL3155291	H B FULLER	E. COLI		Monitoring, Source Water (GWR)
Heptachlor	IL3142018	RIVER RIDGE SCHOOL	Heptachlor	08/05/2022	Monitoring, Regular
Heptachlor	IL3142018	RIVER RIDGE SCHOOL	Heptachlor	08/05/2022	Monitoring, Regular
Lead and Copper Rule	IL3051250	1ST CHURCH OF THE OPEN BIBLE	Lead and Copper Rule	09/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL3051250	1ST CHURCH OF THE OPEN BIBLE	Lead and Copper Rule	09/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL3029389	325 S ROUTE 31 LLC	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3029389	325 S ROUTE 31 LLC	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3158717	ALLOY SPECIALTIES (10500312)	Lead and Copper Rule	08/12/2022	Lead Consumer Notice

Lead and Copper Rule	IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Lead and Copper Rule	06/30/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Lead and Copper Rule	06/30/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Lead and Copper Rule	06/30/2022	Initial, Follow-up, or Routine Source Water M/R
Lead and Copper Rule	IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Lead and Copper Rule	07/19/2022	Lead Consumer Notice
Lead and Copper Rule	IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Lead and Copper Rule	07/19/2022	Lead Consumer Notice
Lead and Copper Rule	IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Lead and Copper Rule	07/19/2022	Lead Consumer Notice
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3147728	AMERICAN PRECISION ELECTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3152223	APACHI DAY CAMP	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3152223	APACHI DAY CAMP	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3086454	AQUA PLAZA	Lead and Copper Rule	05/10/2022	Lead Consumer Notice
Lead and Copper Rule	IL3086454	AQUA PLAZA	Lead and Copper Rule	05/10/2022	Lead Consumer Notice

Lead and Copper Rule	IL3086454	AQUA PLAZA	Lead and Copper Rule	05/10/2022	Lead Consumer Notice
Lead and Copper Rule	IL3112367	BANYAN TREATMENT CENTER	Lead and Copper Rule	09/01/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3112367	BANYAN TREATMENT CENTER	Lead and Copper Rule	09/01/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3112367	BANYAN TREATMENT CENTER	Lead and Copper Rule	09/01/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3148742	BARRINGTON METHODIST CHURCH (148742)	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3148742	BARRINGTON METHODIST CHURCH (148742)	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3018556	BATTERY BUILDERS	Lead and Copper Rule	08/30/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3018556	BATTERY BUILDERS	Lead and Copper Rule	08/30/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3018556	BATTERY BUILDERS	Lead and Copper Rule	08/30/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3039735	CARMEL MONTESSORI ACADEMY	Lead and Copper Rule	09/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL3039735	CARMEL MONTESSORI ACADEMY	Lead and Copper Rule	09/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL3039735	CARMEL MONTESSORI ACADEMY	Lead and Copper Rule	09/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL3117895	CAT TECH CENTER	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3161240	CCI MANUFACTURING	Lead and Copper Rule	03/10/2022	Lead Consumer Notice
Lead and Copper Rule	IL3126417	CENTRAL HIGH SCHOOL	Lead and Copper Rule		Lead Consumer Notice

Lead and Copper Rule	IL3067538	CENTRAL MIDDLE SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3088518	COG HILL COUNTRY CLUB	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3088518	COG HILL COUNTRY CLUB	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3006882	COMMONWEALTH EDISON COMPANY	Lead and Copper Rule	01/05/2022	Lead Consumer Notice
Lead and Copper Rule	IL3006882	COMMONWEALTH EDISON COMPANY	Lead and Copper Rule	01/05/2022	Lead Consumer Notice
Lead and Copper Rule	IL3084715	COUNTRYSIDE SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3057232	CRYSTAL LAKE MONTESSORI	Lead and Copper Rule	05/03/2022	Lead Consumer Notice
Lead and Copper Rule	IL3057232	CRYSTAL LAKE MONTESSORI	Lead and Copper Rule	05/03/2022	Lead Consumer Notice
Lead and Copper Rule	IL3057232	CRYSTAL LAKE MONTESSORI	Lead and Copper Rule	05/03/2022	Lead Consumer Notice
Lead and Copper Rule	IL3005298	DONOVAN GRADE SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3004572	EISENHOWER ACADEMY	Lead and Copper Rule	05/13/2022	Lead Consumer Notice
Lead and Copper Rule	IL3004572	EISENHOWER ACADEMY	Lead and Copper Rule	05/13/2022	Lead Consumer Notice
Lead and Copper Rule	IL3004572	EISENHOWER ACADEMY	Lead and Copper Rule	05/13/2022	Lead Consumer Notice
Lead and Copper Rule	IL3102939	EMMONS GRADE SCHOOL	Lead and Copper Rule	09/28/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3102939	EMMONS GRADE SCHOOL	Lead and Copper Rule	09/28/2022	Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL3102939	EMMONS GRADE SCHOOL	Lead and Copper Rule	09/28/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3034314	EQUISTAR CHEMICALS LP	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3055483	EXCEL FOUNDRY & MACHINE	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
Lead and Copper Rule	IL3055483	EXCEL FOUNDRY & MACHINE	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
Lead and Copper Rule	IL3139337	FIBER TEX-NON WOVEN SOLUTIONS	Lead and Copper Rule	02/03/2022	Lead Consumer Notice
Lead and Copper Rule	IL3139337	FIBER TEX-NON WOVEN SOLUTIONS	Lead and Copper Rule	02/03/2022	Lead Consumer Notice
Lead and Copper Rule	IL3118646	FLOWER GARDEN ANNEX	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3133538	FOX VALLEY YMCA & PRESCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3108704	GATEWAY FOUNDATION	Lead and Copper Rule	04/29/2022	Lead Consumer Notice
Lead and Copper Rule	IL3108704	GATEWAY FOUNDATION	Lead and Copper Rule	04/29/2022	Lead Consumer Notice
Lead and Copper Rule	IL3108704	GATEWAY FOUNDATION	Lead and Copper Rule	04/29/2022	Lead Consumer Notice
Lead and Copper Rule	IL3002188	GAVIN CENTRAL ELEMENTARY	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3002188	GAVIN CENTRAL ELEMENTARY	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3130302	GOOD SHEPHERD HOSPITAL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3019638	GRASS LAKE SCHOOL	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
Lead and Copper Rule	IL3019638	GRASS LAKE SCHOOL	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
Lead and Copper Rule	IL3019638	GRASS LAKE SCHOOL	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
Lead and Copper Rule	IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3113837	ILLINOIS CENTRAL	Lead and Copper Rule		Public Education
Lead and Copper Rule	IL3037291	INDIAN KNOLL SCHOOL DIST 33	Lead and Copper Rule	04/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL3037291	INDIAN KNOLL SCHOOL DIST 33	Lead and Copper Rule	04/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL3153312	JARRETT PRAIRIE CENTER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL3153312	JARRETT PRAIRIE CENTER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL3153312	JARRETT PRAIRIE CENTER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL3053652	JBS CORPORATION	Lead and Copper Rule	06/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL3053652	JBS CORPORATION	Lead and Copper Rule	06/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL3153072	JEWEL WELLS SPRING GROVE	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3153072	JEWEL WELLS SPRING GROVE	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3130534	JIMMY JOHNS (PROSPECT CROSSING)	Lead and Copper Rule	05/04/2022	Lead Consumer Notice

Lead and Copper Rule	IL3130534	JIMMY JOHNS (PROSPECT CROSSING)	Lead and Copper Rule	05/04/2022	Lead Consumer Notice
Lead and Copper Rule	IL3130534	JIMMY JOHNS (PROSPECT CROSSING)	Lead and Copper Rule	05/04/2022	Lead Consumer Notice
Lead and Copper Rule	IL3142604	JOHNS MANVILLE	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3156836	JW MARRIOT HOTEL	Lead and Copper Rule	08/01/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3057240	KINDERCARE MCHENRY	Lead and Copper Rule	05/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL3057240	KINDERCARE MCHENRY	Lead and Copper Rule	05/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL3057240	KINDERCARE MCHENRY	Lead and Copper Rule	05/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL3034819	KONE INC	Lead and Copper Rule	02/21/2022	Lead Consumer Notice
Lead and Copper Rule	IL3163097	LAUNCH ENRICHMENT L3C	Lead and Copper Rule	09/15/2022	Initial Tap Sampling for Pb and Cu
Lead and Copper Rule	IL3131045	LEICA BIOSYSTEMS	Lead and Copper Rule	06/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL3131045	LEICA BIOSYSTEMS	Lead and Copper Rule	06/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL3131045	LEICA BIOSYSTEMS	Lead and Copper Rule	06/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL3154724	LIFES LITTLE MIRACLES	Lead and Copper Rule	01/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL3067520	LILY LAKE GRADE SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3108688	LORADO TAFT DINING HALL	Lead and Copper Rule	07/13/2022	Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL3108688	LORADO TAFT DINING HALL	Lead and Copper Rule	07/13/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3108688	LORADO TAFT DINING HALL	Lead and Copper Rule	07/13/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3108688	LORADO TAFT DINING HALL	Lead and Copper Rule	07/13/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3104216	MAT HOLDINGS	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3076984	MIDLAND HIGH SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3154666	MONROE CENTER SCHOOL - NEW WELL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3001578	MONROE CENTER SCHOOL - OLD WELL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3001578	MONROE CENTER SCHOOL - OLD WELL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3001578	MONROE CENTER SCHOOL - OLD WELL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3149823	MONTE CARLO PLAZA	Lead and Copper Rule	02/04/2022	Lead Consumer Notice
Lead and Copper Rule	IL3089243	MONTEREY MUSHROOMS INC	Lead and Copper Rule	06/13/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3089243	MONTEREY MUSHROOMS INC	Lead and Copper Rule	06/13/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3089243	MONTEREY MUSHROOMS INC	Lead and Copper Rule	06/13/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3024281	MOTHER TERESA CATHOLIC ACADEMY	Lead and Copper Rule	06/15/2022	Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL3024281	MOTHER TERESA CATHOLIC ACADEMY	Lead and Copper Rule	06/15/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3024281	MOTHER TERESA CATHOLIC ACADEMY	Lead and Copper Rule	06/15/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3030700	NETTLE CREEK SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3030700	NETTLE CREEK SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3148619	NORTH BOONE HIGH SCHOOL	Lead and Copper Rule	06/29/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3148619	NORTH BOONE HIGH SCHOOL	Lead and Copper Rule	06/29/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3148619	NORTH BOONE HIGH SCHOOL	Lead and Copper Rule	06/29/2022	Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL3091728	NORTH BOONE MIDDLE SCHOOL	Lead and Copper Rule	06/28/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3091728	NORTH BOONE MIDDLE SCHOOL	Lead and Copper Rule	06/28/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3091728	NORTH BOONE MIDDLE SCHOOL	Lead and Copper Rule	06/28/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3005611	OAKWOOD TWP HIGH SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3027961	PARK CENTER OF KEMPER LAKES AVIANDS	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3096453	PBC LINEAR	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3155390	PEACEFUL PATHWAYS	Lead and Copper Rule	09/20/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3039792	PETER PAN DAY SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3140228	PRAIRIE VIEW ELEMENTARY SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3076398	PUTNAM COUNTY JR HIGH	Lead and Copper Rule	05/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL3076398	PUTNAM COUNTY JR HIGH	Lead and Copper Rule	05/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL3076398	PUTNAM COUNTY JR HIGH	Lead and Copper Rule	05/06/2022	Lead Consumer Notice
Lead and Copper Rule	IL3139295	QUIKRETE COMPANIES	Lead and Copper Rule	08/05/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3139295	QUIKRETE COMPANIES	Lead and Copper Rule	08/05/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3139295	QUIKRETE COMPANIES	Lead and Copper Rule	08/05/2022	Follow-up Or Routine LCR Tap M/R

Lead and Copper Rule	IL3139295	QUIKRETE COMPANIES	Lead and Copper Rule	08/05/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3055947	RANKIN SCHOOL DISTRICT NO 98	Lead and Copper Rule	06/06/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3055947	RANKIN SCHOOL DISTRICT NO 98	Lead and Copper Rule	06/06/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3055947	RANKIN SCHOOL DISTRICT NO 98	Lead and Copper Rule	06/06/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3055947	RANKIN SCHOOL DISTRICT NO 98	Lead and Copper Rule	06/06/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3086751	ROCKLAND OFFICE PLAZA	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	02/25/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	02/25/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	02/25/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
Lead and Copper Rule	IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice

Lead and Copper Rule	IL3141028	SHOPS OF KILDEER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL3141028	SHOPS OF KILDEER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL3141028	SHOPS OF KILDEER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL3135459	SOUTH BARRINGTON PARK DISTRICT	Lead and Copper Rule	01/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL3135459	SOUTH BARRINGTON PARK DISTRICT	Lead and Copper Rule	01/31/2022	Lead Consumer Notice
Lead and Copper Rule	IL3155382	SPEICHER STORAGE	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3155382	SPEICHER STORAGE	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3131532	SPRING CREEK PLAZA/CORE SPRING GROVE LLC	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3131532	SPRING CREEK PLAZA/CORE SPRING GROVE LLC	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3131532	SPRING CREEK PLAZA/CORE SPRING GROVE LLC	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3002931	SPRING GROVE ELEMENTARY SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3002931	SPRING GROVE ELEMENTARY SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3011486	ST BEDE SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3096966	ST RITAS SCHOOL	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3096966	ST RITAS SCHOOL	Lead and Copper Rule		Lead Consumer Notice

Lead and Copper Rule	IL3047530	STATELINE FOUNDRIES	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3112938	TAYLOR RIDGE ELEMENTARY SCHOOL	Lead and Copper Rule	04/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL3112938	TAYLOR RIDGE ELEMENTARY SCHOOL	Lead and Copper Rule	04/25/2022	Lead Consumer Notice
Lead and Copper Rule	IL3131060	TOP DIE CASTING CO	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3131060	TOP DIE CASTING CO	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3153924	TPG PRESSURE, INC. - WEST WELL	Lead and Copper Rule	02/21/2022	Lead Consumer Notice
Lead and Copper Rule	IL3153924	TPG PRESSURE, INC. - WEST WELL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3153924	TPG PRESSURE, INC. - WEST WELL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3153924	TPG PRESSURE, INC. - WEST WELL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3022061	TRINITY LUTHERAN SCHOOL	Lead and Copper Rule	08/03/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3022061	TRINITY LUTHERAN SCHOOL	Lead and Copper Rule	08/03/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3022061	TRINITY LUTHERAN SCHOOL	Lead and Copper Rule	08/03/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3155606	U OF I CHICAGO MEDICAL CENTER	Lead and Copper Rule		Lead Consumer Notice
Lead and Copper Rule	IL3131524	VAN DRUNEN FARMS	Lead and Copper Rule	07/19/2022	Lead Consumer Notice
Lead and Copper Rule	IL3131524	VAN DRUNEN FARMS	Lead and Copper Rule	07/19/2022	Lead Consumer Notice

Lead and Copper Rule	IL3129619	WASTE MANAGEMENT NORTH	Lead and Copper Rule	05/09/2022	Lead Consumer Notice
Lead and Copper Rule	IL3129619	WASTE MANAGEMENT NORTH	Lead and Copper Rule	05/09/2022	Lead Consumer Notice
Lead and Copper Rule	IL3129619	WASTE MANAGEMENT NORTH	Lead and Copper Rule	05/09/2022	Lead Consumer Notice
Lead and Copper Rule	IL3137232	WEDRON SILICA SAND COMPANY	Lead and Copper Rule	06/27/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3137232	WEDRON SILICA SAND COMPANY	Lead and Copper Rule	06/27/2022	Follow-up Or Routine LCR Tap M/R
Lead and Copper Rule	IL3158873	WEDRON SILICA SCREENHOUSE	Lead and Copper Rule	08/10/2022	Lead Consumer Notice
Lead and Copper Rule	IL3159780	WINNEBAGO COUNTY ROCK 39	Lead and Copper Rule	09/02/2022	Lead Consumer Notice
Lead and Copper Rule	IL3159780	WINNEBAGO COUNTY ROCK 39	Lead and Copper Rule	09/02/2022	Lead Consumer Notice
Nitrate	IL3052894	EMERALD POLYMER ADDITIVES, LLC	Nitrate	08/09/2022	Maximum Contaminant Level Violation, Single Sample
Nitrate	IL3052894	EMERALD POLYMER ADDITIVES, LLC	Nitrate	08/09/2022	Maximum Contaminant Level Violation, Single Sample
Public Notice	IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Public Notice	09/07/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Public Notice	09/07/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3039735	CARMEL MONTESSORI ACADEMY	Public Notice		Public Notification Violation for NPDWR Violation

Public Notice	IL3113852	CAT MOSSVILLE	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3117895	CAT TECH CENTER	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3147801	CBRE WEST PLAZA	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3088518	COG HILL COUNTRY CLUB	Public Notice	08/20/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3088518	COG HILL COUNTRY CLUB	Public Notice	08/20/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3088518	COG HILL COUNTRY CLUB	Public Notice	08/20/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3088518	COG HILL COUNTRY CLUB	Public Notice	08/20/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3155374	EVEREST ACADEMY	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3137158	FCA MANUFACTURING COMPANY	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3137158	FCA MANUFACTURING COMPANY	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3137158	FCA MANUFACTURING COMPANY	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3139337	FIBER TEX-NON WOVEN SOLUTIONS	Public Notice		Public Notification Violation for

					NPDWR Violation
Public Notice	IL3139337	FIBER TEX-NON WOVEN SOLUTIONS	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3155416	FOX METRO WATER RECLAMATION DISTRICT	Public Notice	08/31/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3155416	FOX METRO WATER RECLAMATION DISTRICT	Public Notice	08/31/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3008342	HARDING GRADE SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3053652	JBS CORPORATION	Public Notice	08/12/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3053652	JBS CORPORATION	Public Notice	08/12/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3029207	LISBON GRADE SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3155085	LITTLE FUTURE'S CHILD CARE	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3076984	MIDLAND HIGH SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3001578	MONROE CENTER SCHOOL - OLD WELL	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3149823	MONTE CARLO PLAZA	Public Notice		Public Notification Violation for NPDWR Violation

Public Notice	IL3057844	OLYMPIA SCHOOL	Public Notice	05/02/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3057844	OLYMPIA SCHOOL	Public Notice	05/02/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3057844	OLYMPIA SCHOOL	Public Notice	05/02/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3076398	PUTNAM COUNTY JR HIGH	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3111278	REICHHOLD CHEMICALS	Public Notice	08/23/2022	Public Notification Violation for NPDWR Violation
Public Notice	IL3090290	SHERRARD JR/SR HIGH SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3059584	ST PAULS LUTHERAN SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3019364	TAMARAK DAY CAMP	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3153924	TPG PRESSURE, INC. - WEST WELL	Public Notice		Public Notification Violation for NPDWR Violation
Public Notice	IL3155606	U OF I CHICAGO MEDICAL CENTER	Public Notice		Public Notification Violation for NPDWR Violation
Revised Total Coliform Rule	IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Additional Routine (RTCR)

Revised Total Coliform Rule	IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule		Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule		Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3162313	BRANDT INDUSTRIES USA LTD	Revised Total Coliform Rule	07/25/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3113423	CAT MAPLETON /MAPLETON	Revised Total Coliform Rule	02/08/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3113423	CAT MAPLETON /MAPLETON	Revised Total Coliform Rule	02/08/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3113423	CAT MAPLETON /MAPLETON	Revised Total Coliform Rule	02/08/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3020008	CATERPILLAR DEMONSTRATION AREA	Revised Total Coliform Rule	07/08/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3020008	CATERPILLAR DEMONSTRATION AREA	Revised Total Coliform Rule	07/08/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3020008	CATERPILLAR DEMONSTRATION AREA	Revised Total Coliform Rule	07/08/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3126417	CENTRAL HIGH SCHOOL	Revised Total Coliform Rule	07/07/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3126417	CENTRAL HIGH SCHOOL	Revised Total Coliform Rule	07/07/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3126417	CENTRAL HIGH SCHOOL	Revised Total Coliform Rule	07/07/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3126417	CENTRAL HIGH SCHOOL	Revised Total Coliform Rule	07/07/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3152629	CHS ANNAWAN	Revised Total Coliform Rule	06/16/2022	Monitoring, Additional Routine (RTCR)

Revised Total Coliform Rule	IL3152629	CHS ANNAWAN	Revised Total Coliform Rule	06/16/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3152629	CHS ANNAWAN	Revised Total Coliform Rule	06/16/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3141184	CORN BELT ENERGY CORP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3141184	CORN BELT ENERGY CORP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3029207	LISBON GRADE SCHOOL	Revised Total Coliform Rule	04/27/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3029207	LISBON GRADE SCHOOL	Revised Total Coliform Rule	04/27/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3029207	LISBON GRADE SCHOOL	Revised Total Coliform Rule	04/27/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3154633	LUTHERAN GENERAL HOSPITAL	Revised Total Coliform Rule	03/14/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3154633	LUTHERAN GENERAL HOSPITAL	Revised Total Coliform Rule	03/14/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3162297	MEADOW LANE SCHOOL	Revised Total Coliform Rule	08/08/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3162297	MEADOW LANE SCHOOL	Revised Total Coliform Rule	08/08/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3151670	PIONEER HI-BRED INTL RESEARCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3151670	PIONEER HI-BRED INTL RESEARCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3151670	PIONEER HI-BRED INTL RESEARCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3151670	PIONEER HI-BRED INTL RESEARCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3113985	RIVERDALE SCHOOL DISTRICT #100	Revised Total Coliform Rule	08/25/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3113985	RIVERDALE SCHOOL DISTRICT #100	Revised Total Coliform Rule	08/25/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3113985	RIVERDALE SCHOOL DISTRICT #100	Revised Total Coliform Rule	08/25/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3079467	ROAD RANGER 132	Revised Total Coliform Rule	08/16/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3079467	ROAD RANGER 132	Revised Total Coliform Rule	08/16/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3079467	ROAD RANGER 132	Revised Total Coliform Rule	08/16/2022	Monitoring, Additional Routine (RTCR)
Revised Total Coliform Rule	IL3005413	ROOKS CREEK ELEMENTARY SCHOOL	Revised Total Coliform Rule	05/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3005413	ROOKS CREEK ELEMENTARY SCHOOL	Revised Total Coliform Rule	05/05/2022	Monitoring, Routine (RTCR)

Revised Total Coliform Rule	IL3005413	ROOKS CREEK ELEMENTARY SCHOOL	Revised Total Coliform Rule	05/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3005413	ROOKS CREEK ELEMENTARY SCHOOL	Revised Total Coliform Rule	05/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3046318	TPG PRESSURE, INC.	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3046318	TPG PRESSURE, INC.	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3046318	TPG PRESSURE, INC.	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3155606	U OF I CHICAGO MEDICAL CENTER	Revised Total Coliform Rule	07/25/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3155606	U OF I CHICAGO MEDICAL CENTER	Revised Total Coliform Rule	07/25/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3131524	VAN DRUNEN FARMS	Revised Total Coliform Rule		Maximum Contaminant Level Violation, E. coli (RTCR)
Revised Total Coliform Rule	IL3086850	WEST OAK MIDDLE SCHOOL	Revised Total Coliform Rule	04/05/2022	Monitoring, Routine (RTCR)
Revised Total Coliform Rule	IL3086850	WEST OAK MIDDLE SCHOOL	Revised Total Coliform Rule	04/05/2022	Monitoring, Routine (RTCR)
Simazine	IL3156471	PCS PHOSPHATE	Simazine	08/05/2022	Monitoring, Regular
Simazine	IL3156471	PCS PHOSPHATE	Simazine	08/05/2022	Monitoring, Regular
Stage 1 Disinfectants and Disinfection Byproducts Rule	IL3109900	CHRIST MISSION LUTHERAN CHURCH	Stage 1 Disinfectants and Disinfection Byproducts Rule	05/11/2022	Treatment Technique No Certif. Operator
Stage 1 Disinfectants and Disinfection Byproducts Rule	IL3109900	CHRIST MISSION LUTHERAN CHURCH	Stage 1 Disinfectants and Disinfection Byproducts Rule	05/11/2022	Treatment Technique No Certif. Operator

Stage 1 Disinfectants and Disinfection Byproducts Rule	IL3082818	FRANCISCAN SISTERS OF THE SACRED HEART	Stage 1 Disinfectants and Disinfection Byproducts Rule		Treatment Technique No Certif. Operator
Stage 1 Disinfectants and Disinfection Byproducts Rule	IL3108704	GATEWAY FOUNDATION	Stage 1 Disinfectants and Disinfection Byproducts Rule		Treatment Technique No Certif. Operator
Stage 1 Disinfectants and Disinfection Byproducts Rule	IL3002188	GAVIN CENTRAL ELEMENTARY	Stage 1 Disinfectants and Disinfection Byproducts Rule		Treatment Technique No Certif. Operator
TTHM	IL3008342	HARDING GRADE SCHOOL	TTHM	05/17/2022	Monitoring and Reporting (DBP)
TTHM	IL3008342	HARDING GRADE SCHOOL	TTHM	08/08/2022	Monitoring and Reporting (DBP)
TTHM	IL3008342	HARDING GRADE SCHOOL	TTHM	08/08/2022	Monitoring and Reporting (DBP)
TTHM	IL3154633	LUTHERAN GENERAL HOSPITAL	TTHM	04/26/2022	Monitoring and Reporting (DBP)
TTHM	IL3154633	LUTHERAN GENERAL HOSPITAL	TTHM	04/26/2022	Monitoring and Reporting (DBP)
TTHM	IL3155804	MARIANJOY REHAB HOSPITAL	TTHM		Monitoring and Reporting (DBP)
TTHM	IL3155804	MARIANJOY REHAB HOSPITAL	TTHM		Monitoring and Reporting (DBP)
TTHM	IL3155804	MARIANJOY REHAB HOSPITAL	TTHM		Monitoring and Reporting (DBP)
TTHM	IL3155804	MARIANJOY REHAB HOSPITAL	TTHM		Monitoring and Reporting (DBP)

Appendix F
Illinois EPA 2022 Annual Compliance Report
Violations Sorted by NTNCWS

From U.S. EPA's CDX Reporting Services database

PWS ID	PWS Name	Contaminant Name	Resolved Date	Violation Type Description
IL3051250	1ST CHURCH OF THE OPEN BIBLE	Lead and Copper Rule	09/06/2022	Lead Consumer Notice
IL3051250	1ST CHURCH OF THE OPEN BIBLE	Lead and Copper Rule	09/06/2022	Lead Consumer Notice
IL3029389	325 S ROUTE 31 LLC	Lead and Copper Rule		Lead Consumer Notice
IL3029389	325 S ROUTE 31 LLC	Lead and Copper Rule		Lead Consumer Notice
IL3148270	AG VIEW FS INC.	Arsenic		Monitoring, Regular
IL3148270	AG VIEW FS INC.	Arsenic		Monitoring, Regular
IL3158717	ALLOY SPECIALTIES (10500312)	1,2-DIBROMO-3-CHLOROPROPANE	08/24/2022	Monitoring, Regular
IL3158717	ALLOY SPECIALTIES (10500312)	1,2-DIBROMO-3-CHLOROPROPANE	08/24/2022	Monitoring, Regular
IL3158717	ALLOY SPECIALTIES (10500312)	Lead and Copper Rule	08/12/2022	Lead Consumer Notice
IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Lead and Copper Rule	06/30/2022	Initial, Follow-up, or Routine Source Water M/R
IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Lead and Copper Rule	06/30/2022	Initial, Follow-up, or Routine Source Water M/R
IL3113589	AMEREN-CILCO-EASTERN SERV CTR	Lead and Copper Rule	06/30/2022	Initial, Follow-up, or Routine Source Water M/R

IL3113589	AMEREN-CILCO- EASTERN SERV CTR	Lead and Copper Rule	07/19/2022	Lead Consumer Notice
IL3113589	AMEREN-CILCO- EASTERN SERV CTR	Lead and Copper Rule	07/19/2022	Lead Consumer Notice
IL3113589	AMEREN-CILCO- EASTERN SERV CTR	Lead and Copper Rule	07/19/2022	Lead Consumer Notice
IL3113589	AMEREN-CILCO- EASTERN SERV CTR	Public Notice	09/07/2022	Public Notification Violation for NPDWR Violation
IL3113589	AMEREN-CILCO- EASTERN SERV CTR	Public Notice	09/07/2022	Public Notification Violation for NPDWR Violation
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R

IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3147728	AMERICAN PRECISION ELCTRONICS	Lead and Copper Rule	08/24/2022	Follow-up Or Routine LCR Tap M/R
IL3152223	APACHI DAY CAMP	Lead and Copper Rule		Lead Consumer Notice
IL3152223	APACHI DAY CAMP	Lead and Copper Rule		Lead Consumer Notice
IL3086454	AQUA PLAZA	Lead and Copper Rule	05/10/2022	Lead Consumer Notice
IL3086454	AQUA PLAZA	Lead and Copper Rule	05/10/2022	Lead Consumer Notice
IL3086454	AQUA PLAZA	Lead and Copper Rule	05/10/2022	Lead Consumer Notice
IL3112367	BANYAN TREATMENT CENTER	Lead and Copper Rule	09/01/2022	Follow-up Or Routine LCR Tap M/R
IL3112367	BANYAN TREATMENT CENTER	Lead and Copper Rule	09/01/2022	Follow-up Or Routine LCR Tap M/R

IL3112367	BANYAN TREATMENT CENTER	Lead and Copper Rule	09/01/2022	Follow-up Or Routine LCR Tap M/R
IL3148742	BARRINGTON METHODIST CHURCH (148742)	Lead and Copper Rule		Lead Consumer Notice
IL3148742	BARRINGTON METHODIST CHURCH (148742)	Lead and Copper Rule		Lead Consumer Notice
IL3018556	BATTERY BUILDERS	Lead and Copper Rule	08/30/2022	Follow-up Or Routine LCR Tap M/R
IL3018556	BATTERY BUILDERS	Lead and Copper Rule	08/30/2022	Follow-up Or Routine LCR Tap M/R
IL3018556	BATTERY BUILDERS	Lead and Copper Rule	08/30/2022	Follow-up Or Routine LCR Tap M/R
IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Additional Routine (RTCR)
IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Additional Routine (RTCR)
IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Additional Routine (RTCR)
IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule		Monitoring, Additional Routine (RTCR)
IL3047035	BEREAN BAPTIST CHURCH	Revised Total Coliform Rule		Monitoring, Additional Routine (RTCR)
IL3162313	BRANDT INDUSTRIES USA LTD	Revised Total Coliform Rule	07/25/2022	Monitoring, Routine (RTCR)
IL3039735	CARMEL MONTESSORI ACADEMY	1,1,1-Trichloroethane	05/25/2022	Monitoring, Regular
IL3039735	CARMEL MONTESSORI ACADEMY	1,1,1-Trichloroethane	05/25/2022	Monitoring, Regular
IL3039735	CARMEL MONTESSORI ACADEMY	1,1,1-Trichloroethane	05/25/2022	Monitoring, Regular

IL3039735	CARMEL MONTESSORI ACADEMY	1,1,1-Trichloroethane	05/25/2022	Monitoring, Regular
IL3039735	CARMEL MONTESSORI ACADEMY	Lead and Copper Rule	09/02/2022	Lead Consumer Notice
IL3039735	CARMEL MONTESSORI ACADEMY	Lead and Copper Rule	09/02/2022	Lead Consumer Notice
IL3039735	CARMEL MONTESSORI ACADEMY	Lead and Copper Rule	09/02/2022	Lead Consumer Notice
IL3039735	CARMEL MONTESSORI ACADEMY	Public Notice		Public Notification Violation for NPDWR Violation
IL3113423	CAT MAPLETON /MAPLETON	Revised Total Coliform Rule	02/08/2022	Monitoring, Routine (RTCR)
IL3113423	CAT MAPLETON /MAPLETON	Revised Total Coliform Rule	02/08/2022	Monitoring, Routine (RTCR)
IL3113423	CAT MAPLETON /MAPLETON	Revised Total Coliform Rule	02/08/2022	Monitoring, Routine (RTCR)
IL3113852	CAT MOSSVILLE	Public Notice		Public Notification Violation for NPDWR Violation
IL3117895	CAT TECH CENTER	Lead and Copper Rule		Lead Consumer Notice
IL3117895	CAT TECH CENTER	Public Notice		Public Notification Violation for NPDWR Violation
IL3020008	CATERPILLAR DEMONSTRATION AREA	Revised Total Coliform Rule	07/08/2022	Monitoring, Additional Routine (RTCR)
IL3020008	CATERPILLAR DEMONSTRATION AREA	Revised Total Coliform Rule	07/08/2022	Monitoring, Additional Routine (RTCR)
IL3020008	CATERPILLAR DEMONSTRATION AREA	Revised Total Coliform Rule	07/08/2022	Monitoring, Additional Routine (RTCR)
IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular

IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular
IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular
IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular
IL3147801	CBRE WEST PLAZA	1,1,1-Trichloroethane	09/09/2022	Monitoring, Regular
IL3147801	CBRE WEST PLAZA	Public Notice		Public Notification Violation for NPDWR Violation
IL3161240	CCI MANUFACTURING	Lead and Copper Rule	03/10/2022	Lead Consumer Notice
IL3126417	CENTRAL HIGH SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3126417	CENTRAL HIGH SCHOOL	Revised Total Coliform Rule	07/07/2022	Monitoring, Routine (RTCR)
IL3126417	CENTRAL HIGH SCHOOL	Revised Total Coliform Rule	07/07/2022	Monitoring, Routine (RTCR)
IL3126417	CENTRAL HIGH SCHOOL	Revised Total Coliform Rule	07/07/2022	Monitoring, Routine (RTCR)
IL3126417	CENTRAL HIGH SCHOOL	Revised Total Coliform Rule	07/07/2022	Monitoring, Routine (RTCR)
IL3067538	CENTRAL MIDDLE SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3109900	CHRIST MISSION LUTHERAN CHURCH	Stage 1 Disinfectants and Disinfection Byproducts Rule	05/11/2022	Treatment Technique No Certif. Operator
IL3109900	CHRIST MISSION LUTHERAN CHURCH	Stage 1 Disinfectants and Disinfection Byproducts Rule	05/11/2022	Treatment Technique No Certif. Operator
IL3152629	CHS ANNAWAN	Revised Total Coliform Rule	06/16/2022	Monitoring, Additional Routine (RTCR)

IL3152629	CHS ANNAWAN	Revised Total Coliform Rule	06/16/2022	Monitoring, Additional Routine (RTCR)
IL3152629	CHS ANNAWAN	Revised Total Coliform Rule	06/16/2022	Monitoring, Additional Routine (RTCR)
IL3088518	COG HILL COUNTRY CLUB	1,1,1-Trichloroethane	08/05/2022	Monitoring, Regular
IL3088518	COG HILL COUNTRY CLUB	1,1,1-Trichloroethane	08/05/2022	Monitoring, Regular
IL3088518	COG HILL COUNTRY CLUB	1,1,1-Trichloroethane	08/05/2022	Monitoring, Regular
IL3088518	COG HILL COUNTRY CLUB	1,1,1-Trichloroethane	08/05/2022	Monitoring, Regular
IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
IL3088518	COG HILL COUNTRY CLUB	1,2-DIBROMO-3-CHLOROPROPANE		Monitoring, Regular
IL3088518	COG HILL COUNTRY CLUB	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3088518	COG HILL COUNTRY CLUB	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3088518	COG HILL COUNTRY CLUB	Public Notice	08/20/2022	Public Notification Violation for NPDWR Violation
IL3088518	COG HILL COUNTRY CLUB	Public Notice	08/20/2022	Public Notification Violation for NPDWR Violation

IL3088518	COG HILL COUNTRY CLUB	Public Notice	08/20/2022	Public Notification Violation for NPDWR Violation
IL3088518	COG HILL COUNTRY CLUB	Public Notice	08/20/2022	Public Notification Violation for NPDWR Violation
IL3006882	COMMONWEALTH EDISON COMPANY	Lead and Copper Rule	01/05/2022	Lead Consumer Notice
IL3006882	COMMONWEALTH EDISON COMPANY	Lead and Copper Rule	01/05/2022	Lead Consumer Notice
IL3141184	CORN BELT ENERGY CORP	Arsenic		Maximum Contaminant Level Violation, Average
IL3141184	CORN BELT ENERGY CORP	Arsenic		Maximum Contaminant Level Violation, Average
IL3141184	CORN BELT ENERGY CORP	Arsenic		Maximum Contaminant Level Violation, Average
IL3141184	CORN BELT ENERGY CORP	Arsenic		Monitoring, Regular
IL3141184	CORN BELT ENERGY CORP	Arsenic		Monitoring, Regular
IL3141184	CORN BELT ENERGY CORP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3141184	CORN BELT ENERGY CORP	Revised Total Coliform Rule		Monitoring, Routine (RTCR)
IL3147652	CORNERSTONE CHRISTIAN ACADEMY	Chlorine		Monitoring and Reporting (DBP)
IL3147652	CORNERSTONE CHRISTIAN ACADEMY	Chlorine		Monitoring and Reporting (DBP)
IL3147652	CORNERSTONE CHRISTIAN ACADEMY	Chlorine		Monitoring and Reporting (DBP)
IL3084715	COUNTRYSIDE SCHOOL	Lead and Copper Rule		Lead Consumer Notice

IL3057232	CRYSTAL LAKE MONTESSORI	Lead and Copper Rule	05/03/2022	Lead Consumer Notice
IL3057232	CRYSTAL LAKE MONTESSORI	Lead and Copper Rule	05/03/2022	Lead Consumer Notice
IL3057232	CRYSTAL LAKE MONTESSORI	Lead and Copper Rule	05/03/2022	Lead Consumer Notice
IL3005298	DONOVAN GRADE SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3152603	EDP RENEWABLES	1,1,1-Trichloroethane	06/21/2022	Monitoring, Regular
IL3152603	EDP RENEWABLES	1,1,1-Trichloroethane	06/21/2022	Monitoring, Regular
IL3152603	EDP RENEWABLES	1,1,1-Trichloroethane	07/19/2022	Monitoring, Regular
IL3152603	EDP RENEWABLES	1,1,1-Trichloroethane	07/19/2022	Monitoring, Regular
IL3152603	EDP RENEWABLES	1,2-DIBROMO-3- CHLOROPROPANE		Monitoring, Regular
IL3152603	EDP RENEWABLES	1,2-DIBROMO-3- CHLOROPROPANE		Monitoring, Regular
IL3152603	EDP RENEWABLES	1,2-DIBROMO-3- CHLOROPROPANE		Monitoring, Regular
IL3152603	EDP RENEWABLES	1,2-DIBROMO-3- CHLOROPROPANE		Monitoring, Regular
IL3004572	EISENHOWER ACADEMY	Lead and Copper Rule	05/13/2022	Lead Consumer Notice
IL3004572	EISENHOWER ACADEMY	Lead and Copper Rule	05/13/2022	Lead Consumer Notice
IL3004572	EISENHOWER ACADEMY	Lead and Copper Rule	05/13/2022	Lead Consumer Notice

IL3052894	EMERALD POLYMER ADDITIVES, LLC	Nitrate	08/09/2022	Maximum Contaminant Level Violation, Single Sample
IL3052894	EMERALD POLYMER ADDITIVES, LLC	Nitrate	08/09/2022	Maximum Contaminant Level Violation, Single Sample
IL3102939	EMMONS GRADE SCHOOL	1,1,1-Trichloroethane	05/23/2022	Monitoring, Regular
IL3102939	EMMONS GRADE SCHOOL	1,1,1-Trichloroethane	05/23/2022	Monitoring, Regular
IL3102939	EMMONS GRADE SCHOOL	1,1,1-Trichloroethane	05/23/2022	Monitoring, Regular
IL3102939	EMMONS GRADE SCHOOL	Lead and Copper Rule	09/28/2022	Follow-up Or Routine LCR Tap M/R
IL3102939	EMMONS GRADE SCHOOL	Lead and Copper Rule	09/28/2022	Follow-up Or Routine LCR Tap M/R
IL3102939	EMMONS GRADE SCHOOL	Lead and Copper Rule	09/28/2022	Follow-up Or Routine LCR Tap M/R
IL3034314	EQUISTAR CHEMICALS LP	Lead and Copper Rule		Lead Consumer Notice
IL3155374	EVEREST ACADEMY	Public Notice		Public Notification Violation for NPDWR Violation
IL3055483	EXCEL FOUNDRY & MACHINE	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
IL3055483	EXCEL FOUNDRY & MACHINE	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
IL3137158	FCA MANUFACTURING COMPANY	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation
IL3137158	FCA MANUFACTURING COMPANY	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation
IL3137158	FCA MANUFACTURING COMPANY	Public Notice	08/24/2022	Public Notification Violation for NPDWR Violation

IL3139337	FIBER TEX-NON WOVEN SOLUTIONS	Lead and Copper Rule	02/03/2022	Lead Consumer Notice
IL3139337	FIBER TEX-NON WOVEN SOLUTIONS	Lead and Copper Rule	02/03/2022	Lead Consumer Notice
IL3139337	FIBER TEX-NON WOVEN SOLUTIONS	Public Notice		Public Notification Violation for NPDWR Violation
IL3139337	FIBER TEX-NON WOVEN SOLUTIONS	Public Notice		Public Notification Violation for NPDWR Violation
IL3118646	FLOWER GARDEN ANNEX	Lead and Copper Rule		Lead Consumer Notice
IL3155416	FOX METRO WATER RECLAMATION DISTRICT	Public Notice	08/31/2022	Public Notification Violation for NPDWR Violation
IL3155416	FOX METRO WATER RECLAMATION DISTRICT	Public Notice	08/31/2022	Public Notification Violation for NPDWR Violation
IL3133538	FOX VALLEY YMCA & PRESCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3082818	FRANCISCAN SISTERS OF THE SACRED HEART	Stage 1 Disinfectants and Disinfection Byproducts Rule		Treatment Technique No Certif. Operator
IL3108704	GATEWAY FOUNDATION	Lead and Copper Rule	04/29/2022	Lead Consumer Notice
IL3108704	GATEWAY FOUNDATION	Lead and Copper Rule	04/29/2022	Lead Consumer Notice
IL3108704	GATEWAY FOUNDATION	Lead and Copper Rule	04/29/2022	Lead Consumer Notice
IL3108704	GATEWAY FOUNDATION	Stage 1 Disinfectants and Disinfection Byproducts Rule		Treatment Technique No Certif. Operator
IL3002188	GAVIN CENTRAL ELEMENTARY	Lead and Copper Rule		Lead Consumer Notice
IL3002188	GAVIN CENTRAL ELEMENTARY	Lead and Copper Rule		Lead Consumer Notice

IL3002188	GAVIN CENTRAL ELEMENTARY	Stage 1 Disinfectants and Disinfection Byproducts Rule		Treatment Technique No Certif. Operator
IL3130302	GOOD SHEPHERD HOSPITAL	Lead and Copper Rule		Lead Consumer Notice
IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3037705	GRAND PRAIRIE TRANSIT	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3019638	GRASS LAKE SCHOOL	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
IL3019638	GRASS LAKE SCHOOL	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
IL3019638	GRASS LAKE SCHOOL	Lead and Copper Rule	05/12/2022	Lead Consumer Notice
IL3155291	H B FULLER	E. COLI		Monitoring, Source Water (GWR)
IL3155291	H B FULLER	E. COLI		Monitoring, Source Water (GWR)
IL3155291	H B FULLER	E. COLI		Monitoring, Source Water (GWR)

IL3008342	HARDING GRADE SCHOOL	Di(2-ethylhexyl) phthalate	05/17/2022	Monitoring, Regular
IL3008342	HARDING GRADE SCHOOL	Di(2-ethylhexyl) phthalate	05/17/2022	Monitoring, Regular
IL3008342	HARDING GRADE SCHOOL	Di(2-ethylhexyl) phthalate	08/08/2022	Monitoring, Regular
IL3008342	HARDING GRADE SCHOOL	Di(2-ethylhexyl) phthalate	08/08/2022	Monitoring, Regular
IL3008342	HARDING GRADE SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
IL3008342	HARDING GRADE SCHOOL	TTHM	05/17/2022	Monitoring and Reporting (DBP)
IL3008342	HARDING GRADE SCHOOL	TTHM	08/08/2022	Monitoring and Reporting (DBP)
IL3008342	HARDING GRADE SCHOOL	TTHM	08/08/2022	Monitoring and Reporting (DBP)
IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R

IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
IL3123984	HILL FASTNER CORP	Lead and Copper Rule	08/20/2022	Follow-up Or Routine LCR Tap M/R
IL3042127	HONEYWELL INTERNATIONAL INC	1,1,1-Trichloroethane	05/12/2022	Monitoring, Regular
IL3042127	HONEYWELL INTERNATIONAL INC	1,1,1-Trichloroethane	05/12/2022	Monitoring, Regular
IL3042127	HONEYWELL INTERNATIONAL INC	1,1,1-Trichloroethane	05/12/2022	Monitoring, Regular
IL3042127	HONEYWELL INTERNATIONAL INC	1,1,1-Trichloroethane	05/12/2022	Monitoring, Regular
IL3113837	ILLINOIS CENTRAL	Lead and Copper Rule		Public Education
IL3037291	INDIAN KNOLL SCHOOL DIST 33	Lead and Copper Rule	04/25/2022	Lead Consumer Notice
IL3037291	INDIAN KNOLL SCHOOL DIST 33	Lead and Copper Rule	04/25/2022	Lead Consumer Notice
IL3153312	JARRETT PRAIRIE CENTER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
IL3153312	JARRETT PRAIRIE CENTER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
IL3153312	JARRETT PRAIRIE CENTER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
IL3053652	JBS CORPORATION	Lead and Copper Rule	06/02/2022	Lead Consumer Notice
IL3053652	JBS CORPORATION	Lead and Copper Rule	06/02/2022	Lead Consumer Notice
IL3053652	JBS CORPORATION	Public Notice	08/12/2022	Public Notification Violation for NPDWR Violation

IL3053652	JBS CORPORATION	Public Notice	08/12/2022	Public Notification Violation for NPDWR Violation
IL3153072	JEWEL WELLS SPRING GROVE	Lead and Copper Rule		Lead Consumer Notice
IL3153072	JEWEL WELLS SPRING GROVE	Lead and Copper Rule		Lead Consumer Notice
IL3130534	JIMMY JOHNS (PROSPECT CROSSING)	Lead and Copper Rule	05/04/2022	Lead Consumer Notice
IL3130534	JIMMY JOHNS (PROSPECT CROSSING)	Lead and Copper Rule	05/04/2022	Lead Consumer Notice
IL3130534	JIMMY JOHNS (PROSPECT CROSSING)	Lead and Copper Rule	05/04/2022	Lead Consumer Notice
IL3142604	JOHNS MANVILLE	Lead and Copper Rule		Lead Consumer Notice
IL3156836	JW MARRIOT HOTEL	Lead and Copper Rule	08/01/2022	Follow-up Or Routine LCR Tap M/R
IL3010702	KANELAND HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)
IL3010702	KANELAND HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)
IL3057240	KINDERCARE MCHENRY	Lead and Copper Rule	05/02/2022	Lead Consumer Notice
IL3057240	KINDERCARE MCHENRY	Lead and Copper Rule	05/02/2022	Lead Consumer Notice
IL3057240	KINDERCARE MCHENRY	Lead and Copper Rule	05/02/2022	Lead Consumer Notice
IL3034819	KONE INC	Lead and Copper Rule	02/21/2022	Lead Consumer Notice
IL3163097	LAUNCH ENRICHMENT L3C	1,1,1-Trichloroethane	09/07/2022	Monitoring, Regular

IL3163097	LAUNCH ENRICHMENT L3C	Lead and Copper Rule	09/15/2022	Initial Tap Sampling for Pb and Cu
IL3131045	LEICA BIOSYSTEMS	Lead and Copper Rule	06/01/2022	Lead Consumer Notice
IL3131045	LEICA BIOSYSTEMS	Lead and Copper Rule	06/01/2022	Lead Consumer Notice
IL3131045	LEICA BIOSYSTEMS	Lead and Copper Rule	06/01/2022	Lead Consumer Notice
IL3154724	LIFES LITTLE MIRACLES	Lead and Copper Rule	01/31/2022	Lead Consumer Notice
IL3067520	LILY LAKE GRADE SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3029207	LISBON GRADE SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
IL3029207	LISBON GRADE SCHOOL	Revised Total Coliform Rule	04/27/2022	Monitoring, Routine (RTCR)
IL3029207	LISBON GRADE SCHOOL	Revised Total Coliform Rule	04/27/2022	Monitoring, Routine (RTCR)
IL3029207	LISBON GRADE SCHOOL	Revised Total Coliform Rule	04/27/2022	Monitoring, Routine (RTCR)
IL3155085	LITTLE FUTURE'S CHILD CARE	Public Notice		Public Notification Violation for NPDWR Violation
IL3108688	LORADO TAFT DINING HALL	Lead and Copper Rule	07/13/2022	Follow-up Or Routine LCR Tap M/R
IL3108688	LORADO TAFT DINING HALL	Lead and Copper Rule	07/13/2022	Follow-up Or Routine LCR Tap M/R
IL3108688	LORADO TAFT DINING HALL	Lead and Copper Rule	07/13/2022	Follow-up Or Routine LCR Tap M/R
IL3108688	LORADO TAFT DINING HALL	Lead and Copper Rule	07/13/2022	Follow-up Or Routine LCR Tap M/R

IL3154633	LUTHERAN GENERAL HOSPITAL	Revised Total Coliform Rule	03/14/2022	Monitoring, Routine (RTCR)
IL3154633	LUTHERAN GENERAL HOSPITAL	Revised Total Coliform Rule	03/14/2022	Monitoring, Routine (RTCR)
IL3154633	LUTHERAN GENERAL HOSPITAL	TTHM	04/26/2022	Monitoring and Reporting (DBP)
IL3154633	LUTHERAN GENERAL HOSPITAL	TTHM	04/26/2022	Monitoring and Reporting (DBP)
IL3155804	MARIANJOY REHAB HOSPITAL	TTHM		Monitoring and Reporting (DBP)
IL3155804	MARIANJOY REHAB HOSPITAL	TTHM		Monitoring and Reporting (DBP)
IL3155804	MARIANJOY REHAB HOSPITAL	TTHM		Monitoring and Reporting (DBP)
IL3155804	MARIANJOY REHAB HOSPITAL	TTHM		Monitoring and Reporting (DBP)
IL3104216	MAT HOLDINGS	Lead and Copper Rule		Lead Consumer Notice
IL3162297	MEADOW LANE SCHOOL	Revised Total Coliform Rule	08/08/2022	Monitoring, Routine (RTCR)
IL3162297	MEADOW LANE SCHOOL	Revised Total Coliform Rule	08/08/2022	Monitoring, Routine (RTCR)
IL3076984	MIDLAND HIGH SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3076984	MIDLAND HIGH SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
IL3154666	MONROE CENTER SCHOOL - NEW WELL	Lead and Copper Rule		Lead Consumer Notice
IL3001578	MONROE CENTER SCHOOL - OLD WELL	Lead and Copper Rule		Lead Consumer Notice

IL3001578	MONROE CENTER SCHOOL - OLD WELL	Lead and Copper Rule		Lead Consumer Notice
IL3001578	MONROE CENTER SCHOOL - OLD WELL	Lead and Copper Rule		Lead Consumer Notice
IL3001578	MONROE CENTER SCHOOL - OLD WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3149823	MONTE CARLO PLAZA	Lead and Copper Rule	02/04/2022	Lead Consumer Notice
IL3149823	MONTE CARLO PLAZA	Public Notice		Public Notification Violation for NPDWR Violation
IL3089243	MONTEREY MUSHROOMS INC	Lead and Copper Rule	06/13/2022	Follow-up Or Routine LCR Tap M/R
IL3089243	MONTEREY MUSHROOMS INC	Lead and Copper Rule	06/13/2022	Follow-up Or Routine LCR Tap M/R
IL3089243	MONTEREY MUSHROOMS INC	Lead and Copper Rule	06/13/2022	Follow-up Or Routine LCR Tap M/R
IL3024281	MOTHER TERESA CATHOLIC ACADEMY	Lead and Copper Rule	06/15/2022	Follow-up Or Routine LCR Tap M/R
IL3024281	MOTHER TERESA CATHOLIC ACADEMY	Lead and Copper Rule	06/15/2022	Follow-up Or Routine LCR Tap M/R
IL3024281	MOTHER TERESA CATHOLIC ACADEMY	Lead and Copper Rule	06/15/2022	Follow-up Or Routine LCR Tap M/R
IL3030700	NETTLE CREEK SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3030700	NETTLE CREEK SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3026922	NEWPORT SCHOOL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3148619	NORTH BOONE HIGH SCHOOL	Lead and Copper Rule	06/29/2022	Follow-up Or Routine LCR Tap M/R
IL3148619	NORTH BOONE HIGH SCHOOL	Lead and Copper Rule	06/29/2022	Follow-up Or Routine LCR Tap M/R
IL3148619	NORTH BOONE HIGH SCHOOL	Lead and Copper Rule	06/29/2022	Follow-up Or Routine LCR Tap M/R
IL3091728	NORTH BOONE MIDDLE SCHOOL	Lead and Copper Rule	06/28/2022	Follow-up Or Routine LCR Tap M/R
IL3091728	NORTH BOONE MIDDLE SCHOOL	Lead and Copper Rule	06/28/2022	Follow-up Or Routine LCR Tap M/R
IL3091728	NORTH BOONE MIDDLE SCHOOL	Lead and Copper Rule	06/28/2022	Follow-up Or Routine LCR Tap M/R
IL3065383	NOURYON SURFACE CHEMISTRY LLC	Arsenic	04/19/2022	Monitoring, Regular
IL3065383	NOURYON SURFACE CHEMISTRY LLC	Arsenic	04/19/2022	Monitoring, Regular
IL3065383	NOURYON SURFACE CHEMISTRY LLC	Arsenic	04/19/2022	Monitoring, Regular
IL3065383	NOURYON SURFACE CHEMISTRY LLC	Arsenic	04/19/2022	Monitoring, Regular

IL3005611	OAKWOOD TWP HIGH SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3057844	OLYMPIA SCHOOL	Public Notice	05/02/2022	Public Notification Violation for NPDWR Violation
IL3057844	OLYMPIA SCHOOL	Public Notice	05/02/2022	Public Notification Violation for NPDWR Violation
IL3057844	OLYMPIA SCHOOL	Public Notice	05/02/2022	Public Notification Violation for NPDWR Violation
IL3027961	PARK CENTER OF KEMPER LAKES AVIANDS	Lead and Copper Rule		Lead Consumer Notice
IL3096453	PBC LINEAR	Lead and Copper Rule		Lead Consumer Notice
IL3156471	PCS PHOSPHATE	Simazine	08/05/2022	Monitoring, Regular
IL3156471	PCS PHOSPHATE	Simazine	08/05/2022	Monitoring, Regular
IL3155390	PEACEFUL PATHWAYS	Lead and Copper Rule	09/20/2022	Follow-up Or Routine LCR Tap M/R
IL3157933	PEARL VALLEY FARMS	Arsenic		Monitoring, Regular
IL3149963	PEARL VALLEY SPECIALTY EGG PRODUCTS	Arsenic		Monitoring, Regular
IL3139766	PEOTONE INTERMEDIATE CENTER	BHC-GAMMA	05/31/2022	Monitoring, Regular
IL3139766	PEOTONE INTERMEDIATE CENTER	BHC-GAMMA	05/31/2022	Monitoring, Regular
IL3139766	PEOTONE INTERMEDIATE CENTER	BHC-GAMMA	05/31/2022	Monitoring, Regular
IL3039792	PETER PAN DAY SCHOOL	Lead and Copper Rule		Lead Consumer Notice

IL3151670	PIONEER HI-BRED INTL RESEARCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
IL3151670	PIONEER HI-BRED INTL RESEARCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
IL3151670	PIONEER HI-BRED INTL RESEARCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
IL3151670	PIONEER HI-BRED INTL RESEARCH	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
IL3062398	PRAIRIE GROVE SCHOOL	Revised Total Coliform Rule	07/05/2022	Monitoring, Routine (RTCR)
IL3140228	PRAIRIE VIEW ELEMENTARY SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3005256	PRAIRIEVIEW JR. HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)
IL3005256	PRAIRIEVIEW JR. HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)
IL3005256	PRAIRIEVIEW JR. HIGH SCHOOL	Chlorine		Monitoring and Reporting (DBP)

IL3076398	PUTNAM COUNTY JR HIGH	Lead and Copper Rule	05/06/2022	Lead Consumer Notice
IL3076398	PUTNAM COUNTY JR HIGH	Lead and Copper Rule	05/06/2022	Lead Consumer Notice
IL3076398	PUTNAM COUNTY JR HIGH	Lead and Copper Rule	05/06/2022	Lead Consumer Notice
IL3076398	PUTNAM COUNTY JR HIGH	Public Notice		Public Notification Violation for NPDWR Violation
IL3139295	QUIKRETE COMPANIES	Lead and Copper Rule	08/05/2022	Follow-up Or Routine LCR Tap M/R
IL3139295	QUIKRETE COMPANIES	Lead and Copper Rule	08/05/2022	Follow-up Or Routine LCR Tap M/R
IL3139295	QUIKRETE COMPANIES	Lead and Copper Rule	08/05/2022	Follow-up Or Routine LCR Tap M/R
IL3139295	QUIKRETE COMPANIES	Lead and Copper Rule	08/05/2022	Follow-up Or Routine LCR Tap M/R
IL3055947	RANKIN SCHOOL DISTRICT NO 98	Lead and Copper Rule	06/06/2022	Follow-up Or Routine LCR Tap M/R
IL3055947	RANKIN SCHOOL DISTRICT NO 98	Lead and Copper Rule	06/06/2022	Follow-up Or Routine LCR Tap M/R
IL3055947	RANKIN SCHOOL DISTRICT NO 98	Lead and Copper Rule	06/06/2022	Follow-up Or Routine LCR Tap M/R
IL3055947	RANKIN SCHOOL DISTRICT NO 98	Lead and Copper Rule	06/06/2022	Follow-up Or Routine LCR Tap M/R
IL3111278	REICHHOLD CHEMICALS	Public Notice	08/23/2022	Public Notification Violation for NPDWR Violation
IL3142018	RIVER RIDGE SCHOOL	Heptachlor	08/05/2022	Monitoring, Regular
IL3142018	RIVER RIDGE SCHOOL	Heptachlor	08/05/2022	Monitoring, Regular

IL3113985	RIVERDALE SCHOOL DISTRICT #100	Chlorine		Monitoring and Reporting (DBP)
IL3113985	RIVERDALE SCHOOL DISTRICT #100	Chlorine		Monitoring and Reporting (DBP)
IL3113985	RIVERDALE SCHOOL DISTRICT #100	Revised Total Coliform Rule	08/25/2022	Monitoring, Routine (RTCR)
IL3113985	RIVERDALE SCHOOL DISTRICT #100	Revised Total Coliform Rule	08/25/2022	Monitoring, Routine (RTCR)
IL3113985	RIVERDALE SCHOOL DISTRICT #100	Revised Total Coliform Rule	08/25/2022	Monitoring, Routine (RTCR)
IL3079467	ROAD RANGER 132	Revised Total Coliform Rule	08/16/2022	Monitoring, Additional Routine (RTCR)
IL3079467	ROAD RANGER 132	Revised Total Coliform Rule	08/16/2022	Monitoring, Additional Routine (RTCR)
IL3079467	ROAD RANGER 132	Revised Total Coliform Rule	08/16/2022	Monitoring, Additional Routine (RTCR)
IL3086751	ROCKLAND OFFICE PLAZA	Lead and Copper Rule		Lead Consumer Notice
IL3005413	ROOKS CREEK ELEMENTARY SCHOOL	Revised Total Coliform Rule	05/05/2022	Monitoring, Routine (RTCR)
IL3005413	ROOKS CREEK ELEMENTARY SCHOOL	Revised Total Coliform Rule	05/05/2022	Monitoring, Routine (RTCR)
IL3005413	ROOKS CREEK ELEMENTARY SCHOOL	Revised Total Coliform Rule	05/05/2022	Monitoring, Routine (RTCR)
IL3005413	ROOKS CREEK ELEMENTARY SCHOOL	Revised Total Coliform Rule	05/05/2022	Monitoring, Routine (RTCR)
IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	02/25/2022	Follow-up Or Routine LCR Tap M/R
IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	02/25/2022	Follow-up Or Routine LCR Tap M/R

IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	02/25/2022	Follow-up Or Routine LCR Tap M/R
IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
IL3003145	SHERIDAN GRADE SCHOOL	Lead and Copper Rule	09/01/2022	Lead Consumer Notice
IL3090290	SHERRARD JR/SR HIGH SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
IL3141028	SHOPS OF KILDEER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
IL3141028	SHOPS OF KILDEER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
IL3141028	SHOPS OF KILDEER	Lead and Copper Rule	08/31/2022	Lead Consumer Notice
IL3135459	SOUTH BARRINGTON PARK DISTRICT	Lead and Copper Rule	01/31/2022	Lead Consumer Notice
IL3135459	SOUTH BARRINGTON PARK DISTRICT	Lead and Copper Rule	01/31/2022	Lead Consumer Notice
IL3155382	SPEICHER STORAGE	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3155382	SPEICHER STORAGE	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R

IL3131532	SPRING CREEK PLAZA/CORE SPRING GROVE LLC	Lead and Copper Rule		Lead Consumer Notice
IL3131532	SPRING CREEK PLAZA/CORE SPRING GROVE LLC	Lead and Copper Rule		Lead Consumer Notice
IL3131532	SPRING CREEK PLAZA/CORE SPRING GROVE LLC	Lead and Copper Rule		Lead Consumer Notice
IL3002931	SPRING GROVE ELEMENTARY SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3002931	SPRING GROVE ELEMENTARY SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3011486	ST BEDE SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3059584	ST PAULS LUTHERAN SCHOOL	Public Notice		Public Notification Violation for NPDWR Violation
IL3096966	ST RITAS SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3096966	ST RITAS SCHOOL	Lead and Copper Rule		Lead Consumer Notice
IL3047530	STATELINE FOUNDRIES	Lead and Copper Rule		Lead Consumer Notice
IL3019364	TAMARAK DAY CAMP	Public Notice		Public Notification Violation for NPDWR Violation
IL3112938	TAYLOR RIDGE ELEMENTARY SCHOOL	Lead and Copper Rule	04/25/2022	Lead Consumer Notice
IL3112938	TAYLOR RIDGE ELEMENTARY SCHOOL	Lead and Copper Rule	04/25/2022	Lead Consumer Notice
IL3050716	TITAN TIRE CORPORATION OF FREEPORT	Antimony, Total	09/06/2022	Monitoring, Regular
IL3050716	TITAN TIRE CORPORATION OF FREEPORT	Antimony, Total	09/06/2022	Monitoring, Regular

IL3050716	TITAN TIRE CORPORATION OF FREEPORT	Antimony, Total	09/06/2022	Monitoring, Regular
IL3050716	TITAN TIRE CORPORATION OF FREEPORT	Antimony, Total	09/06/2022	Monitoring, Regular
IL3131060	TOP DIE CASTING CO	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3131060	TOP DIE CASTING CO	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3046318	TPG PRESSURE, INC.	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
IL3046318	TPG PRESSURE, INC.	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
IL3046318	TPG PRESSURE, INC.	Revised Total Coliform Rule	07/27/2022	Monitoring, Routine (RTCR)
IL3153924	TPG PRESSURE, INC. - WEST WELL	Lead and Copper Rule	02/21/2022	Lead Consumer Notice
IL3153924	TPG PRESSURE, INC. - WEST WELL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3153924	TPG PRESSURE, INC. - WEST WELL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3153924	TPG PRESSURE, INC. - WEST WELL	Lead and Copper Rule		Follow-up Or Routine LCR Tap M/R
IL3153924	TPG PRESSURE, INC. - WEST WELL	Public Notice		Public Notification Violation for NPDWR Violation
IL3022061	TRINITY LUTHERAN SCHOOL	Lead and Copper Rule	08/03/2022	Follow-up Or Routine LCR Tap M/R
IL3022061	TRINITY LUTHERAN SCHOOL	Lead and Copper Rule	08/03/2022	Follow-up Or Routine LCR Tap M/R
IL3022061	TRINITY LUTHERAN SCHOOL	Lead and Copper Rule	08/03/2022	Follow-up Or Routine LCR Tap M/R

IL3155606	U OF I CHICAGO MEDICAL CENTER	Chlorine		Monitoring and Reporting (DBP)
IL3155606	U OF I CHICAGO MEDICAL CENTER	Lead and Copper Rule		Lead Consumer Notice
IL3155606	U OF I CHICAGO MEDICAL CENTER	Public Notice		Public Notification Violation for NPDWR Violation
IL3155606	U OF I CHICAGO MEDICAL CENTER	Revised Total Coliform Rule	07/25/2022	Monitoring, Routine (RTCR)
IL3155606	U OF I CHICAGO MEDICAL CENTER	Revised Total Coliform Rule	07/25/2022	Monitoring, Routine (RTCR)
IL3131524	VAN DRUNEN FARMS	Lead and Copper Rule	07/19/2022	Lead Consumer Notice
IL3131524	VAN DRUNEN FARMS	Lead and Copper Rule	07/19/2022	Lead Consumer Notice
IL3131524	VAN DRUNEN FARMS	Revised Total Coliform Rule		Maximum Contaminant Level Violation, E. coli (RTCR)
IL3129619	WASTE MANAGEMENT NORTH	Lead and Copper Rule	05/09/2022	Lead Consumer Notice
IL3129619	WASTE MANAGEMENT NORTH	Lead and Copper Rule	05/09/2022	Lead Consumer Notice
IL3129619	WASTE MANAGEMENT NORTH	Lead and Copper Rule	05/09/2022	Lead Consumer Notice
IL3137232	WEDRON SILICA SAND COMPANY	CYANIDE	04/18/2022	Monitoring, Regular
IL3137232	WEDRON SILICA SAND COMPANY	CYANIDE	04/18/2022	Monitoring, Regular
IL3137232	WEDRON SILICA SAND COMPANY	CYANIDE	04/18/2022	Monitoring, Regular
IL3137232	WEDRON SILICA SAND COMPANY	Lead and Copper Rule	06/27/2022	Follow-up Or Routine LCR Tap M/R

IL3137232	WEDRON SILICA SAND COMPANY	Lead and Copper Rule	06/27/2022	Follow-up Or Routine LCR Tap M/R
IL3158873	WEDRON SILICA SCREENHOUSE	Lead and Copper Rule	08/10/2022	Lead Consumer Notice
IL3086850	WEST OAK MIDDLE SCHOOL	Revised Total Coliform Rule	04/05/2022	Monitoring, Routine (RTCR)
IL3086850	WEST OAK MIDDLE SCHOOL	Revised Total Coliform Rule	04/05/2022	Monitoring, Routine (RTCR)
IL3159780	WINNEBAGO COUNTY ROCK 39	Lead and Copper Rule	09/02/2022	Lead Consumer Notice
IL3159780	WINNEBAGO COUNTY ROCK 39	Lead and Copper Rule	09/02/2022	Lead Consumer Notice

Appendix G
Illinois EPA 2022 Annual Compliance Report
Table of FY22 Regional/State Measures

From U.S. EPA's CDX Reporting Services database

Description	Status/Baseline	State Target
National Measures		
EPA and the State will work collaboratively to implement the national HQ Office of Water measure and national compliance initiative (NCI) to reduce by 25%, by the end of FY 2022, the number of CWSs that are out of compliance with health-based standards. (Total count of community water systems out of compliance with health-based standards)	USEPA evaluates quarterly <i>46 (FY21 commitment)</i>	FY 2022 target: (57) CY22 0 Continuous 10 Intermediate and 47 New
Number of community water systems still in noncompliance with health-based standards (continuous violations) since September 30, 2017. (Tracks progress against 2017 baseline)	USEPA evaluates quarterly <i>5 (FY21 commitment)</i>	2022 : There are no systems still in noncompliance with health-based standards (continuous violations) since September 30, 2017
Regional Measures		
% of CWS systems meeting all health-based standards		2022-: 96.8%
% of population served by CWS meeting all health-based standards		2022 99.2%
% of CWS and NCWS with a Sanitary Survey w/in the past 3 or 5 yrs. as required	Updated by Region 5 in April and October	2022 CWS = 77.31% NTNCWS = 94.67% TNCWS = 99.59%
Percent of CWS where risk to public health is minimized through source water protection	R5 SWP Program measure	2022 target: % CWS =50

Percent of population served by CWS where risk to public health is minimized through source water protection	R5 SWP Program measure	2022 % population served by CWS: 73%
All Rule Violation Completeness Reporting <i>Rule violations IDPH is unable to fully report:</i> <ul style="list-style-type: none"> • Nitrate • Disinfection By-Products (DBPs) • Revised Total Coliform Rule (RTC) 		2022 IDPH target: 100% reporting IDPH fully implemented Nitrate and RTCR rules including reporting of violations in FY 2022. DPBs was fully implemented with the exception of Chlorine Residual monitoring/reporting violations which began on April 1, 2022.
Regional Enforcement Measures		
The number of priority systems (on ETT list) that will be addressed with a formal enforcement action or Return to Compliance (RTC)	July ETT list (starting point for the FY). <i>CWS: 6</i> <i>NTNCWS: 50</i> <i>TNCWS: 378</i>	2022: 7 CWS 2 NTNCWS and 19 TNCWS on priority status.
For priority systems (ETT list), correct violations not properly linked to Enforcement actions (data clean- up effort)	July ETT list (starting point for the FY) of violations not properly linked to Enforcement Actions <i>CWS: 6</i> <i>NTNCWS: 50</i> <i>TNCWS: 378</i>	2022: CWS: 4 NTNCWS: 30 TNCWS: 250
Shared Goals Measures		
1. % of NTNCWSs meeting all health-based standards	Shared Goals: Updated annually in April by Region	2022: ≥95% 96.9%

	5	
2. % of TNCWSs meeting all health-based standards	Shared Goals: Updated annually in April by Region 5	2022: \geq95% 92.3%
3. % of population served by CWSs with significant/ major monitoring violations	Shared Goals: Updated annually in April by Region 5	2022: <5% 28.6%
4. % of CWS systems with significant/major monitoring violations (includes LCR Type 66 violations)	Shared Goals: Updated annually in April by Region 5	2022: <10% 12.1%
5. % of NTNCWSs with significant/major monitoring violations for acute health risks	Shared Goals: Updated annually in April by Region 5	2022: <5% 9.4%
6. % of NTNCWSs with significant/major monitoring violations for chronic health risks	Shared Goals: Updated annually in April by Region 5	2022: <10% 41.9%
7. % of TNCWSs with significant/major monitoring violations	Shared Goals: Updated annually in April by Region 5	2022: <10% 12.4%