

NPDES Permit No. IL0053457
Notice No. ALD:07071301.bah

Public Notice Beginning Date: **June 3, 2011**

Public Notice Ending Date: **July 5, 2011**

National Pollutant Discharge Elimination System (NPDES)
Permit Program

PUBLIC NOTICE/FACT SHEET
of
Draft Modified NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois EPA
Division of Water Pollution Control
Permit Section
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276
217/782-0610

Name and Address of Discharger:

City of Crystal Lake
Post Office Box 597
Crystal Lake, Illinois 60014

Name and Address of Facility:

Crystal Lake W.W.T.P. #3
400 Knaack Boulevard
Crystal Lake, Illinois
(McHenry County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES Permit to discharge into the waters of the state and has prepared a draft Permit and associated fact sheet for the above named discharger. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. All comments on the draft Permit and requests for hearing must be received by the IEPA by U.S. Mail, carrier mail or hand delivered by the Public Notice Ending Date. Interested persons are invited to submit written comments on the draft Permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the Permit applicant. The NPDES Permit and notice numbers must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft Permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicates a significant degree of public interest in the draft Permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final Permit is issued. For further information, please call Amy Dragovich at 217/782-0610.

The following water quality and effluent standards and limitations were applied to the discharge:

Title 35: Environmental Protection, Subtitle C: Water Pollution, Chapter I: Pollution Control Board and the Clean Water Act were applied in determining the applicable standards, limitations and conditions contained in the draft Permit.

The applicant is engaged in treating domestic and industrial wastewater for the Crystal Lake W.W.T.P. #3.

The length of the Permit is approximately 5 years.

The main discharge number is 001. The seven day once in ten year low flow (7Q10) of the receiving stream, unnamed tributary of Sleepy Hollow Creek, is 0 cfs.

The design average flow (DAF) for the facility is 1.7 million gallons per day (MGD) and the design maximum flow (DMF) for the facility is 5.0 MGD. Treatment consists of screens, comminutor, primary clarifier, trickling filter, final clarifier, sand filters, chlorination, dechlorination, and sludge handling facilities.

This treatment works has an approved pretreatment program. There are 2 CIUs.

This modified NPDES Permit does not increase the facility's DAF, DMF, concentration limits, and/or load limits.

The IEPA will accept comments on the following draft modifications to the Permit:

1. The compliance schedule for chloride has been extended for one year.

Application is made for the existing discharge(s) which is (are) located in McHenry County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

Outfall	Receiving Stream	Latitude	Longitude	Stream Classification	Biological Stream Characterization
001	Unnamed Tributary of Sleepy Hollow Creek	42° 15' 07" North	88° 18' 21" West	General Use	Not Rated

To assist you further in identifying the location of the discharge(s) please see the attached map.

The stream segment(s) receiving the discharge from outfall(s) 001 is (are) not on the 303 (d) list of impaired waters.

The discharge(s) from the facility is (are) proposed to be monitored and limited at all times as follows:

Discharge Number(s) and Name(s): 001 STP Outfall

Load limits computed based on a design average flow (DAF) of 1.7 MGD (design maximum flow (DMF) of 5.0 MGD).


The effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day* DAF (DMF)			CONCENTRATION LIMITS mg/L			Regulation
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum	
CBOD ₅	142 (417)		284 (834)	10		20	35 IAC 304.120 40 CFR 133.102
Suspended Solids	170 (500)		340 (1,001)	12		24	35 IAC 304.120 40 CFR 133.102
Dissolved Oxygen	Shall not be less than 6 mg/L						35 IAC 302.206
pH	Shall be in the range of 6 to 9 Standard Units						35 IAC 304.125
Fecal Coliform	Daily Maximum shall not exceed 400 per 100 mL (May through October)						35 IAC 304.121
Chlorine Residual						0.05	35 IAC 302.208
Ammonia Nitrogen:							
April-Oct.	17 (50)	----	43 (125)	1.2	----	3.0	35 IAC 355 and 35 IAC 302
Nov.-Feb.	35 (104)	----	112 (329)	2.5	----	7.9	
March	28 (83)	72 (213)	101 (296)	2.0	5.1	7.1	
Phosphorus	14 (42)		28 (83)	1.0		2.0	35 IAC 304.123
Chloride			7,089 (20,850)			500	35 IAC 302.208
Barium	28 (83)		57 (167)	2.0		4.0	35 IAC 304.124

*Load Limits are calculated by using the formula: 8.34 x (Design Average and/or Maximum Flow in MGD) x (Applicable Concentration in mg/L).

This draft Permit also contains the following requirements as special conditions:

1. Reopening of this Permit to include different final effluent limitations.
2. Operation of the facility by or under the supervision of a certified operator.
3. Submission of the operational data in a specified form and at a required frequency at any time during the effective term of this Permit.
4. More frequent monitoring requirement without Public Notice in the event of operational, maintenance or other problems resulting in possible effluent deterioration.
5. Prohibition against causing or contributing to violations of water quality standards.
6. Effluent sampling point location.
7. Seasonal fecal coliform limits.
8. The Permittee implements and administers an industrial pretreatment program pursuant to 40 CFR §403.
9. Burden reduction.
10. Submission of annual fiscal data.
11. The Permittee is required to perform biomonitoring tests in the 18th, 15th, 12th and 9th months prior to the expiration date of the Permit, and to submit the results of such tests to the IEPA within one week of receiving the results from the laboratory.
12. Submission of semi annual reports indicating the quantities of sludge generated and disposed.
13. Recording the monitoring results on Discharge Monitoring Report Forms using one such form for each outfall each month and submitting the forms to IEPA each month.
14. Compliance schedule for chloride.

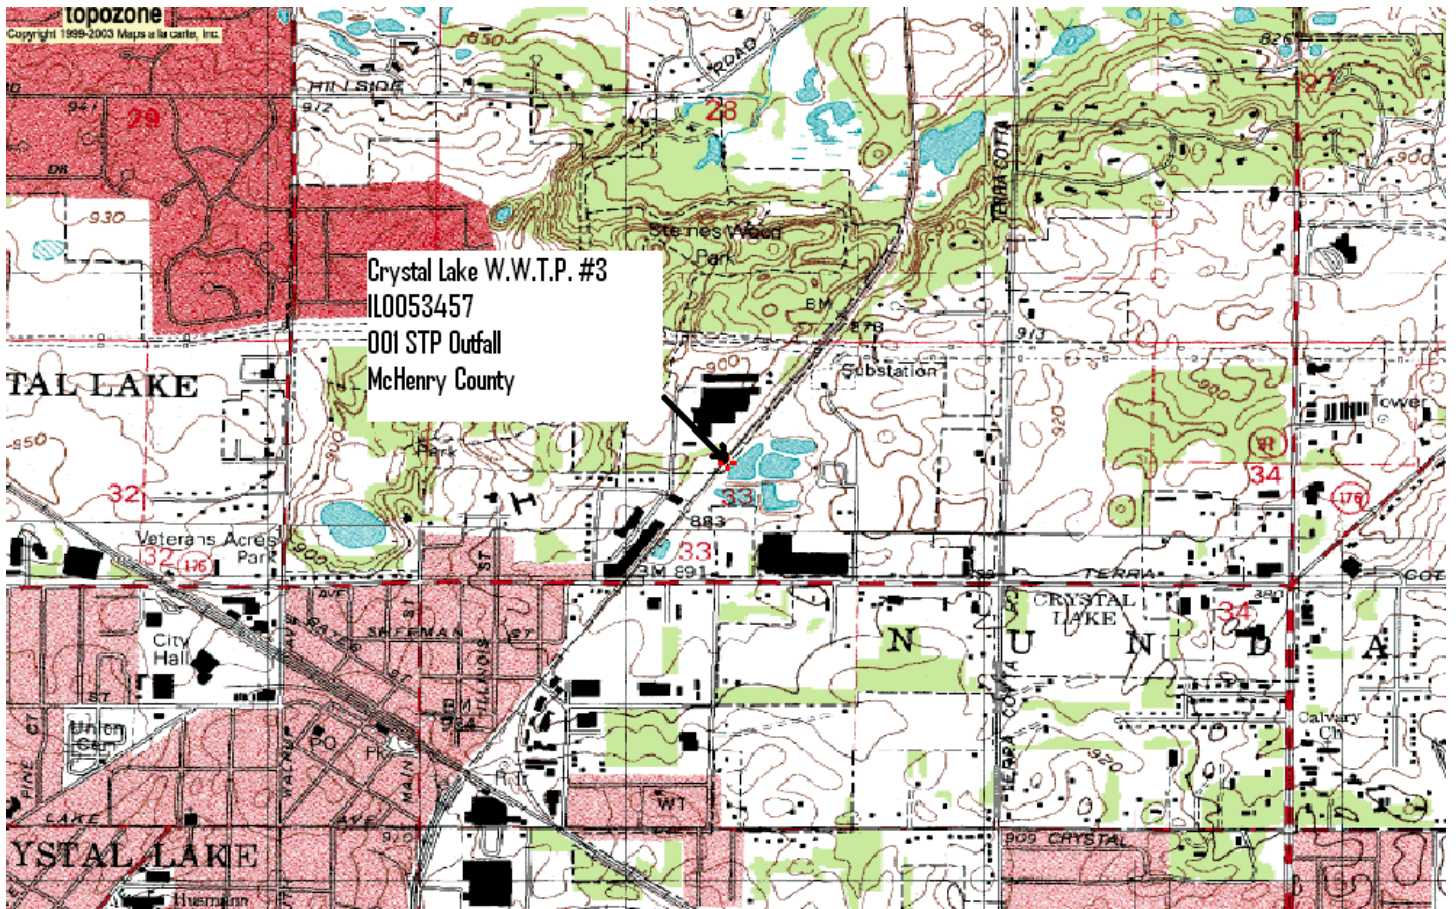

NPDES Permit No. IL0053457

Illinois Environmental Protection Agency

Division of Water Pollution Control

1021 North Grand Avenue East

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Modified (NPDES) Permit

Expiration Date: **February 28, 2013**

Issue Date: **January 25, 2008**

Effective Date: **March 1, 2008**

Modification Date:

Name and Address of Permittee:

City of Crystal Lake
Post Office Box 597
Crystal Lake, Illinois 60014

Facility Name and Address:

Crystal Lake W.W.T.P. #3
400 Knaack Boulevard
Crystal Lake, Illinois
(McHenry County)

Receiving Waters: Unnamed Tributary of Sleepy Hollow Creek

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of the Ill. Adm. Code, Subtitle C, Chapter I, and the Clean Water Act (CWA), the above-named Permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the standard conditions and attachments herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the Permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Alan Keller, P.E.
Manager, Permit Section
Division of Water Pollution Control

SAK:ALD:07071301.bah

NPDES Permit No. IL0053457

Effluent Limitations, Monitoring, and Reporting

FINAL

Discharge Number(s) and Name(s): 001 STP Outfall

Load limits computed based on a design average flow (DAF) of 1.7 MGD (design maximum flow (DMF) of 5.0 MGD).

Excess flow facilities (if applicable) shall not be utilized until the main treatment facility is receiving its maximum practical flow.

From the modification date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day DAF (DMF)*			CONCENTRATION LIMITS MG/L			Sample Frequency	Sample Type
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum		
Flow (MGD)							Continuous	RIT****
CBOD ₅ **	142 (417)		284 (834)	10		20	1 Day/Week	Composite
Suspended Solids	170 (500)		340 (1,001)	12		24	1 Day/Week	Composite
Dissolved Oxygen	Shall not be less than 6 mg/L						3 Days/Week	Grab
pH	Shall be in the range of 6 to 9 Standard Units						1 Day/Week	Grab
Fecal Coliform***	Daily Maximum shall not exceed 400 per 100 mL (May through October)						1 Day/Week	Grab
Chlorine Residual***						0.05	1 Day/Week	Grab
Ammonia Nitrogen as (N)								
April-October	17 (50)	----	43 (125)	1.2	----	3.0	1 Day/Week	Composite
November-Feb.	35 (104)	----	112 (329)	2.5	----	7.9	1 Day/Week	Composite
March	28 (83)	72 (213)	101 (296)	2.0	5.1	7.1	1 Day/Week	Composite
Phosphorus	14 (42)		28 (83)	1.0		2.0	1 Day/Week	Composite
Chloride*****			7089 (20,850)			500	3 Days/Week	Composite
Barium	28 (83)		57 (167)	2.0		4.0	3 Days/Week	Composite

*Load limits based on design maximum flow shall apply only when flow exceeds design average flow.

**Carbonaceous BOD₅ (CBOD₅) testing shall be in accordance with 40 CFR 136.

***See Special Condition 7.

****Recording, Indicating, Totalizing.

*****See Special Condition 14.

Flow shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

Fecal Coliform shall be reported on the DMR as a daily maximum value.

pH shall be reported on the DMR as minimum and maximum value.

Chlorine Residual shall be reported on DMR as daily maximum.

Dissolved oxygen shall be reported on the DMR as a minimum value.

NPDES Permit No. IL0053457

Influent Monitoring, and Reporting

The influent to the plant shall be monitored as follows:

Parameter	Sample Frequency	Sample Type
Flow (MGD)	Continuous	RIT*
BOD ₅	1 Day/Week	Composite
Suspended Solids	1 Day/Week	Composite

Influent samples shall be taken at a point representative of the influent.

Flow (MGD) shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration.

*Recording, Indicating, Totalizing.

Special Conditions

SPECIAL CONDITION 1. This Permit may be modified to include different final effluent limitations or requirements which are consistent with applicable laws, regulations, or judicial orders. The IEPA will public notice the permit modification.

SPECIAL CONDITION 2. The use or operation of this facility shall be by or under the supervision of a Certified Class 1 operator.

SPECIAL CONDITION 3. The IEPA may request in writing submittal of operational information in a specified form and at a required frequency at any time during the effective period of this Permit.

SPECIAL CONDITION 4. The IEPA may request more frequent monitoring by permit modification pursuant to 40 CFR § 122.63 and Without Public Notice in the event of operational, maintenance or other problems resulting in possible effluent deterioration.

SPECIAL CONDITION 5. The effluent, alone or in combination with other sources, shall not cause a violation of any applicable water quality standard outlined in 35 Ill. Adm. Code 302.

SPECIAL CONDITION 6. Samples taken in compliance with the effluent monitoring requirements shall be taken at a point representative of the discharge, but prior to entry into the receiving stream.

SPECIAL CONDITION 7. Fecal Coliform limits for Discharge Number 001 are effective May thru October. Sampling of Fecal Coliform is only required during this time period.

The total residual chlorine limit is applicable at all times. If the Permittee is chlorinating for any purpose during the months of November through April, sampling is required on a daily grab basis. Sampling frequency for the months of May through October shall be as indicated on effluent limitations, monitoring and reporting page of this Permit.

SPECIAL CONDITION 8.A. Publicly Owned Treatment Works (POTW) Pretreatment Program General Provisions

1. The Permittee shall implement and enforce its approved Pretreatment Program which was approved on June 28, 1985 and all approved subsequent modifications thereto. The Permittee shall maintain legal authority adequate to fully implement the Pretreatment Program in compliance with Federal (40 CFR 403), State, and local laws. The Permittee shall:
 - a. Carry out independent inspection and monitoring procedures at least once per year, which will determine whether each significant industrial user (SIU) is in compliance with applicable pretreatment standards;
 - b. Perform an evaluation, at least once every two (2) years, to determine whether each SIU needs a slug control plan. If needed, the SIU slug control plan shall include the items specified in 40 CFR § 403.8 (f)(2)(v);
 - c. Update its inventory of Industrial Users (IUs) at least annually and as needed to ensure that all SIUs are properly identified, characterized, and categorized;
 - d. Receive and review self monitoring and other IU reports to determine compliance with all pretreatment standards and requirements, and obtain appropriate remedies for noncompliance by any IU with any pretreatment standard and/or requirement;
 - e. Investigate instances of noncompliance, collect and analyze samples, and compile other information with sufficient care as to produce evidence admissible in enforcement proceedings, including judicial action;
 - f. Require development, as necessary, of compliance schedules by each industrial user for the installation of control technologies to meet applicable pretreatment standards; and,
 - g. Maintain an adequate revenue structure for continued operation of the Pretreatment Program.
2. The Permittee shall issue/reissue permits or equivalent control mechanisms to all SIUs prior to expiration of existing permits or prior to commencement of discharge in the case of new discharges. The permits at a minimum shall include the elements listed in 40 CFR § 403.8(f)(1)(iii).
3. The Permittee shall develop, maintain, and enforce, as necessary, local limits to implement the prohibitions in 40 CFR § 403.5 which prohibit the introduction of specific pollutants to the waste treatment system from any source of nondomestic discharge.

NPDES Permit No. IL0053457

Special Conditions

4. In addition to the general limitations expressed in Paragraph 3 above, applicable pretreatment standards must be met by all industrial users of the POTW. These limitations include specific standards for certain industrial categories as determined by Section 307(b) and (c) of the Clean Water Act, State limits, or local limits, whichever are more stringent.
5. The USEPA and IEPA individually retain the right to take legal action against any industrial user and/or the POTW for those cases where an industrial user has failed to meet an applicable pretreatment standard by the deadline date regardless of whether or not such failure has resulted in a permit violation.
6. The Permittee shall establish agreements with all contributing jurisdictions, as necessary, to enable it to fulfill its requirements with respect to all IUs discharging to its system.
7. Unless already completed, the Permittee shall within six (6) months of the effective date of this Permit submit to USEPA and IEPA a proposal to modify and update its approved Pretreatment Program to incorporate Federal revisions to the general pretreatment regulations. The proposal shall include all changes to the approved program and the sewer use ordinance which are necessary to incorporate the regulations commonly referred to as PIRT and DSS, which were effective November 16, 1988 and August 23, 1990, respectively. This includes the development of an Enforcement Response Plan (ERP) and a technical re-evaluation of the Permittee's local limits.

B. Reporting and Records Requirements

1. The Permittee shall provide an annual report briefly describing the permittee's pretreatment program activities over the previous calendar year. Permittees who operate multiple plants may provide a single report providing all plant-specific reporting requirements are met. Such report shall be submitted no later than April 28 of each year, and shall be in the format set forth in IEPA's POTW Pretreatment Report Package which contains information regarding:
 - a. An updated listing of the Permittee's industrial users.
 - b. A descriptive summary of the compliance activities including numbers of any major enforcement actions, (i.e., administrative orders, penalties, civil actions, etc.), and the outcome of those actions. This includes an assessment of the compliance status of the Permittee's industrial users and the effectiveness of the Permittee's Pretreatment Program in meeting its needs and objectives.
 - c. A description of all substantive changes made to the Permittee's Pretreatment Program. Changes which are "substantial modifications" as described in 40 CFR § 403.18(c) must receive prior approval from the Approval Authority.
 - d. Results of sampling and analysis of POTW influent, effluent, and sludge.
 - e. A summary of the findings from the priority pollutants sampling. As sufficient data becomes available the IEPA may modify this Permit to incorporate additional requirements relating to the evaluation, establishment, and enforcement of local limits for organic pollutants. Any permit modification is subject to formal due process procedures pursuant to State and Federal law and regulation. Upon a determination that an organic pollutant is present that causes interference or pass through, the Permittee shall establish local limits as required by 40 CFR § 403.5(c).
2. The Permittee shall maintain all pretreatment data and records for a minimum of three (3) years. This period shall be extended during the course of unresolved litigation or when requested by the IEPA or the Regional Administrator of USEPA. Records shall be available to USEPA and the IEPA upon request.
3. The Permittee shall establish public participation requirements of 40 CFR 25 in implementation of its Pretreatment Program. The Permittee shall at least annually, publish the names of all IU's which were in significant noncompliance (SNC), as defined by 40 CFR § 403.8(f)(2)(vii), in the largest daily paper in the municipality in which the POTW is located or based on any more restrictive definition of SNC that the POTW may be using.

NPDES Permit No. IL0053457

Special Conditions

4. The Permittee shall provide written notification to the Deputy Counsel for the Division of Water Pollution Control, IEPA, 1021 North Grand Avenue East, P.O. Box 19276, Springfield, Illinois 62794-9276 within five (5) days of receiving notice that any Industrial User of its sewage treatment plant is appealing to the Circuit Court any condition imposed by the Permittee in any permit issued to the Industrial User by Permittee. A copy of the Industrial User's appeal and all other pleadings filed by all parties shall be mailed to the Deputy Counsel within five (5) days of the pleadings being filed in Circuit Court.

C. Monitoring Requirements

1. The Permittee shall monitor its influent, effluent and sludge and report concentrations of the following parameters on monitoring report forms provided by the IEPA and include them in its annual report. Samples shall be taken at 6 months intervals at the indicated reporting limit or better and consist of a 24-hour composite unless otherwise specified below. Sludge samples shall be taken of final sludge and consist of a grab sample reported on a dry weight basis.

<u>STORET CODE</u>	<u>PARAMETER</u>	<u>Minimum reporting limit</u>
01097	Antimony	0.07 mg/L
01002	Arsenic	0.05 mg/L
01007	Barium	0.5 mg/L
01012	Beryllium	0.005 mg/L
01027	Cadmium	0.001 mg/L
01032	Chromium (hex - grab not to exceed 24 hours)*	0.01 mg/L
01034	Chromium (total)	0.05 mg/L
01042	Copper	0.005 mg/L
00718	Cyanide (grab) (weak acid dissociable)*	5.0 ug/L
00720	Cyanide (grab) (total)	5.0 ug/L
00951	Fluoride*	0.1 mg/L
01045	Iron (total)	0.5 mg/L
01046	Iron (Dissolved)*	0.5 mg/L
01051	Lead	0.05 mg/L
01055	Manganese	0.5 mg/L
71900	Mercury (effluent grab using USEPA Method 1631 or equivalent)***	1.0 ng/L**
01067	Nickel	0.005 mg/L
00556	Oil (hexane soluble or equivalent) (Grab Sample only)*	5.0 mg/L
32730	Phenols (grab)	0.005 mg/L
01147	Selenium	0.005 mg/L
01077	Silver (total)	0.003 mg/L
01059	Thallium	0.3 mg/L
01092	Zinc	0.025 mg/L

* Influent and effluent only

**1 ng/L = 1 part per trillion.

*** Other approved methods may be used for influent (composite) and sludge

Unless otherwise indicated, concentrations refer to the total amount of the constituent present in all phases, whether solid, suspended or dissolved, elemental or combined including all oxidation states. Where constituents are commonly measured as other than total, the phase is so indicated.

2. The Permittee shall conduct an analysis for the one hundred and ten (110) organic priority pollutants identified in 40 CFR 122 Appendix D, Table II as amended. This monitoring shall be done annually and reported on monitoring report forms provided by the IEPA and shall consist of the following:

- a. The influent and effluent shall be sampled and analyzed for the one hundred and ten (110) organic priority pollutants. The sampling shall be done during a day when industrial discharges are expected to be occurring at normal to maximum levels.

Samples for the analysis of acid and base/neutral extractable compounds shall be 24-hour composites.

NPDES Permit No. IL0053457

Special Conditions

Five (5) grab samples shall be collected each monitoring day to be analyzed for volatile organic compounds. A single analysis for volatile pollutants (Method 624) may be run for each monitoring day by compositing equal volumes of each grab sample directly in the GC purge and trap apparatus in the laboratory, with no less than one (1) mL of each grab included in the composite.

Wastewater samples must be handled, prepared, and analyzed by GC/MS in accordance with USEPA Methods 624 and 625 of 40 CFR 136 as amended.

- b. The sludge shall be sampled and analyzed for the one hundred and ten (110) organic priority pollutants. A sludge sample shall be collected concurrent with a wastewater sample and taken as final sludge.

Sampling and analysis shall conform to USEPA Methods 624 and 625 unless an alternate method has been approved by IEPA.

- c. Sample collection, preservation and storage shall conform to approved USEPA procedures and requirements.
3. In addition, the Permittee shall monitor any new toxic substances as defined by the Clean Water Act, as amended, following notification by the IEPA.
4. Permittee shall report any noncompliance with effluent or water quality standards in accordance with Standard Condition 12(e) of this Permit.
5. Analytical detection limits shall be in accordance with 40 CFR 136. Minimum detection limits for sludge analyses shall be in accordance with 40 CFR 503.

SPECIAL CONDITION 9. The Permittee has undergone a Monitoring Reduction review and the influent and effluent sample frequency has been reduced for BOD₅, CBOD₅, suspended solids, pH, ammonia, fecal coliform, chlorine residual, and phosphorus due to sustained compliance. The IEPA will require that the influent and effluent sampling frequency for these parameters be increased to if effluent deterioration occurs due to increased wasteload, operational, maintenance or other problems. The increased monitoring will be required Without Public Notice when a permit modification is received by the Permittee from the IEPA.

SPECIAL CONDITION 10. During January of each year the Permittee shall submit annual fiscal data regarding sewerage system operations to the Illinois Environmental Protection Agency/Division of Water Pollution Control/Compliance Assurance Section. The Permittee may use any fiscal year period provided the period ends within twelve (12) months of the submission date.

Submission shall be on forms provided by IEPA titled "Fiscal Report Form For NPDES Permittees".

SPECIAL CONDITION 11. The Permittee shall conduct biomonitoring of the effluent from Discharge Number(s) 001.

Biomonitoring

1. Acute Toxicity - Standard definitive acute toxicity tests shall be run on at least two trophic levels of aquatic species (fish, invertebrate) representative of the aquatic community of the receiving stream. Testing must be consistent with Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms (Fifth Ed.) EPA/821-R-02-012. Unless substitute tests are pre-approved; the following tests are required:
- a. Fish - 96 hour static LC₅₀ Bioassay using fathead minnows (*Pimephales promelas*).
- b. Invertebrate 48-hour static LC₅₀ Bioassay using *Ceriodaphnia*.
2. Testing Frequency - The above tests shall be conducted using 24-hour composite samples unless otherwise authorized by the IEPA. Samples must be collected in the 18th, 15th, 12th, and 9th month prior to the expiration date of this Permit.
3. Reporting - Results shall be reported according to EPA/821-R-02-012, Section 12, Report Preparation, and shall be submitted to IEPA, Bureau of Water, Compliance Assurance Section within one week of receipt from the laboratory. Reports are due to the IEPA no later than the 16th, 13th, 10th, and 7th month prior to the expiration date of this Permit.

Special Conditions

4. Toxicity Reduction Evaluation - Should the results of the biomonitoring program identify toxicity, the IEPA may require that the Permittee prepare a plan for toxicity reduction evaluation and identification. This plan shall be developed in accordance with Toxicity Reduction Evaluation Guidance for Municipal Wastewater Treatment Plants, EPA/833B-99/002, and shall include an evaluation to determine which chemicals have a potential for being discharged in the plant wastewater, a monitoring program to determine their presence or absence and to identify other compounds which are not being removed by treatment, and other measures as appropriate. The Permittee shall submit to the IEPA its plan for toxicity reduction evaluation within ninety (90) days following notification by the IEPA. The Permittee shall implement the plan within ninety (90) days or other such date as contained in a notification letter received from the IEPA.

The IEPA may modify this Permit during its term to incorporate additional requirements or limitations based on the results of the biomonitoring. In addition, after review of the monitoring results, the IEPA may modify this Permit to include numerical limitations for specific toxic pollutants. Modifications under this condition shall follow public notice and opportunity for hearing.

SPECIAL CONDITION 12. For the duration of this Permit, the Permittee shall determine the quantity of sludge produced by the treatment facility in dry tons or gallons with average percent total solids analysis. The Permittee shall maintain adequate records of the quantities of sludge produced and have said records available for IEPA inspection. The Permittee shall submit to the IEPA, at a minimum, a semi-annual summary report of the quantities of sludge generated and disposed of, in units of dry tons or gallons (average total percent solids) by different disposal methods including but not limited to application on farmland, application on reclamation land, landfilling, public distribution, dedicated land disposal, sod farms, storage lagoons or any other specified disposal method. Said reports shall be submitted to the IEPA by January 31 and July 31 of each year reporting the preceding January thru June and July thru December interval of sludge disposal operations.

Duty to Mitigate. The Permittee shall take all reasonable steps to minimize any sludge use or disposal in violation of this Permit.

Sludge monitoring must be conducted according to test procedures approved under 40 CFR 136 unless otherwise specified in 40 CFR 503, unless other test procedures have been specified in this Permit.

Planned Changes. The Permittee shall give notice to the IEPA on the semi-annual report of any changes in sludge use and disposal.

The Permittee shall retain records of all sludge monitoring, and reports required by the Sludge Permit as referenced in Standard Condition 23 for a period of at least five (5) years from the date of this Permit.

If the Permittee monitors any pollutant more frequently than required by the Sludge Permit, the results of this monitoring shall be included in the reporting of data submitted to the IEPA.

Monitoring reports for sludge shall be reported on the form titled "Sludge Management Reports" to the following address:

Illinois Environmental Protection Agency
Bureau of Water
Compliance Assurance Section
Mail Code #19
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 13. The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) Forms using one such form for each outfall each month.

In the event that an outfall does not discharge during a monthly reporting period, the DMR Form shall be submitted with no discharge indicated.

The Permittee may choose to submit electronic DMRs (eDMRs) instead of mailing paper DMRs to the IEPA. More information, including registration information for the eDMR program, can be obtained on the IEPA website, <http://www.epa.state.il.us/water/edmr/index.html>.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 25th day of the following month, unless otherwise specified by the permitting authority.

Special Conditions

Permittees not using eDMRs shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency
Division of Water Pollution Control
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

Attention: Compliance Assurance Section, Mail Code # 19

SPECIAL CONDITION 14. A daily maximum chloride limit of 500.0 mg/L shall become effective four (4) years from the effective date of this permit.

The Permittee shall complete the necessary upgrades in accordance with the following schedule:

- | | | |
|----|---------------------------------|---|
| 1. | Submit Progress Report | 6 months from effective date of permit |
| 2. | Submit Plans and Specifications | 12 months from effective date of permit |
| 3. | Submit Progress Report | 18 months from effective date of permit |
| 4. | Commence Construction | 24 months from effective date of permit |
| 5. | Submit Progress Report | 30 months from effective date of permit |
| 6. | Submit Progress Report | 36 months from effective date of permit |
| 7. | Submit Progress Report | 42 months from effective date of permit |
| 8. | Obtain Compliance | 48 months from effective date of permit |

Compliance dates set out in this Permit may be superseded or supplemented by compliance dates in judicial orders, Illinois Pollution Control Board orders. This Permit may be modified with Public Notice, to include such revised compliance dates.

Reporting shall be submitted on the DMR's on a monthly basis.

REPORTING

The Permittee shall submit progress reports for items 1, 3, 4, 5, 6 and 7 of the compliance schedule indicating: a) the date the item was completed, or b) that the item was not completed, the reasons for non-completion and the anticipated completion date to the Agency Compliance Section.

