

NPDES Permit No. IL0045993
Notice No. MRA:09091101.daa

Public Notice Beginning Date: **April 7, 2011**

Public Notice Ending Date: **May 9, 2011**

National Pollutant Discharge Elimination System (NPDES)
Permit Program

PUBLIC NOTICE/FACT SHEET
of
Draft Reissued NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois EPA
Division of Water Pollution Control
Permit Section
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276
217/782-0610

Name and Address of Discharger:

Illinois - American Water Company
1000 Internationale Parkway
Woodridge, Illinois 60517-4924

Name and Address of Facility:

Illinois - American Water Co. - Derby Meadows WRF
12130 Derby Lane
Lockport, Illinois 60441
(Will County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES Permit to discharge into the waters of the state and has prepared a draft Permit and associated fact sheet for the above named discharger. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. All comments on the draft Permit and requests for hearing must be received by the IEPA by U.S. Mail, carrier mail or hand delivered by the Public Notice Ending Date. Interested persons are invited to submit written comments on the draft Permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the Permit applicant. The NPDES Permit and notice numbers must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft Permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicate a significant degree of public interest in the draft Permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final Permit is issued. For further information, please call Mark R. Ashrafi at 217/782-0610.

The following water quality and effluent standards and limitations were applied to the discharge:

Title 35: Environmental Protection, Subtitle C: Water Pollution, Chapter I: Pollution Control Board and the Clean Water Act were applied in determining the applicable standards, limitations and conditions contained in the draft Permit.

The applicant is engaged in treating domestic and industrial wastewater for the Illinois - American Water Company - Derby Meadows WRF service area.

The length of the Permit is approximately 5 years.

The main discharge number is 001. The seven day once in ten year low flow (7Q10) of the receiving stream, Long Run Creek, is 0 cfs.

The design average flow (DAF) for the facility is 0.9 million gallons per day (MGD) and the design maximum flow (DMF) for the facility is 2.655 MGD. Treatment consists of screening, grit removal, activated sludge, clarification, chlorination/dechlorination, aerobic digestion, sludge dewatering and land application.

This reissued NPDES Permit does not increase the facility's DAF, DMF, concentration limits, and/or load limits.

Pursuant to the waiver provisions authorized by 40 CFR § 123.24, this draft permit is within the class, type, and size for which the Regional Administrator, Region V, has waived the right to review, object, or comment on this draft permit action.

Application is made for the existing discharge(s) which is located in Will County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

Outfall	Receiving Stream	Latitude	Longitude	Stream Classification	Integrity Rating
001	Long Run Creek	41° 38' 15" North	87° 55' 00" West	General Use	*

*Long Run Creek is not given an integrity rating in the 2008 IDNR Publication *Integrating Multiple Taxa in a Biological Stream Rating System*.

To assist you further in identifying the location of the discharge(s) please see the attached map.

The stream segment(s) receiving the discharge from outfall(s) 001 is not on the Illinois Integrated Water Quality Report and Section 303(d) List - 2006 or 2008 Partially approved List of impaired waters.

The discharge(s) from the facility is (are) proposed to be monitored and limited at all times as follows:

Discharge Number(s) and Name(s): 001 STP Outfall

Load limits computed based on a design average flow (DAF) of 0.9 MGD (design maximum flow (DMF) of 2.655 MGD).


The effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day* DAF (DMF)			CONCENTRATION LIMITS mg/L			Regulation
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum	
CBOD ₅	75 (221)		150 (443)	10		20	35 IAC 304.120 40 CFR 133.102
Suspended Solids	90 (266)		180 (531)	12		24	35 IAC 304.120 40 CFR 133.102
pH	Shall be in the range of 6 to 9 Standard Units						35 IAC 304.125
Fecal Coliform	The monthly geometric mean shall not exceed 200 per 100 mL (May through October)						35 IAC 304.121
Chlorine Residual						0.05	35 IAC 302.208
Ammonia Nitrogen: April-Oct. Nov.-Feb. March	11 (31) 30 (89) 24 (71)	-- -- --	23 (66) 60 (177) 60 (177)	1.4 4.0 3.2	-- -- --	3.0 8.0 8.0	35 IAC 355 and 35 IAC 302
				Monthly Average not less than	Weekly Average not less than	Daily Minimum	
Dissolved Oxygen March - July August - February				N/A 5.5	6.0 4.0	5.0 3.5	35 IAC 302.206

*Load Limits are calculated by using the formula: $8.34 \times (\text{Design Average and/or Maximum Flow in MGD}) \times (\text{Applicable Concentration in mg/L})$.

This draft Permit also contains the following requirements as special conditions:

1. Reopening of this Permit to include different final effluent limitations.
2. Operation of the facility by or under the supervision of a certified operator.
3. Submission of the operational data in a specified form and at a required frequency at any time during the effective term of this Permit.
4. More frequent monitoring requirement without Public Notice in the event of operational, maintenance or other problems resulting in possible effluent deterioration.
5. Prohibition against causing or contributing to violations of water quality standards.
6. Effluent sampling point location.
7. Seasonal fecal coliform limits.
8. Submission of semi annual reports indicating the quantities of sludge generated and disposed.
9. Recording the monitoring results on Discharge Monitoring Report Forms using one such form for each outfall each month and submitting the forms to IEPA each month.
10. Bypass provisions of 40 CFR Section 122.41(m) & (n).
11. Burden reduction.
12. pH and temperature site – specific data.
13. Ammonia limits compliance schedule.

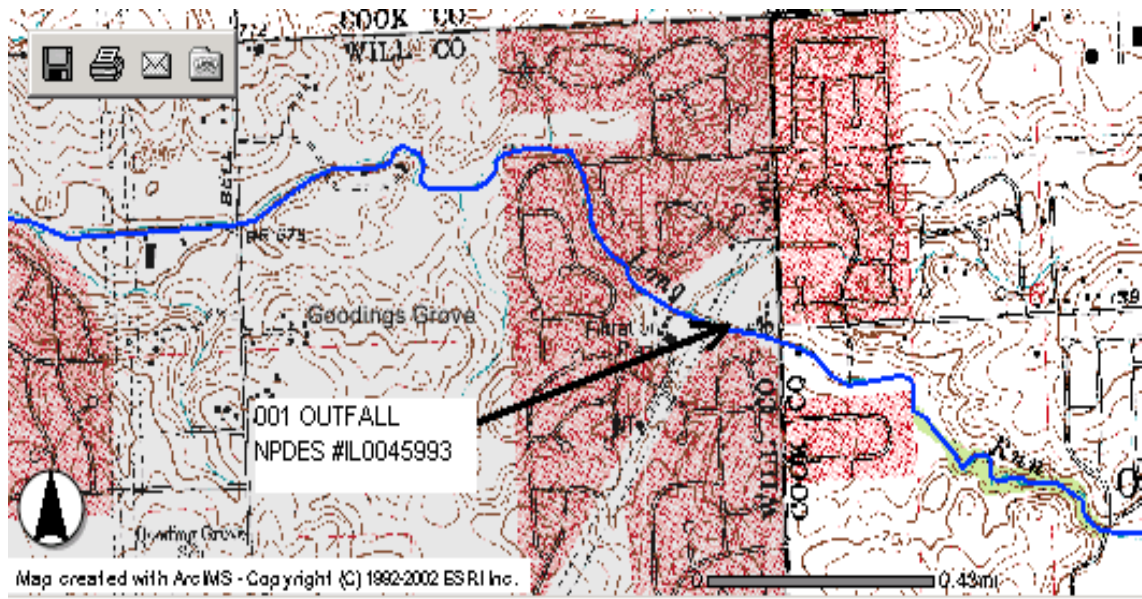

NPDES Permit No. IL0045993

Illinois Environmental Protection Agency

Division of Water Pollution Control

1021 North Grand Avenue East

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Reissued (NPDES) Permit

Expiration Date:

Issue Date:

Effective Date:

Name and Address of Permittee:

Facility Name and Address:

Illinois - American Water Company
1000 Internationale Parkway
Woodridge, Illinois 60517-4924

Illinois - American Water Co. - Derby Meadows WRF
12130 Derby Lane
Lockport, Illinois 60441
(Will County)

Receiving Waters: Long Run Creek

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of the Ill. Adm. Code, Subtitle C, Chapter I, and the Clean Water Act (CWA), the above-named Permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the standard conditions and attachments herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the Permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Alan Keller, P.E.
Manager, Permit Section
Division of Water Pollution Control

SAK:MRA:09091101.daa

Effluent Limitations, Monitoring, and Reporting

FINAL

Discharge Number(s) and Name(s): 001 STP Outfall

Load limits computed based on a design average flow (DAF) of 0.9 MGD (design maximum flow (DMF) of 2.655 MGD).

Excess flow facilities (if applicable) shall not be utilized until the main treatment facility is receiving its maximum practical flow.

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day DAF (DMF)*			CONCENTRATION LIMITS MG/L			Sample Frequency	Sample Type
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum		
Flow (MGD)							Continuous	
CBOD ₅ **	75 (221)		150 (443)	10		20	1 Day/Week	Composite
Suspended Solids	90 (266)		180 (531)	12		24	1 Day/Week	Composite
pH	Shall be in the range of 6 to 9 Standard Units						1 Day/Week	Grab
Fecal Coliform***	The monthly geometric mean shall not exceed 200 per 100 mL (May through October)						2 Days/Week	Grab
Chlorine Residual***						0.05	2 Days/Week	Grab
Ammonia Nitrogen**** as (N)								
April-Oct.	11 (31)	--	23 (66)	1.4	--	3.0	1 Day/Week	Composite
Nov.-Feb.	30 (89)	--	60 (177)	4.0	--	8.0	1 Day/Week	Composite
March	24 (71)	--	60 (177)	3.2	--	8.0	1 Day/Week	Composite
				Monthly Average not less than	Weekly Average not less than	Daily Minimum		
Dissolved Oxygen								
March - July				N/A	6.0	5.0	1 Day/Week	Grab
August - February				5.5	4.0	3.5	1 Day/Week	Grab

*Load limits based on design maximum flow shall apply only when flow exceeds design average flow.

**Carbonaceous BOD₅ (CBOD₅) testing shall be in accordance with 40 CFR 136.

***See Special Condition 7.

****See Special Conditions 12 and 13.

Flow shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

Fecal Coliform shall be reported on the DMR as a monthly geometric mean. No more than 1 sample or 10% of the samples, whichever is greater during the month shall exceed 400 per 100 mL.

pH shall be reported on the DMR as minimum and maximum value.

Chlorine Residual shall be reported on DMR as daily maximum.

Dissolved oxygen shall be reported on the DMR as a minimum value.

NPDES Permit No. IL0045993

Influent Monitoring, and Reporting

The influent to the plant shall be monitored as follows:

Parameter	Sample Frequency	Sample Type
Flow (MGD)	Continuous	
BOD ₅	1 Day/Week	Composite
Suspended Solids	1 Day/Week	Composite

Influent samples shall be taken at a point representative of the influent.

Flow (MGD) shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration.

NPDES Permit No. IL0045993

Special Conditions

SPECIAL CONDITION 1. This Permit may be modified to include different final effluent limitations or requirements which are consistent with applicable laws, regulations, or judicial orders. The IEPA will public notice the permit modification.

SPECIAL CONDITION 2. The use or operation of this facility shall be by or under the supervision of a Certified Class 2 operator.

SPECIAL CONDITION 3. The IEPA may request in writing submittal of operational information in a specified form and at a required frequency at any time during the effective period of this Permit.

SPECIAL CONDITION 4. The IEPA may request more frequent monitoring by permit modification pursuant to 40 CFR ' 122.63 and Without Public Notice in the event of operational, maintenance or other problems resulting in possible effluent deterioration.

SPECIAL CONDITION 5. The effluent, alone or in combination with other sources, shall not cause a violation of any applicable water quality standard outlined in 35 Ill. Adm. Code 302.

SPECIAL CONDITION 6 Samples taken in compliance with the effluent monitoring requirements shall be taken at a point representative of the discharge, but prior to entry into the receiving stream.

SPECIAL CONDITION 7. Fecal Coliform limits for Discharge Number 001 are effective May thru October. Sampling of Fecal Coliform is only required during this time period.

The total residual chlorine limit is applicable at all times. If the Permittee is chlorinating for any purpose during the months of November through April, sampling is required on a daily grab basis. Sampling frequency for the months of May through October shall be as indicated on effluent limitations, monitoring and reporting page of this Permit.

SPECIAL CONDITION 8. For the duration of this Permit, the Permittee shall determine the quantity of sludge produced by the treatment facility in dry tons or gallons with average percent total solids analysis. The Permittee shall maintain adequate records of the quantities of sludge produced and have said records available for IEPA inspection. The Permittee shall submit to the IEPA, at a minimum, a semi-annual summary report of the quantities of sludge generated and disposed of, in units of dry tons or gallons (average total percent solids) by different disposal methods including but not limited to application on farmland, application on reclamation land, landfilling, public distribution, dedicated land disposal, sod farms, storage lagoons or any other specified disposal method. Said reports shall be submitted to the IEPA by January 31 and July 31 of each year reporting the preceding January thru June and July thru December interval of sludge disposal operations.

Duty to Mitigate. The Permittee shall take all reasonable steps to minimize any sludge use or disposal in violation of this Permit.

Sludge monitoring must be conducted according to test procedures approved under 40 CFR 136 unless otherwise specified in 40 CFR 503, unless other test procedures have been specified in this Permit.

Planned Changes. The Permittee shall give notice to the IEPA on the semi-annual report of any changes in sludge use and disposal.

The Permittee shall retain records of all sludge monitoring, and reports required by the Sludge Permit as referenced in Standard Condition 23 for a period of at least five (5) years from the date of this Permit.

If the Permittee monitors any pollutant more frequently than required by the Sludge Permit, the results of this monitoring shall be included in the reporting of data submitted to the IEPA.

Monitoring reports for sludge shall be reported on the form titled "Sludge Management Reports" to the following address:

Illinois Environmental Protection Agency
Bureau of Water
Compliance Assurance Section
Mail Code #19
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 9. The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) Forms using one such form for each outfall each month.

In the event that an outfall does not discharge during a monthly reporting period, the DMR Form shall be submitted with no discharge indicated.

NPDES Permit No. IL0045993

Special Conditions

The Permittee may choose to submit electronic DMRs (eDMRs) instead of mailing paper DMRs to the IEPA. More information, including registration information for the eDMR program, can be obtained on the IEPA website, <http://www.epa.state.il.us/water/edmr/index.html>.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 25th day of the following month, unless otherwise specified by the permitting authority.

Permittees not using eDMRs shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency
Division of Water Pollution Control
Attention: Compliance Assurance Section, Mail Code # 19
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 10. The provisions of 40 CFR Section 122.41 (m) & (n) are applicable and are hereby incorporated by reference.

SPECIAL CONDITION 11. The Permittee has undergone a Monitoring Reduction review and the influent and effluent sample frequency has been reduced for BOD₅, CBOD₅, Suspended Solids, Ammonia Nitrogen, Fecal Coliform, pH and Chlorine Residual due to sustained compliance. The IEPA will require that the influent and effluent sampling frequency for these parameters be increased to 3 days/week if effluent deterioration occurs due to increased wasteload, operational, maintenance or other problems. The increased monitoring will be required Without Public Notice when a permit modification is received by the Permittee from the IEPA.

SPECIAL CONDITION 12. The Permittee may collect data in support of developing site-specific effluent limitations for ammonia nitrogen. Instream monitoring for pH and temperature would be required. Samples should be taken downstream at a point representative of substantial mixing with the receiving stream and below the surface. A monitoring plan must be submitted to the Agency for approval which indicates the location, sample frequency and the duration of the monitoring program. Should the instream monitoring data indicate that less stringent ammonia nitrogen effluent limitations are protective of the receiving stream, this Permit may be modified to include alternate ammonia nitrogen effluent limitations designed to prevent exceedances of the ammonia nitrogen water quality standards.

SPECIAL CONDITION 13.

Project Description: Compliance with Ammonia Nitrogen Water Quality Standards

Thirty-six (36) months from the effective date of this Permit the following ammonia nitrogen (as N) limits shall become effective:

	Load Limits lbs/day DAF (DMF)*			Concentration Limits mg/L		
	Monthly Avg.	Weekly Avg.	Daily Max.	Monthly Avg.	Weekly Avg.	Daily Max.
April-May/Sept-Oct.	11 (31)		23 (66)	1.4		3.0
June-August	2.3 (6.6)	6.0 (18)	14 (40)	0.3	0.8	1.8
Nov.-Feb.	22 (64)		35 (104)	2.9		4.7
March	11 (31)		24 (71)	1.4		3.2

*Load limits based on design maximum flow shall apply only when flow exceeds the design average flow.

The Permittee shall complete the project described above in accordance with the following schedule:

- (1) Interim Report on either ammonia reductions to date and what measures are necessary to comply with Final Ammonia Nitrogen Limitations or instream pH and temperature monitoring 6 months from the effective date of this Permit
- (2) Preliminary Report on construction of ammonia reduction equipment or interim report on instream pH and temperature monitoring 12 months from the effective date of this Permit

NPDES Permit No. IL0045993

Special Conditions

- | | | |
|-----|---|--|
| (3) | Plans and specifications or interim report on instream pH and temperature monitoring | 18 months from the effective date of this Permit |
| (4) | Commence Construction or interim report on instream pH and temperature monitoring | 24 months from the effective date of this Permit |
| (5) | Interim Report on construction activities or submission of pH and temperature monitoring data | 30 months from the effective date of this Permit |
| (6) | Permittee Achieves Compliance with Final Ammonia Nitrogen Effluent Limitations | 36 months from the effective date of this Permit |

Should the instream monitoring data indicate that less stringent ammonia nitrogen effluent limitations are protective of the receiving water, this Permit may be modified to include alternate ammonia nitrogen effluent limitations designed to prevent exceedances of the ammonia nitrogen water quality standards.

This Permit may be modified, with Public Notice, to include revised compliance dates set out in this Permit that are superseded or supplemented by compliance dates in judicial orders, Pollution Control Board orders or grant agreements. Prior to such permit modification, the revised dates in the appropriate orders or grant agreements shall govern the Permittee's compliance.

In addition, the IEPA may initiate a modification of the construction schedule set forth in this Permit at any time, to include other dates which are necessary to carry out the provisions of the Illinois Environmental Protection Act, the Federal Clean Water Act or regulations promulgated under those Acts or compliance dates which have been submitted in writing by the Permittee and approved by the IEPA. Public Notice of such modifications and opportunity for public hearing shall be provided consistent with 40 CFR § 122.63.

REPORTING

The Permittee shall submit a report no later than fourteen (14) days following the completion dates indicated for each numbered item in the compliance schedule, indicating, a) the date the item was completed, or b) that the item was not completed. All reports shall be submitted to IEPA at the following address:

Illinois Environmental Protection Agency
Attention: Compliance Assurance Section, Mail Code # 19
Division of Water Pollution Control
1021 North Grand Avenue East
Post Office box 19276
Springfield, Illinois 62794-9276

Attention: Compliance Assurance Section