NPDES Permit No. IL0061930 Notice No. MEL:13051401.jmc.docx

Public Notice Beginning Date: August 27, 2013

Public Notice Ending Date: September 26, 2013

National Pollutant Discharge Elimination System (NPDES)
Permit Program

Draft Reissued NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois Environmental Protection Agency Bureau of Water, Division of Water Pollution Control Permit Section 1021 North Grand Avenue East Post Office Box 19276 Springfield, Illinois 62794-9276 217/782-0610

Name and Address of Discharger:

Name and Address of Facility:

Archer Daniels Midland Company One Edmund Street Peoria, Illinois 61602 Archer Daniels Midland Company One Edmund Street Peoria, Illinois 61602 (Peoria County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES permit to discharge into the waters of the state and has prepared a draft permit and associated fact sheet for the above named discharger. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. The last day comments will be received will be on the Public Notice period ending date unless a commentor demonstrating the need for additional time requests an extension to this comment period and the request is granted by the IEPA. Interested persons are invited to submit written comments on the draft permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the permit applicant. The NPDES permit and notice number(s) must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicates a significant degree of public interest in the draft permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final permit is issued. For further information, please call Mark E. Liska at 217/782-0610.

The facility is a grain alcohol distillery (SIC 2869 & 2085). Wastewater is generated as water is utilized for cooling during the fermentation and distillation processes. Plant operation results in an average discharge of 0.002 MGD of river backwash from outfall 001, 15 MGD of non-contact cooling water, boiler water, condensate, fire system testing, building wash water, and stormwater from outfall 002, 0.213 MGD of river backwash from outfall 003, 48 MGD of non-contact cooling water from outfall 004, 50 GPD of fire system testing, building wash water, and stormwater from outfall 005, 50 GPD of fire system testing, building wash water, and stormwater from outfall 006, 50 GPD of fire system testing, building wash water, and stormwater from outfall 007, and an intermittent discharge of building wash water and stormwater from outfalls 008, 009, and 010.

Application is made for existing discharge(s) which are located in Peoria County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

Outfall	Receiving Stream	Latitude		Longitude		Stream Classification	Integrity Rating
001	Illinois River	40 ⁰ 40' 35"	North	89 ⁰ 36' 14"	West	General Use	Not Rated
002	Illinois River	40 ⁰ 40' 32"	North	89 ⁰ 36' 14"	West	General Use	Not Rated
003	Illinois River	40 ⁰ 40' 38"	North	89 ⁰ 36' 14"	West	General Use	Not Rated
004	Illinois River	40 ⁰ 40' 38"	North	89 ⁰ 36' 14"	West	General Use	Not Rated
005	Illinois River	40 ⁰ 40' 24"	North	89 ⁰ 36' 14"	West	General Use	Not Rated
006	Illinois River	40 ⁰ 40' 25"	North	89 ⁰ 36' 14"	West	General Use	Not Rated
007	Illinois River	40 ⁰ 40' 29"	North	89 ⁰ 36' 14"	West	General Use	Not Rated
008	Illinois River	40 ⁰ 40' 26"	North	89 ⁰ 36' 14"	West	General Use	Not Rated
009	Illinois River	40 ⁰ 40' 37"	North	89 ⁰ 36' 14"	West	General Use	Not Rated
010	Illinois River	40 ⁰ 40' 40"	North	89 ⁰ 36' 14"	West	General Use	Not Rated

To assist you further in identifying the location of the discharge please see the attached map.

The stream segment receiving the discharge from outfall(s) 001 - 010 is on the 303 (d) list of impaired waters. The following parameters have been identified as the pollutants causing impairment:

Pollutants	Potential Contributors
Total Fecal Coliform, PCB's, Mercury	Sources Unknown

The discharge(s) from the facility shall be monitored and limited at all times as follows:


		ITS lbs/day (<u>DMF)</u>		CONCEN <u>LIMIT</u>		
PARAMETER	30 DAY AVERAGE	DAILY MAXIMUM	REGULATION	30 DAY AVERAGE	DAILY MAXIMUM	REGULATION
Outfall: 001 and 003						
Flow (MGD)						

		ITS lbs/day (<u>DMF)</u>			ITRATION S mg/l	
PARAMETER	30 DAY AVERAGE	DAILY MAXIMUM	REGULATION	30 DAY AVERAGE	DAILY MAXIMUM	REGULATION
Outfall: 002						
Flow (MGD)						
рН				6 - 9 s.u.		35 IAC 304.125
Temperature						35 IAC 302.211
Total Residual Halogen/ Total Residual Chlorine					0.05	40 CFR 125.3
Outfall: 004						
Flow (MGD)						
рН				6 - 9 s.u.		35 IAC 304.125
Temperature						35 IAC 302.211
Total Residual Halogen/ Total Residual Chlorine					0.05	40 CFR 125.3
Outfall: 005						
Flow (MGD)						
Total Suspended Solids					Monitor Only	
Outfall: 006						
Flow (MGD)						
Total Suspended Solids					Monitor Only	
Outfall: 007						
Flow (MGD)						
Total Suspended Solids					Monitor Only	

	LOAD LIMITS lbs/day DAF (DMF)			CONCENTRATION <u>LIMITS mg/l</u>		
PARAMETER	30 DAY AVERAGE	DAILY MAXIMUM	REGULATION	30 DAY AVERAGE	DAILY MAXIMUM	REGULATION
Outfall: 008						
Flow (MGD)						
Total Suspended Solids					Monitor Only	
Outfall: 009						
Flow (MGD)						
Total Suspended Solids					Monitor Only	
Outfall: 010						
Flow (MGD)						
Total Suspended Solids					Monitor Only	

The following explain the conditions of the proposed permit:

The special conditions clarify flow, pH, temperature, monitoring location, total residual chlorine/total residual halogen, stormwater, and discharge monitoring report submission.

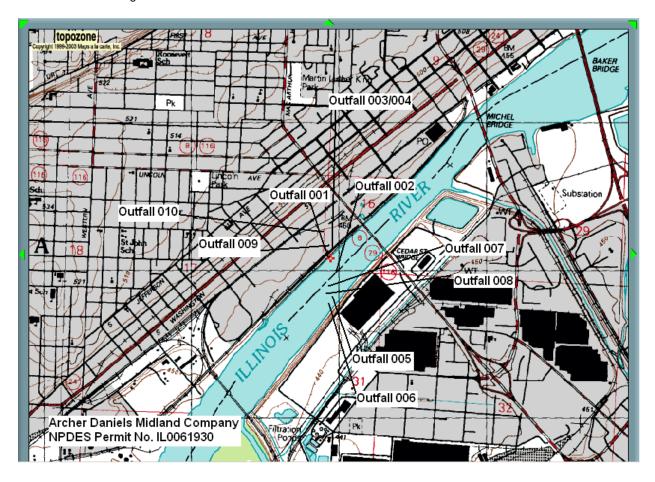

Illinois Environmental Protection Agency

Division of Water Pollution Control

1021 North Grand Avenue East

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Reissued (NPDES) Permit

Expiration Date: Issue Date: Effective Date:

Name and Address of Permittee: Facility Name and Address:

Archer Daniels Midland Company Archer Daniels Midland Company

One Edmund Street
Peoria, Illinois 61602
Peoria, Illinois 61602
(Peoria County)

Discharge Number and Name: Receiving Waters:

001, 003 River Backwash Illinois River 002 Non-Contact Cooling Water, Fire System Testing, Illinois River

Boiler Water, Condensate, Building Wash Water, and

Stormwater

004 Non-Contact Cooling Water Illinois River 005, 006, Fire System Testing, Building Wash Water, and Illinois River

& 007 Stormwater

008 - 010 Building Wash Water and Stormwater Illinois River

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of Ill. Adm. Code, Subtitle C and/or Subtitle D, Chapter 1, and the Clean Water Act (CWA), the above-named permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the standard conditions and attachments herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Alan Keller, P.E. Manager, Permit Section Division of Water Pollution Control

SAK:MEL:1305140jmc.docx

Effluent Limitations and Monitoring

1. From the effective date of this permit until the expiration date, the effluent of the following discharge(s) shall be monitored and limited at all times as follows:

	LOAD LIMIT <u>DAF (E</u>	•		NTRATION <u>FS mg/l</u>		
PARAMETER	30 DAY AVERAGE	DAILY MAXIMUM	30 DAY AVERAGE	DAILY MAXIMUM	SAMPLE FREQUENCY	SAMPLE TYPE
Outfall 001 - River Backwash	(DAF = 0.002 MGD)					
Flow (MGD)	See Special Cor	ndition 1.			1/Week	Estimate
Outfall 002 - Non-Contact Co (DAF = 15 MGD) Flow (MGD)	See Special Cor		oiler Water, Cond	ensate, Building W	Measure When Monitoring	rmwater*
рН	See Special Cor	ndition 2.			1/Week	Grab
Temperature	See Special Cor	ndition 3 and 15			1/Week	Single Reading
Total Residual Halogen/ Total Residual Chlorine				0.05	**	**
* - Limits do not apply to the s dry weather conditions. See ** - See Special Condition 5.				me of sampling wh	ether the flows were	e from wet or
Outfall 003 - River Backwash	(DAF = 0.213 MGD)					

Effluent Limitations and Monitoring

	LOAD LIMIT <u>DAF (E</u>			NTRATION TS mg/l		
PARAMETER	30 DAY AVERAGE	DAILY MAXIMUM	30 DAY AVERAGE	DAILY MAXIMUM	SAMPLE FREQUENCY	SAMPLE TYPE
Outfall 004 - Non-Contact Coo (DAF = 48 MGD)	ling Water					
Flow (MGD)	See Special Con	ndition 1.			Measure When Monitoring	
рН	See Special Co	ndition 2.			1/Week	Grab
Temperature	See Special Cor	ndition 3 and 15			1/Week	Single Reading
BOD ₅			30	60	1/Week	24-hour Composite
Total Residual Halogen/ Total Residual Chlorine				0.05	*	*
* - See Special Condition 5.						
Outfall 005 - Fire System Testi (DAF = 50 GPD)	ng, Building Wash \	Water, and Stor	mwater**			
Flow (MGD)	See Special Co	ndtion 1.			Measure When Discharging*	Estimate
Total Suspended Solids				Monitor Only	1/Week*	Grab
* - Monitoring only applies whe ** - See Specials Conditions 1: Outfall 006 - Fire System Testi	2 and 13 for stormw	ater.		ash water.		
<u>Outraii 006</u> - Fire System Testi (DAF = 50 GPD)	ng, bulluing wash	vvater, and Stor	iliwater "	<u>, </u>		
(27.11 00 01.2)						
Flow (MGD)	See Special Cor	ndtion 1.			Measure When Discharging*	Estimate

* - Monitoring only applies when discharging fire system test water and building wash water.
** - See Special Conditions 12 and 13 for stormwater.

Effluent Limitations and Monitoring

1. From the effective date of this permit until the expiration date, the effluent of the following discharge(s) shall be monitored and limited at all times as follows:

PARAMETER Outfall 007 - Fire System Testin (DAF = 50 GPD)	30 DAY AVERAGE	DAILY MAXIMUM	30 DAY AVERAGE	DAILY MAXIMUM	SAMPLE FREQUENCY	SAMPLE TYPE
	na Buildina Wash V			100 0 01010101	TREGOLITOT	IIIFE
	ig, Danding Wasii V	Vater, and Stor	mwater**			
Flow (MGD)	See Special Con	ndition 1.			Measure When Discharging*	Estimate
Total Suspended Solids				Monitor Only	1/Week*	Grab
* - Monitoring only applies wher ** - See Special Conditions 12 a	n discharging fire sy and 13 for stormwa	ystem test wate ter.	r and building wa	ash water.		
Outfall 008 - Building Wash Wa (Intermittent Discharge)	ter and Stormwater	**				
Flow (MGD)	See Special Con	ndition 1.			Measure When Discharging*	
Total Suspended Solids				Monitor Only	1/Week*	Grab
** - See Special Conditions 12 a Outfall 009 - Building Wash War (Intermittent Discharge)		,				
Flow (MGD)	See Special Cor	ndition 1.			Measure When Monitoring	
Total Suspended Solids				Monitor Only	1/Week***	Grab
* - See Special Condition 6. ** - See Special Conditions 10, *** - Monitoring only applies who			er.			
Outfall 010 - Building Wash Wa (Intermittent Discharge)	ter and Stormwater	r**				
	See Special Cor	ndition 1.			Measure When	
Flow (MGD)					Discharging*	

Special Conditions

<u>SPECIAL CONDITION 1</u>. Flow shall be measured in unit of Million Gallons per Day (MGD) and reported as a monthly average and a daily maximum on the Discharge Monitoring Report. In the event that no discharge occurs during a given month, a statement of "No discharge" shall be reported on the DMR submitted for that month.

<u>SPECIAL CONDITION 2</u>. The pH shall be in the range 6.0 to 9.0. The monthly minimum and monthly maximum values shall be reported on the DMR form.

<u>SPECIAL CONDITION 3</u>. Discharge of wastewater from this facility must not alone or in combination with other sources cause the receiving stream to violate the following thermal limitations at the edge of the mixing zone which is defined by Section 302.211, Illinois Administration Code, Title 35, Chapter 1, Subtitle C, as amended:

- A. Maximum temperature rise above natural temperature must not exceed 5°F (2.8°C).
- B. Water temperature at representative locations in the main river shall not exceed the maximum limits in the following table during more than one (1) percent of the hours in the 12-month period ending with any month. Moreover, at no time shall the water temperature at such locations exceed the maximum limits in the following table by more than 3EF (1.7EC). (Main river temperatures are temperatures of those portions of the river essentially similar to and following the same thermal regime as the temperatures of the main flow of the river.)

	Jan.	Feb.	Mar.	<u>April</u>	<u>May</u>	<u>June</u>	<u>July</u>	Aug.	Sept.	Oct.	Nov.	Dec.
°F	60	60	60	90	90	90	90	90	90	90	90	60
°C	16	16	16	32	32	32	32	32	32	32	32	16

- C. The monthly maximum value shall be reported on the DMR form.
- D. The permittee shall implement one of the methods in Paragraph E below for determining compliance with the limitations in the above table and submit this information with the next renewal of this permit (unless provided for in Paragraph F). In addition, the permittee must determine the dimensions of the mixing zone, and submit this information to the Agency with the next renewal of this permit.
 - E. The permittee shall determine compliance with the above limitations by one of the following methods:
 - 1. Direct thermal monitoring, at an approved location at the edge of the mixing zone.
 - 2. Monitor end of pipe temperature. Utilize an approved thermal program model that predicts the temperature at the edge of thermal mixing zone taking in to account the end of pipe temperature.
 - 3. An alternative method approved by the Agency. The alternative method must be submitted to the Agency and approved by the Bureau of Water Standards Development Unit.
 - F. If an alternative method is submitted to the Agency then the applicant shall submit that plan within three years of issuance of the permit. The plan shall include a contingency plan to implement an approved method in case the alternative plan is denied. Agency Pre-approved methods are listed in paragraph E.1 and E.2 of this special condition.

<u>SPECIAL CONDITION 4</u>. For the purpose of this permit, discharges from Outfalls 001 and 003 are limited to river backwash wastewater, free from debris and any other wastewater discharges. Any additional discharges would require a modification of this permit.

<u>SPECIAL CONDITION 5</u>. The following zebra mussel control programs are authorized by this permit, in accordance with the conditions and limitations below.

A. Chlorination/Dechlorination

- 1. Chlorine or chlorine compounds may be applied on an intermittent or continuous basis.
- 2. The discharge shall be dechlorinated.
- 3. The discharge limit is 0.05 mg/l total residual chlorine.

Special Conditions

- 4. Dechlorination chemical(s) shall be applied at a rate sufficient to provide complete dechlorination; excess application should be avoided to the extent practicable. The dechlorination system shall be interlocked or otherwise controlled to operate whenever chlorination is occurring.
- 5. For continuous chlorination programs, or intermittent chlorination more frequent than once per week, the residual shall be monitored on a twice-daily basis for the first five days of the control program, twice per week for the following three weeks, and weekly thereafter. The more frequent initial monitoring program shall be implemented when restarting the treatment program each spring, if treatment is suspended during the winter. For intermittent chlorination once per week or less frequently, each chlorine application shall be monitored. Monitoring shall be by a grab sample at the time of maximum chlorine application. All samples for TRC shall be analyzed by an applicable method contained in 40 CFR 136, equivalent in accuracy to low-level amperometric filtration. Any analytical variability of the method used shall be considered when determining the accuracy and precision of the results obtained.

B. Bromination/Debromination

- Bromine compounds may be applied subject to all the conditions described above for a chlorination program including dehalogenation and monitoring.
- 2. The discharge limit is 0.05 mg/l total residual halogen.
- 3. Bromine formulations which contain a surfactant may only be used on an intermittent basis (2 hours or less per day).

The sampling requirements listed above are only required when the facility is using chlorine and/or bromine for treatment. If chlorine and/or bromine are not being used such information shall be included on the DMR.

<u>SPECIAL CONDITION 6</u>. Grab samples for monitoring stormwater shall be collected within the first thirty minutes of discharge from a storm event. A storm event shall be defined as rainfall that is greater than 0.1 inches and at least 72 hours from the previously measurable (greater than 0.1 inch rainfall) storm event.

<u>SPECIAL CONDITION 7.</u> Samples taken in compliance with the effluent monitoring requirements shall be taken at a point representative of the discharge but prior to entry into the receiving stream.

SPECIAL CONDITION 8. If an applicable effluent standard or limitation is promulgated under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a)(2) of the Clean Water Act and that effluent standard or limitation is more stringent than any effluent limitation in the permit or controls a pollutant not limited in the NPDES Permit, the Agency shall revise or modify the permit in accordance with the more stringent standard or prohibition and shall so notify the permittee.

<u>SPECIAL CONDITION 9</u>. The effluent, alone or in combination with other sources, shall not cause a violation of any applicable water quality standard outlined in 35 III. Adm. Code 302.

<u>SPECIAL CONDITION 10</u>. In addition to the Storm Water Pollution Prevention Plan, a Best Management Practices (BMP) program shall be developed and implemented to specifically address the stormwater discharge from outfall 009. The BMP shall be designed to reduce the levels of pollutants (specifically BOD_5 , oil & grease, COD and phosphorus) in the stormwater. The BMP shall attempt to identify pollutant sources and minimize the potential for contamination.

A report summarizing and outlining the BMP shall be submitted to IEPA within 180 days of the issue date of this permit. Within one year of the issue date, the BMP shall be fully implemented and a report submitted to IEPA indicating the status of final compliance. Annual reports shall be submitted thereafter and shall include a summary of the monitoring data collected at outfall 009 during the previous year. All reports shall be submitted to the Agency address identified under Special Condition 13.

<u>SPECIAL CONDITION 11</u>. The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) Forms using one such form for each outfall each month.

The Permittee may choose to submit electronic DMRs (eDMRs) instead of mailing paper DMRs to the IEPA. More information, including registration information for the eDMR program, can be obtained on the IEPA website, http://www.epa.state.il.us/water/edmr/index.html.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 15th day of the following month, unless otherwise specified by the permitting authority.

Special Conditions

Permittees not using eDMRs shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency Division of Water Pollution Control Attention: Compliance Assurance Section, Mail Code # 19 1021 North Grand Avenue East Post Office Box 19276 Springfield, Illinois 62794-9276

<u>SPECIAL CONDITION 12.</u> Within 180 days of the issue date of this permit, the permittee shall submit to the Agency a completed Form 2F for the stormwater discharges from this facility. The Form 2F submitted shall include analytical data from both grab and composite samples, collected and analyzed as outlined in the Form 2F instructions, for outfalls 002, 005, 006, 007, 008, 009 and 010. Samples collected for outfall 002 must be collected at a point representative of the stormwater discharge but prior to mixing with the non-contact cooling water wastestream. Both Form 2C and Form 2F must be submitted for renewal of this permit.

SPECIAL CONDITION 13.

STORM WATER POLLUTION PREVENTION PLAN (SWPPP)

- A. A storm water pollution prevention plan shall be maintained by the permittee for the storm water associated with industrial activity at this facility. The plan shall identify potential sources of pollution which may be expected to affect the quality of storm water discharges associated with the industrial activity at the facility. In addition, the plan shall describe and ensure the implementation of practices which are to be used to reduce the pollutants in storm water discharges associated with industrial activity at the facility and to assure compliance with the terms and conditions of this permit. The permittee shall modify the plan if substantive changes are made or occur affecting compliance with this condition.
 - 1. Waters not classified as impaired pursuant to Section 303(d) of the Clean Water Act.
 - Unless otherwise specified by federal regulation, the storm water pollution prevention plan shall be designed for a storm event equal to or greater than a 25-year 24-hour rainfall event.
 - 2. Waters classified as impaired pursuant to Section 303(d) of the Clean Water Act
 - For any site which discharges directly to an impaired water identified in the Agency's 303(d) listing, and if any parameter in the subject discharge has been identified as the cause of impairment, the storm water pollution prevention plan shall be designed for a storm event equal to or greater than a 25-year 24-hour rainfall event. If required by federal regulations, the storm water pollution prevention plan shall adhere to a more restrictive design criteria.
- B. The operator or owner of the facility shall make a copy of the plan available to the Agency at any reasonable time upon request.
 - Facilities which discharge to a municipal separate storm sewer system shall also make a copy available to the operator of the municipal system at any reasonable time upon request.
- C. The permittee may be notified by the Agency at any time that the plan does not meet the requirements of this condition. After such notification, the permittee shall make changes to the plan and shall submit a written certification that the requested changes have been made. Unless otherwise provided, the permittee shall have 30 days after such notification to make the changes.
- D. The discharger shall amend the plan whenever there is a change in construction, operation, or maintenance which may affect the discharge of significant quantities of pollutants to the waters of the State or if a facility inspection required by paragraph H of this condition indicates that an amendment is needed. The plan should also be amended if the discharger is in violation of any conditions of this permit, or has not achieved the general objective of controlling pollutants in storm water discharges. Amendments to the plan shall be made within 30 days of any proposed construction or operational changes at the facility, and shall be provided to the Agency for review upon request.
- E. The plan shall provide a description of potential sources which may be expected to add significant quantities of pollutants to storm water discharges, or which may result in non-storm water discharges from storm water outfalls at the facility. The plan shall include, at a minimum, the following items:
 - 1. A topographic map extending one-quarter mile beyond the property boundaries of the facility, showing: the facility, surface water bodies, wells (including injection wells), seepage pits, infiltration ponds, and the discharge points where the facility's storm water discharges to a municipal storm drain system or other water body. The requirements of this paragraph may be

Special Conditions

included on the site map if appropriate. Any map or portion of map may be withheld for security reasons.

- A site map showing:
 - The storm water conveyance and discharge structures;
 - An outline of the storm water drainage areas for each storm water discharge point;
 - iii. Paved areas and buildings;
 - iv. Areas used for outdoor manufacturing, storage, or disposal of significant materials, including activities that generate significant quantities of dust or particulates.
 - v. Location of existing storm water structural control measures (dikes, coverings, detention facilities, etc.);
 - vi. Surface water locations and/or municipal storm drain locations
 - vii. Areas of existing and potential soil erosion;
 - viii. Vehicle service areas;
 - ix. Material loading, unloading, and access areas.
 - Areas under items iv and ix above may be withheld from the site for security reasons.
- 3. A narrative description of the following:
 - i. The nature of the industrial activities conducted at the site, including a description of significant materials that are treated, stored or disposed of in a manner to allow exposure to storm water;
 - ii. Materials, equipment, and vehicle management practices employed to minimize contact of significant materials with storm water discharges;
 - iii. Existing structural and non-structural control measures to reduce pollutants in storm water discharges;
 - iv. Industrial storm water discharge treatment facilities;
 - v. Methods of onsite storage and disposal of significant materials.
- 4. A list of the types of pollutants that have a reasonable potential to be present in storm water discharges in significant quantities. Also provide a list of any pollutant that is listed as impaired in the most recent 303(d) report.
- 5. An estimate of the size of the facility in acres or square feet, and the percent of the facility that has impervious areas such as pavement or buildings.
- 6. A summary of existing sampling data describing pollutants in storm water discharges.
- F. The plan shall describe the storm water management controls which will be implemented by the facility. The appropriate controls shall reflect identified existing and potential sources of pollutants at the facility. The description of the storm water management controls shall include:
 - 1. Storm Water Pollution Prevention Personnel Identification by job titles of the individuals who are responsible for developing, implementing, and revising the plan.
 - 2. Preventive Maintenance Procedures for inspection and maintenance of storm water conveyance system devices such as oil/water separators, catch basins, etc., and inspection and testing of plant equipment and systems that could fail and result in discharges of pollutants to storm water.
 - Good Housekeeping Good housekeeping requires the maintenance of clean, orderly facility areas that discharge storm water. Material handling areas shall be inspected and cleaned to reduce the potential for pollutants to enter the storm water conveyance system.

Special Conditions

- 4. Spill Prevention and Response Identification of areas where significant materials can spill into or otherwise enter the storm water conveyance systems and their accompanying drainage points. Specific material handling procedures, storage requirements, spill cleanup equipment and procedures should be identified, as appropriate. Internal notification procedures for spills of significant materials should be established.
- 5. Storm Water Management Practices Storm water management practices are practices other than those which control the source of pollutants. They include measures such as installing oil and grit separators, diverting storm water into retention basins, etc. Based on assessment of the potential of various sources to contribute pollutants, measures to remove pollutants from storm water discharge shall be implemented. In developing the plan, the following management practices shall be considered:
 - i. Containment Storage within berms or other secondary containment devices to prevent leaks and spills from entering storm water runoff. To the maximum extent practicable storm water discharged from any area where material handling equipment or activities, raw material, intermediate products, final products, waste materials, by-products, or industrial machinery are exposed to storm water should not enter vegetated areas or surface waters or infiltrate into the soil unless adequate treatment is provided.
 - ii. Oil & Grease Separation Oil/water separators, booms, skimmers or other methods to minimize oil contaminated storm water discharges.
 - iii. Debris & Sediment Control Screens, booms, sediment ponds or other methods to reduce debris and sediment in storm water discharges.
 - iv. Waste Chemical Disposal Waste chemicals such as antifreeze, degreasers and used oils shall be recycled or disposed of in an approved manner and in a way which prevents them from entering storm water discharges.
 - v. Storm Water Diversion Storm water diversion away from materials manufacturing, storage and other areas of potential storm water contamination. Minimize the quantity of storm water entering areas where material handling equipment of activities, raw material, intermediate products, final products, waste materials, by-products, or industrial machinery are exposed to storm water using green infrastructure techniques where practicable in the areas outside the exposure area, and otherwise divert storm water away from exposure area.
 - vi. Covered Storage or Manufacturing Areas Covered fueling operations, materials manufacturing and storage areas to prevent contact with storm water.
 - vii. Storm Water Reduction Install vegetation on roofs of buildings within adjacent to the exposure area to detain and evapotranspirate runoff where precipitation falling on the roof is not exposed to contaminants, to minimize storm water runoff; capture storm water in devices that minimize the amount of storm water runoff and use this water as appropriate based on quality.
- 6. Sediment and Erosion Prevention The plan shall identify areas which due to topography, activities, or other factors, have a high potential for significant soil erosion. The plan shall describe measures to limit erosion.
- 7. Employee Training Employee training programs shall inform personnel at all levels of responsibility of the components and goals of the storm water pollution control plan. Training should address topics such as spill response, good housekeeping and material management practices. The plan shall identify periodic dates for such training.
- 8. Inspection Procedures Qualified plant personnel shall be identified to inspect designated equipment and plant areas. A tracking or follow-up procedure shall be used to ensure appropriate response has been taken in response to an inspection. Inspections and maintenance activities shall be documented and recorded.
- G. Non-Storm Water Discharge The plan shall include a certification that the discharge has been tested or evaluated for the presence of non-storm water discharge. The certification shall include a description of any test for the presence of non-storm water discharges, the methods used, the dates of the testing, and any onsite drainage points that were observed during the testing. Any facility that is unable to provide this certification must describe the procedure of any test conducted for the presence of non-storm water discharges, the test results, potential sources of non-storm water discharges to the storm sewer, and why adequate tests for such storm sewers were not feasible.
- H. Quarterly Visual Observation of Discharges The requirements and procedures for quarterly visual observations are applicable to all outfalls covered by this condition.

Special Conditions

- 1. You must perform and document a quarterly visual observation of a storm water discharge associated with industrial activity from each outfall. The visual observation must be made during daylight hours. If no storm event resulted in runoff during daylight hours from the facility during a monitoring quarter, you are excused from the visual observations requirement for that quarter, provided you document in your records that no runoff occurred. You must sign and certify the document.
- 2. Your visual observation must be made on samples collected as soon as practical, but not to exceed 1 hour or when the runoff or snow melt begins discharging from your facility. All samples must be collected from a storm event discharge that is greater than 0.1 inch in magnitude and that occurs at least 72 hours from the previously measureable (greater than 0.1 inch rainfall) storm event. The observation must document: color, odor, clarity, floating solids, settled solids, suspended solids, foam, oil sheen, and other obvious indicators of storm water pollution. If visual observations indicate any unnatural color, odor, turbidity, floatable material, oil sheen or other indicators of storm water pollution, the permittee shall obtain a sample and monitor for the parameter or the list of pollutants in Part E.4.
- 3. You must maintain your visual observation reports onsite with the SWPPP. The report must include the observation date and time, inspection personnel, nature of the discharge (i.e., runoff or snow melt), visual quality of the storm water discharge (including observations of color, odor, floating solids, settled solids, suspended solids, foam, oil sheen, and other obvious indicators of storm water pollution), and probable sources of any observed storm water contamination.
- 4. You may exercise a waiver of the visual observation requirement at a facility that is inactive or unstaffed, as long as there are no industrial materials or activities exposed to storm water. If you exercise this waiver, you must maintain a certification with your SWPPP stating that the site is inactive and unstaffed, and that there are no industrial materials or activities exposed to storm water.
- 5. Representative Outfalls If your facility has two or more outfalls that you believe discharge substantially identical effluents, based on similarities of the industrial activities, significant materials, size of drainage areas, and storm water management practices occurring within the drainage areas of the outfalls, you may conduct visual observations of the discharge at just one of the outfalls and report that the results also apply to the substantially identical outfall(s).
- 6. The visual observation documentation shall be made available to the Agency and general public upon written request.
- I. The permittee shall conduct an annual facility inspection to verify that all elements of the plan, including the site map, potential pollutant sources, and structural and non-structural controls to reduce pollutants in industrial storm water discharges are accurate. Observations that require a response and the appropriate response to the observation shall be retained as part of the plan. Records documenting significant observations made during the site inspection shall be submitted to the Agency in accordance with the reporting requirements of this permit.
- J. This plan should briefly describe the appropriate elements of other program requirements, including Spill Prevention Control and Countermeasures (SPCC) plans required under Section 311 of the CWA and the regulations promulgated there under, and Best Management Programs under 40 CFR 125.100.
- K. The plan is considered a report that shall be available to the public at any reasonable time upon request.
- L. The plan shall include the signature and title of the person responsible for preparation of the plan and include the date of initial preparation and each amendment thereto.
- M. Facilities which discharge storm water associated with industrial activity to municipal separate storm sewers may also be subject to additional requirement imposed by the operator of the municipal system

Construction Authorization

Authorization is hereby granted to construct treatment works and related equipment that may be required by the Storm Water Pollution Prevention Plan developed pursuant to this permit.

This Authorization is issued subject to the following condition(s).

- N. If any statement or representation is found to be incorrect, this authorization may be revoked and the permittee there upon waives all rights there under.
- O. The issuance of this authorization (a) does not release the permittee from any liability for damage to persons or property caused by or resulting from the installation, maintenance or operation of the proposed facilities; (b) does not take into consideration the

Special Conditions

structural stability of any units or part of this project; and (c) does not release the permittee from compliance with other applicable statutes of the State of Illinois, or other applicable local law, regulations or ordinances.

- P. Plans and specifications of all treatment equipment being included as part of the stormwater management practice shall be included in the SWPPP.
- Q. Construction activities which result from treatment equipment installation, including clearing, grading and excavation activities which result in the disturbance of one acre or more of land area, are not covered by this authorization. The permittee shall contact the IEPA regarding the required permit(s).

REPORTING

- R. The facility shall submit an electronic copy of the annual inspection report to the Illinois Environmental Protection Agency. The report shall include results of the annual facility inspection which is required by Part I of this condition. The report shall also include documentation of any event (spill, treatment unit malfunction, etc.) which would require an inspection, results of the inspection, and any subsequent corrective maintenance activity. The report shall be completed and signed by the authorized facility employee(s) who conducted the inspection(s). The annual inspection report is considered a public document that shall be available at any reasonable time upon request.
- S. The first report shall contain information gathered during the one year time period beginning with the effective date of coverage under this permit and shall be submitted no later than 60 days after this one year period has expired. Each subsequent report shall contain the previous year's information and shall be submitted no later than one year after the previous year's report was due.
- T. If the facility performs inspections more frequently than required by this permit, the results shall be included as additional information in the annual report.
- U. The permittee shall retain the annual inspection report on file at least 3 years. This period may be extended by request of the Illinois Environmental Protection Agency at any time.

Annual inspection reports shall be mailed to the following address:

Illinois Environmental Protection Agency Bureau of Water - Compliance Assurance Section Annual Inspection Report 1021 North Grand Avenue East Post Office Box 19276 Springfield, Illinois 62794-9276

V. The permittee shall notify any regulated small municipal separate storm sewer owner (MS4 Community) that they maintain coverage under an individual NPDES permit. The permittee shall submit any SWPPP or any annual inspection to the MS4 community upon request by the MS4 community.

<u>SPECIAL CONDITION 14.</u> This permit authorizes the use of water treatment additives that were requested as part of this renewal. The use of any new additives, or change in those previously approved by the Agency, or if the permittee increases the feed rate or quantity of the additives used beyond what has been approved by the Agency, the permittee shall request a modification of this permit in accordance with Standard Conditions - Attachment H.

<u>SPECIAL CONDITION 15</u>. In order for the Agency to evaluate the potential impacts of cooling water intake structure operations pursuant to 40 CFR 125.90(b), the permittee shall prepare and submit information to the Agency outlining current intake structure conditions at this facility, including a detailed description of the current intake structure operation and design, description of any operational or structural modifications from original design parameters, source waterbody flow information, or other information as necessary.

The information shall also include a summary of historical 316(b) related intake impingement and / or entrainment studies, if any, as well as current impingement mortality and / or entrainment characterization data; and shall be submitted to the Agency within six (6) months of the permit's effective date.

Upon the receipt and review of this information, the permit may be modified to require the submittal of additional information based on a Best Professional Judgment review by the Agency. This permit may also be revised or modified in accordance with any laws, regulations, or judicial orders pursuant to Section 316(b) of the Clean Water Act.