

NPDES Permit No. IL0073806  
Notice No. LRL:13031501.daa

Public Notice Beginning Date: **June 26, 2013**

Public Notice Ending Date: **July 26, 2013**

National Pollutant Discharge Elimination System (NPDES)  
Permit Program

Draft Reissued NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois Environmental Protection Agency  
Bureau of Water  
Division of Water Pollution Control  
Permit Section  
1021 North Grand Avenue East  
Post Office Box 19276  
Springfield, Illinois 62794-9276  
217/782-0610

Name and Address of Discharger:

Dynegy Kendall Energy, LLC  
604 Pierce Blvd.  
O'Fallon, Illinois 62269

Name and Address of Facility:

Dynegy Kendall Energy, LLC  
1401 County Line Road  
Minooka, Illinois 60447  
(Kendall County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES permit to discharge into the waters of the state and has prepared a draft permit and associated fact sheet for the above named discharger. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. The last day comments will be received will be on the Public Notice period ending date unless a commentor demonstrating the need for additional time requests an extension to this comment period and the request is granted by the IEPA. Interested persons are invited to submit written comments on the draft permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the permit applicant. The NPDES permit and notice number(s) must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicate a significant degree of public interest in the draft permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final permit is issued. For further information, please call Leslie Lowry at 217/782-0610.

The applicant is engaged in operating a nominal 1,200 megawatt natural gas fired combined cycle electric generation station (SIC 4911). Plant operation results in an average discharge of 1.4 MGD of cooling tower blowdown from internal outfall A01, 1.5 MGD of cooling tower blowdown, plant drains, building drains, reverse osmosis wastewater, and mixed bed regeneration from outfall 001, and an intermittent discharge of stormwater and emergency raw water pond overflow from outfall 002.

Application is made for existing discharges which are located in Kendall County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

<u>Outfall</u>	<u>Receiving Stream</u>	<u>Latitude</u>		<u>Longitude</u>		<u>Stream Classification</u>	<u>Integrity Rating</u>
001	Illinois River	41° 24' 10"	North	88° 16' 30"	West	General Use	B
002	Unnamed Tributary of the DuPage River	41° 28' 40"	North	88° 15' 10"	West	General Use	Not Rated

To assist you further in identifying the location of the discharge please see the attached map.

The stream segment D-10 receiving the discharge from outfall 001 is on the 2012 303(d) list of impaired waters and is not a biologically significant stream on the 2008 Illinois Department of Natural Resources Publication – *Integrating Multiple Taxa in a Biological Stream Rating System*.

The following parameters have been identified as the pollutants causing impairment:

<u>Potential Cause:</u>	<u>Designated Use:</u>
Mercury and Polychlorinated Biphenyls	Fish Consumption

The stream segment receiving the discharge from outfall 002 is not on the 2012 303(d) list of impaired waters and is not a biologically significant stream on the 2008 Illinois Department of Natural Resources Publication – *Integrating Multiple Taxa in a Biological Stream Rating System*.

The discharges from the facility shall be monitored and limited at all times as follows:

	<u>LOAD LIMITS lbs/day</u> <u>DAF (DMF)</u>			<u>CONCENTRATION</u> <u>LIMITS mg/l</u>		
PARAMETER	30 DAY AVERAGE	DAILY MAXIMUM	REGULATION	30 DAY AVERAGE	DAILY MAXIMUM	REGULATION
<u>Outfall 001:</u>						
Flow (MGD)						
pH				6 – 9 s.u.		35 IAC 304.125
Temperature						35 IAC 302.211
Total Residual Chlorine					0.05	40 CFR 125.3 and 35 IAC 302.208
Total Suspended Solids	188	800	35 IAC 304.124	15	30	35 IAC 304.124
Oil and Grease	188	534	40 CFR 423.13	15	20	40 CFR 423.13
Copper	6.3	27	35 IAC 304.124	0.5	1	35 IAC 304.124
Iron	25	107	35 IAC 304.124	2	4	35 IAC 304.124
Chlorides				Monitor Only		
Sulfate				Monitor Only		
Silver				Monitor Only		
Fluoride				Monitor Only		

PARAMETER	LOAD LIMITS lbs/day <u>DAF (DMF)</u>		REGULATION	CONCENTRATION <u>LIMITS mg/l</u>		REGULATION
	30 DAY AVERAGE	DAILY MAXIMUM		30 DAY AVERAGE	DAILY MAXIMUM	
<u>Outfall A01:</u>						
Flow (MGD)						
pH				6 – 9 s.u.		35 IAC 304.125
Chromium (Total)	2.3	4.7	40 CFR 423.15	0.2	0.2	40 CFR 423.15
Zinc	12	23	40 CFR 423.15	1	1	40 CFR 423.15
<u>Outfall 002:</u>						
SWPPP						

## Load Limit Calculations:

- A. Internal outfall A01 load limit calculations for the following pollutant parameters were based on an average flow of 1.4 MGD and a maximum flow of 2.8 MGD using the formula of average or maximum flow (MGD) X concentration limit (mg/l) X 8.34 = the average or maximum load limit (lbs/day): Chromium (Total) and Zinc.
- B. Outfall 001 load limit calculations for the following pollutant parameters were based on an average flow of 1.5 MGD and a maximum flow of 3.2 MGD using the formula of average or maximum flow (MGD) X concentration limit (mg/l) X 8.34 = the average or maximum load limit (lbs/day): Total Suspended Solids, Oil and Grease, Copper, and Iron.

The load limits appearing in the permit will be the more stringent of the State and Federal Guidelines.

The following explain the conditions of the proposed permit:

The Special Conditions clarify flow, pH, temperature, total residual chlorine, monitoring location, class K operator, biomonitoring, discharge monitoring report submission, and stormwater.

The facility has not been granted additional thermal relief and must comply with existing thermal water quality standards as found in 35 IAC 302.211 at the edge of the mixing zone. See Special Condition 3 for the temperature special condition.



The station's water intake comes from Illinois River and groundwater, with 99.9% coming from the river and 0.1% comes from groundwater. The intake is located 7 miles from the plant. The cooling towers use 90% of the incoming water. Of this 90%, 40 – 50% is evaporated. The remaining water is either recirculated or becomes blowdown which is eventually discharged back to the river. In drought conditions when the river level is below the INDR permitted flow, water can be withdrawn from a 22 acre raw water storage pond. The station's intake structure is located on the north shoreline of the backwater pool of the Dresden Island Lock and Dam, (Illinois River mile 271.6). The intake line extends approximately 50 feet into the Illinois River. The water supply inlet is located 485 MSL. The Illinois River water level is at 504.54 MSL.

The intake structure consists of a 30" HPDE intake line contained in a 36" steel carrier pipe with a prefabricated 42" x 30" tee screen under the suction capsule to prevent large debris from entering the intake line. The suction capsule is a tetrahedron-shaped screen material. The intake line has a 4" HPDE air line running along the intake pipe, and carries compressed air from a skid in the pump house. Blasts of compressed air, which last for a few minutes, are injected every 7 days. The injection system has been out of service since 2009 without any adverse impact, at this time.

Three 400 HP, 480 volt, 3-phase pumps are used to withdraw water from the river. Each pump is rated at 2,500 gpm (5.6 cfs). The number of pumps in service at any moment depends on station operating conditions. The station typically operates two river pumps but can use three pumps if necessary. The intake velocity is 8,500 gpm at < 0.5 fps slot velocity.

The facility utilizes a closed-cycle recirculating cooling system, cooling towers, for cooling of plant condensers and is determined to be the equivalent of Best Technology Available (BTA) for cooling water intake structures to prevent/minimize impingement mortality in

accordance with the Best Professional Judgment (BPJ) provisions of 40 CFR 125.3 because it allows the facility to only withdraw the amount of water necessary for cooling of the plant condensers. Special Condition 16 recognizes the submittal of cooling water intake structure operational information.

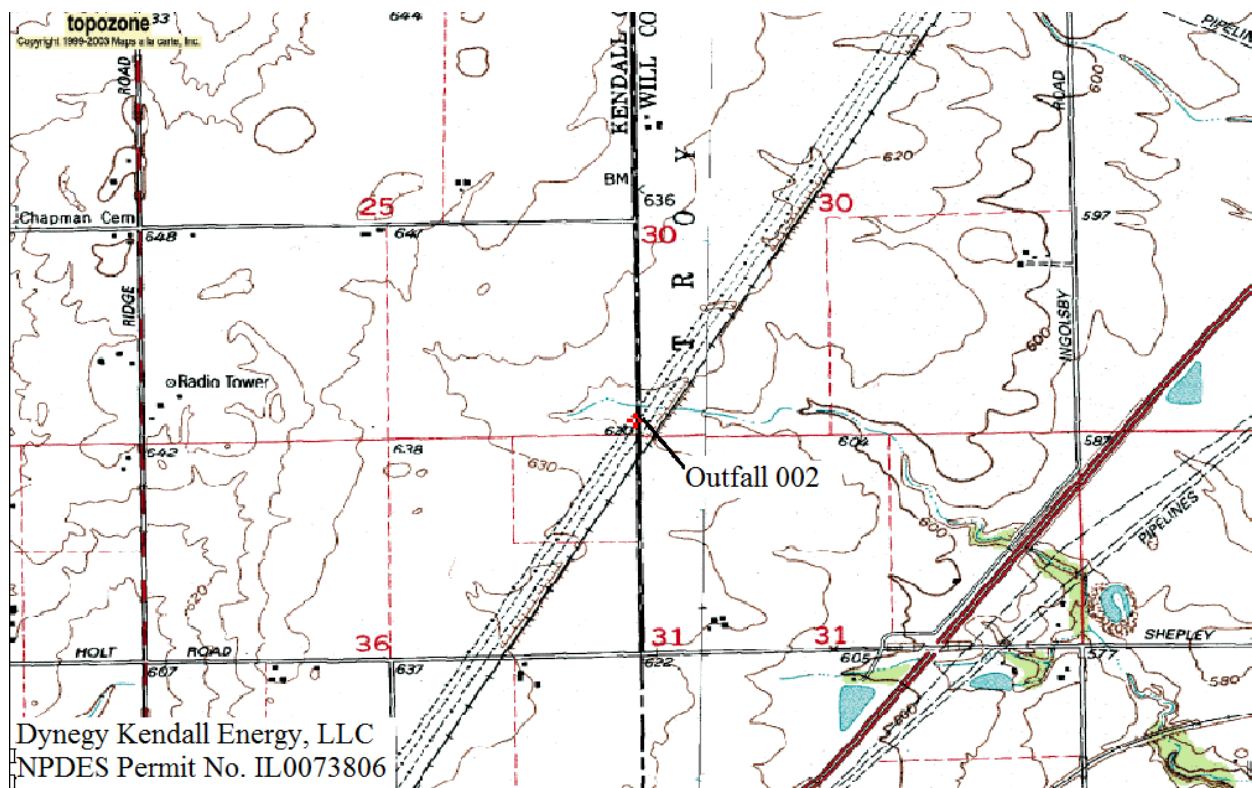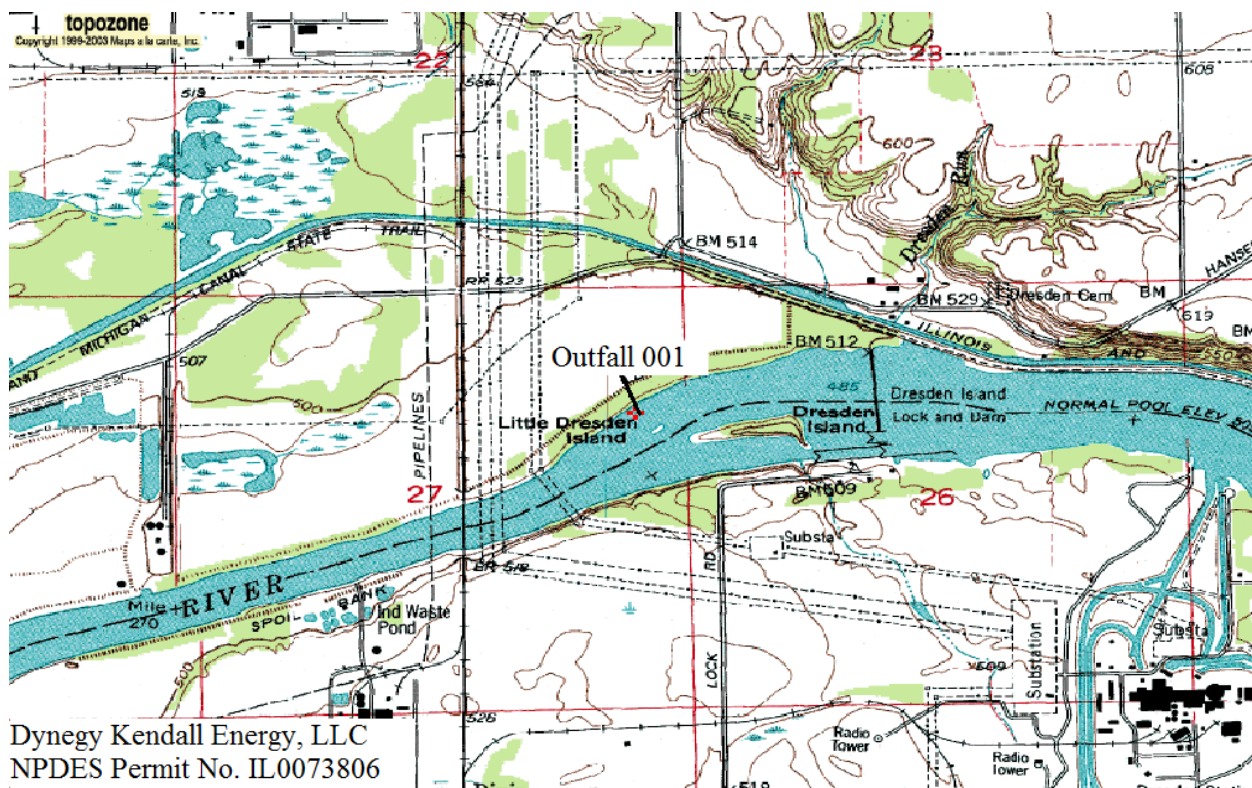

NPDES Permit No. IL0073806

Illinois Environmental Protection Agency

Division of Water Pollution Control

1021 North Grand Avenue East

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Reissued (NPDES) Permit

Expiration Date:

Issue Date:

Effective Date:

Name and Address of Permittee:

Facility Name and Address:

Dynegy Kendall Energy, LLC  
604 Pierce Blvd.  
O'Fallon, Illinois 62269

Dynegy Kendall Energy, LLC  
1401 County Line Road  
Minooka, Illinois 60447  
(Kendall County)

Discharge Number and Name:

Receiving Waters:

001 Cooling Tower Blowdown, Plant Drains, Building Drains,  
Reverse Osmosis Wastewater, and Mixed Bed  
Regeneration

Illinois River

A01 Cooling Tower Blowdown

002 Stormwater and Emergency Raw Water Pond Overflow

Unnamed Tributary to the DuPage River

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of Ill. Adm. Code, Subtitle C and/or Subtitle D, Chapter 1, and the Clean Water Act (CWA), the above-named permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the standard conditions and attachments herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Alan Keller, P.E.  
Manager, Permit Section  
Division of Water Pollution Control

SAK:LRL:13031501.daa

## NPDES Permit No. IL0073806

Effluent Limitations and Monitoring

1. From the effective date of this permit until the expiration date, the effluent of the following discharges shall be monitored and limited at all times as follows:

	LOAD LIMITS lbs/day DAF (DMF)		CONCENTRATION LIMITS mg/l			
PARAMETER	30 DAY AVERAGE	DAILY MAXIMUM	30 DAY AVERAGE	DAILY MAXIMUM	SAMPLE FREQUENCY	SAMPLE TYPE
Outfall 001 – Cooling Tower Blowdown, Plant Drains, Building Drains, Reverse Osmosis Wastewater, and Mixed Bed Regeneration* (Average Flow = 1.5 MGD)						
Flow (MGD)	See Special Condition 1.				Daily	Continuous
pH	See Special Condition 2.				1/Month	Grab
Temperature	See Special Condition 3.				1/Week	Single Reading
Total Residual Chlorine	See Special Condition 4.			0.05	1/Month	Composite
Total Suspended Solids	188	800	15	30	1/Month	Composite
Oil and Grease	188	534	15	20	1/Month	Composite
Copper	6.3	27	0.5	1	1/Month	Composite
Iron	25	107	2	4	1/Month	Composite
Chlorides			Monitor Only		2/Year**	Grab
Sulfate			Monitor Only		2/Year**	Grab
Silver			Monitor Only		2/Year**	Grab
Fluoride			Monitor Only		2/Year**	Grab
* - See Special Condition 11. ** - See Special Condition 13.						
Outfall A01 – Cooling Tower Blowdown* (Average Flow = 1.4 MGD)						
Flow	See Special Condition 1.				Daily	Continuous
pH	See Special Condition 2.				1/Month	Grab
Chromium (Total)	2.3	4.7	0.2	0.2	1/Month	Composite
Zinc	12	23	1	1	1/Month	Composite
* - See Special Condition 8 and 12.						

NPDES Permit No. IL0073806

Effluent Limitations and Monitoring

1. From the effective date of this permit until the expiration date, the effluent of the following discharges shall be monitored and limited at all times as follows:

PARAMETER	LOAD LIMITS lbs/day <u>DAF (DMF)</u>		CONCENTRATION <u>LIMITS mg/l</u>		SAMPLE FREQUENCY	SAMPLE TYPE
	30 DAY AVERAGE	DAILY MAXIMUM	30 DAY AVERAGE	DAILY MAXIMUM		
<u>Outfall 002</u> – Stormwater* and Emergency Raw Water Pond Overflow (Intermittent Discharge)						
* - See Special Condition 15.						

NPDES Permit No. IL0073806

Special Conditions

SPECIAL CONDITION 1. Flow shall be measured in units of Million Gallons per Day (MGD) and reported as a monthly average and a daily maximum on the Discharge Monitoring Report.

SPECIAL CONDITION 2. The pH shall be in the range 6.0 to 9.0. The monthly minimum and monthly maximum values shall be reported on the DMR form.

SPECIAL CONDITION 3. This facility meets the allowed mixing criteria for thermal discharges pursuant to 35 IAC 302.102. No reasonable potential exists for the discharge to exceed thermal water quality standards. This determination is based a design average flow of 1.5 MGD and a maximum temperature of 84°F. The permittee shall monitor the flow and temperature of the discharge prior to entry into the receiving water body. Monitoring results shall be reported on the monthly Discharge Monitoring Report. This permit may be modified to include formal temperature limitations should the results of the monitoring show that there is reasonable potential to exceed a thermal water quality standard. Modification of this permit shall follow public notice and opportunity for comment.

There shall be no abnormal temperature changes that may adversely affect aquatic life unless caused by natural conditions. The normal daily and seasonal temperature fluctuations which existed before the addition of heat due to other than natural causes shall be maintained.

The monthly maximum value shall be reported on the DMR form.

SPECIAL CONDITION 4. All samples for Total Residual Chlorine shall be analyzed by an applicable method contained in 40 CFR 136, equivalent in accuracy to low-level amperometric titration or other methods found in Standard Methods for Examination of Water and Wastewater, current edition. Any analytical variability of the method used shall be considered when determining the accuracy and precision of the results.

SPECIAL CONDITION 5. Samples taken in compliance with the effluent monitoring requirements shall be taken at a point representative of the discharge, but prior to entry into the receiving stream.

SPECIAL CONDITION 6. The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) Forms using one such form for each outfall each month.

In the event that an outfall does not discharge during a monthly reporting period, the DMR Form shall be submitted with no discharge indicated.

The Permittee may choose to submit electronic DMRs (eDMRs) instead of mailing paper DMRs to the IEPA. More information, including registration information for the eDMR program, can be obtained on the IEPA website, <http://www.epa.state.il.us/water/edmr/index.html>.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 15th day of the following month, unless otherwise specified by the permitting authority.

Permittees not using eDMRs shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency  
Division of Water Pollution Control  
1021 North Grand Avenue East  
Post Office Box 19276  
Springfield, Illinois 62794-9276

Attention: Compliance Assurance Section, Mail Code # 19

SPECIAL CONDITION 7. There shall be no discharge of polychlorinated compounds (PCBs) such as those used for transformer fluid.

SPECIAL CONDITION 8. The discharge of 126 priority pollutants except for chromium and zinc (40 CFR 423, Appendix A) is prohibited in detectable amounts from cooling tower discharges if the pollutants come from cooling tower maintenance chemicals.

SPECIAL CONDITION 9. If an applicable effluent standard or limitation is promulgated under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a)(2) of the Clean Water Act and that effluent standard or limitation is more stringent than any effluent limitation in the permit or controls a pollutant not limited in the NPDES Permit, the Agency shall revise or modify the permit in accordance with the more stringent standard or prohibition and shall so notify the permittee.

SPECIAL CONDITION 10. The use or operation of this facility shall be by or under the supervision of a Certified Class K operator.



NPDES Permit No. IL0073806

Special Conditions

SPECIAL CONDITION 11. The Permittee shall conduct annual biomonitoring of the effluent from Outfall 001.

Biomonitoring

1. Acute Toxicity - Standard definitive acute toxicity tests shall be run on at least two trophic levels of aquatic species (fish, invertebrate) representative of the aquatic community of the receiving stream. Testing must be consistent with Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms (Fifth Ed.) EPA/821-R-02-012. Unless substitute tests are pre-approved; the following tests are required:
  - a. Fish - 96 hour static LC<sub>50</sub> Bioassay using fathead minnows (*Pimephales promelas*).
  - b. Invertebrate 48-hour static LC<sub>50</sub> Bioassay using *Ceriodaphnia*.
2. Testing Frequency - The above tests shall be conducted using 24-hour composite samples unless otherwise authorized by the IEPA. Sample collection and testing must be conducted once per year. When possible, bioassay sample collection should coincide with sample collection for metals analysis or other parameters that may contribute to effluent toxicity.
3. Reporting - Results shall be reported according to EPA/821-R-02-012, Section 12, Report Preparation, and shall be submitted to IEPA, Bureau of Water, Compliance Assurance Section within one week of receipt from the laboratory.
4. Toxicity – Should a bioassay result in toxicity to >20% of organisms tested in the 100% effluent treatment, the IEPA may require, upon notification, six (6) additional rounds of monthly testing on the affected organism(s) to be initiated within 30 days of the toxic bioassay. Results shall be submitted to IEPA within one (1) week of becoming available to the Permittee. Should any of the additional bioassays result in toxicity to ≥50% of organisms tested in the 100% effluent treatments, the Permittee may wish to contact the IEPA to request the discontinuance of further sampling at which time the IEPA may require the Permittee to begin the toxicity reduction evaluation and identification as outlined below.
5. Toxicity Reduction Evaluation - Should any of the additional bioassays result in toxicity to ≥50% of organisms tested in the 100% effluent treatment, the IEPA may require, upon notification, that the Permittee prepare a plan for toxicity reduction evaluation and identification. This plan shall be developed in accordance with Toxicity Reduction Evaluation Guidance for Municipal Wastewater Treatment Plants, EPA/833B-99/002, and shall include an evaluation to determine which chemicals have a potential for being discharged in the plant wastewater, a monitoring program to determine their presence or absence and to identify other compounds which are not being removed by treatment, and other measures as appropriate. The Permittee shall submit to the IEPA its plan for toxicity reduction evaluation within ninety (90) days following notification by the IEPA. The Permittee shall implement the plan within ninety (90) days or other such date as contained in a notification letter received from the IEPA.

The IEPA may modify this Permit during its term to incorporate additional requirements or limitations based on the results of the biomonitoring. In addition, after review of the monitoring results, the IEPA may modify this Permit to include numerical limitations for specific toxic pollutants. Modifications under this condition shall follow public notice and opportunity for hearing.

SPECIAL CONDITION 12. This permit authorizes the use of water treatment additives that were requested as part of this renewal. The use of any new additives, or change in those previously approved by the Agency, or if the permittee increases the feed rate or quantity of the additives used beyond what has been approved by the Agency, the permittee shall request a modification of this permit in accordance with the Standard Conditions – Attachment H.

SPECIAL CONDITION 13. The Permittee shall sample the discharge in January and July. Sample results shall be submitted by the 15th of February and the 15th of August on the Discharge Monitoring Report (DMR).

SPECIAL CONDITION 14. The effluent, alone or in combination with other sources, shall not cause a violation of any applicable water quality standard outlined in 35 Ill. Adm. Code 302.

SPECIAL CONDITION 15.

STORM WATER POLLUTION PREVENTION PLAN (SWPPP)

- A. A storm water pollution prevention plan shall be maintained by the permittee for the storm water associated with industrial activity at this facility. The plan shall identify potential sources of pollution which may be expected to affect the quality of storm water discharges associated with the industrial activity at the facility. In addition, the plan shall describe and ensure the implementation of practices which are to be used to reduce the pollutants in storm water discharges associated with industrial activity at the facility and to assure compliance with the terms and conditions of this permit. The permittee shall modify the plan if substantive changes are made or occur affecting compliance with this condition.

1. Waters not classified as impaired pursuant to Section 303(d) of the Clean Water Act.

NPDES Permit No. IL0073806

Special Conditions

Unless otherwise specified by federal regulation, the storm water pollution prevention plan shall be designed for a storm event equal to or greater than a 25-year 24-hour rainfall event.

2. Waters classified as impaired pursuant to Section 303(d) of the Clean Water Act

For any site which discharges directly to an impaired water identified in the Agency's 303(d) listing, and if any parameter in the subject discharge has been identified as the cause of impairment, the storm water pollution prevention plan shall be designed for a storm event equal to or greater than a 25-year 24-hour rainfall event. If required by federal regulations, the storm water pollution prevention plan shall adhere to a more restrictive design criteria.

B. The operator or owner of the facility shall make a copy of the plan available to the Agency at any reasonable time upon request.

Facilities which discharge to a municipal separate storm sewer system shall also make a copy available to the operator of the municipal system at any reasonable time upon request.

C. The permittee may be notified by the Agency at any time that the plan does not meet the requirements of this condition. After such notification, the permittee shall make changes to the plan and shall submit a written certification that the requested changes have been made. Unless otherwise provided, the permittee shall have 30 days after such notification to make the changes.

D. The discharger shall amend the plan whenever there is a change in construction, operation, or maintenance which may affect the discharge of significant quantities of pollutants to the waters of the State or if a facility inspection required by paragraph H of this condition indicates that an amendment is needed. The plan should also be amended if the discharger is in violation of any conditions of this permit, or has not achieved the general objective of controlling pollutants in storm water discharges. Amendments to the plan shall be made within 30 days of any proposed construction or operational changes at the facility, and shall be provided to the Agency for review upon request.

E. The plan shall provide a description of potential sources which may be expected to add significant quantities of pollutants to storm water discharges, or which may result in non-storm water discharges from storm water outfalls at the facility. The plan shall include, at a minimum, the following items:

1. A topographic map extending one-quarter mile beyond the property boundaries of the facility, showing: the facility, surface water bodies, wells (including injection wells), seepage pits, infiltration ponds, and the discharge points where the facility's storm water discharges to a municipal storm drain system or other water body. The requirements of this paragraph may be included on the site map if appropriate. Any map or portion of map may be withheld for security reasons.

2. A site map showing:

- i. The storm water conveyance and discharge structures;
- ii. An outline of the storm water drainage areas for each storm water discharge point;
- iii. Paved areas and buildings;
- iv. Areas used for outdoor manufacturing, storage, or disposal of significant materials, including activities that generate significant quantities of dust or particulates.
- v. Location of existing storm water structural control measures (dikes, coverings, detention facilities, etc.);
- vi. Surface water locations and/or municipal storm drain locations
- vii. Areas of existing and potential soil erosion;
- viii. Vehicle service areas;
- ix. Material loading, unloading, and access areas.
- x. Areas under items iv and ix above may be withheld from the site for security reasons.

2. A narrative description of the following:

- i. The nature of the industrial activities conducted at the site, including a description of significant materials that are treated, stored or disposed of in a manner to allow exposure to storm water;

NPDES Permit No. IL0073806

Special Conditions

- ii. Materials, equipment, and vehicle management practices employed to minimize contact of significant materials with storm water discharges;
  - iii. Existing structural and non-structural control measures to reduce pollutants in storm water discharges;
  - iv. Industrial storm water discharge treatment facilities;
  - v. Methods of onsite storage and disposal of significant materials.
4. A list of the types of pollutants that have a reasonable potential to be present in storm water discharges in significant quantities. Also provide a list of any pollutant that is listed as impaired in the most recent 303(d) report.
  5. An estimate of the size of the facility in acres or square feet, and the percent of the facility that has impervious areas such as pavement or buildings.
  6. A summary of existing sampling data describing pollutants in storm water discharges.
- F. The plan shall describe the storm water management controls which will be implemented by the facility. The appropriate controls shall reflect identified existing and potential sources of pollutants at the facility. The description of the storm water management controls shall include:
1. Storm Water Pollution Prevention Personnel - Identification by job titles of the individuals who are responsible for developing, implementing, and revising the plan.
  2. Preventive Maintenance - Procedures for inspection and maintenance of storm water conveyance system devices such as oil/water separators, catch basins, etc., and inspection and testing of plant equipment and systems that could fail and result in discharges of pollutants to storm water.
  3. Good Housekeeping - Good housekeeping requires the maintenance of clean, orderly facility areas that discharge storm water. Material handling areas shall be inspected and cleaned to reduce the potential for pollutants to enter the storm water conveyance system.
  4. Spill Prevention and Response - Identification of areas where significant materials can spill into or otherwise enter the storm water conveyance systems and their accompanying drainage points. Specific material handling procedures, storage requirements, spill cleanup equipment and procedures should be identified, as appropriate. Internal notification procedures for spills of significant materials should be established.
  5. Storm Water Management Practices - Storm water management practices are practices other than those which control the source of pollutants. They include measures such as installing oil and grit separators, diverting storm water into retention basins, etc. Based on assessment of the potential of various sources to contribute pollutants, measures to remove pollutants from storm water discharge shall be implemented. In developing the plan, the following management practices shall be considered:
    - i. Containment - Storage within berms or other secondary containment devices to prevent leaks and spills from entering storm water runoff. To the maximum extent practicable storm water discharged from any area where material handling equipment or activities, raw material, intermediate products, final products, waste materials, by-products, or industrial machinery are exposed to storm water should not enter vegetated areas or surface waters or infiltrate into the soil unless adequate treatment is provided.
    - ii. Oil & Grease Separation - Oil/water separators, booms, skimmers or other methods to minimize oil contaminated storm water discharges.
    - iii. Debris & Sediment Control - Screens, booms, sediment ponds or other methods to reduce debris and sediment in storm water discharges.
    - iv. Waste Chemical Disposal - Waste chemicals such as antifreeze, degreasers and used oils shall be recycled or disposed of in an approved manner and in a way which prevents them from entering storm water discharges.
    - v. Storm Water Diversion - Storm water diversion away from materials manufacturing, storage and other areas of potential storm water contamination. Minimize the quantity of storm water entering areas where material handling equipment or activities, raw material, intermediate products, final products, waste materials, by-products, or industrial machinery are exposed to storm water using green infrastructure techniques where practicable in the areas outside the exposure area, and otherwise divert storm water away from exposure area.

NPDES Permit No. IL0073806

Special Conditions

- vi. Covered Storage or Manufacturing Areas - Covered fueling operations, materials manufacturing and storage areas to prevent contact with storm water.
- vii. Storm Water Reduction - Install vegetation on roofs of buildings within adjacent to the exposure area to detain and evapotranspire runoff where precipitation falling on the roof is not exposed to contaminants, to minimize storm water runoff; capture storm water in devices that minimize the amount of storm water runoff and use this water as appropriate based on quality.
- 6. Sediment and Erosion Prevention - The plan shall identify areas which due to topography, activities, or other factors, have a high potential for significant soil erosion. The plan shall describe measures to limit erosion.
- 7. Employee Training - Employee training programs shall inform personnel at all levels of responsibility of the components and goals of the storm water pollution control plan. Training should address topics such as spill response, good housekeeping and material management practices. The plan shall identify periodic dates for such training.
- 8. Inspection Procedures - Qualified plant personnel shall be identified to inspect designated equipment and plant areas. A tracking or follow-up procedure shall be used to ensure appropriate response has been taken in response to an inspection. Inspections and maintenance activities shall be documented and recorded.
- G. Non-Storm Water Discharge - The plan shall include a certification that the discharge has been tested or evaluated for the presence of non-storm water discharge. The certification shall include a description of any test for the presence of non-storm water discharges, the methods used, the dates of the testing, and any onsite drainage points that were observed during the testing. Any facility that is unable to provide this certification must describe the procedure of any test conducted for the presence of non-storm water discharges, the test results, potential sources of non-storm water discharges to the storm sewer, and why adequate tests for such storm sewers were not feasible.
- H. Quarterly Visual Observation of Discharges - The requirements and procedures for quarterly visual observations are applicable to all outfalls covered by this condition.
  - 1. You must perform and document a quarterly visual observation of a storm water discharge associated with industrial activity from each outfall. The visual observation must be made during daylight hours. If no storm event resulted in runoff during daylight hours from the facility during a monitoring quarter, you are excused from the visual observations requirement for that quarter, provided you document in your records that no runoff occurred. You must sign and certify the document.
  - 2. Your visual observation must be made on samples collected as soon as practical, but not to exceed 1 hour or when the runoff or snow melt begins discharging from your facility. All samples must be collected from a storm event discharge that is greater than 0.1 inch in magnitude and that occurs at least 72 hours from the previously measureable (greater than 0.1 inch rainfall) storm event. The observation must document: color, odor, clarity, floating solids, settled solids, suspended solids, foam, oil sheen, and other obvious indicators of storm water pollution. If visual observations indicate any unnatural color, odor, turbidity, floatable material, oil sheen or other indicators of storm water pollution, the permittee shall obtain a sample and monitor for the parameter or the list of pollutants in Part E.4.
  - 3. You must maintain your visual observation reports onsite with the SWPPP. The report must include the observation date and time, inspection personnel, nature of the discharge (i.e., runoff or snow melt), visual quality of the storm water discharge (including observations of color, odor, floating solids, settled solids, suspended solids, foam, oil sheen, and other obvious indicators of storm water pollution), and probable sources of any observed storm water contamination.
  - 4. You may exercise a waiver of the visual observation requirement at a facility that is inactive or unstaffed, as long as there are no industrial materials or activities exposed to storm water. If you exercise this waiver, you must maintain a certification with your SWPPP stating that the site is inactive and unstaffed, and that there are no industrial materials or activities exposed to storm water.
  - 5. Representative Outfalls - If your facility has two or more outfalls that you believe discharge substantially identical effluents, based on similarities of the industrial activities, significant materials, size of drainage areas, and storm water management practices occurring within the drainage areas of the outfalls, you may conduct visual observations of the discharge at just one of the outfalls and report that the results also apply to the substantially identical outfall(s).
  - 6. The visual observation documentation shall be made available to the Agency and general public upon written request.
- I. The permittee shall conduct an annual facility inspection to verify that all elements of the plan, including the site map, potential pollutant sources, and structural and non-structural controls to reduce pollutants in industrial storm water discharges are accurate. Observations that require a response and the appropriate response to the observation shall be retained as part of the plan. Records

NPDES Permit No. IL0073806

Special Conditions

documenting significant observations made during the site inspection shall be submitted to the Agency in accordance with the reporting requirements of this permit.

- J. This plan should briefly describe the appropriate elements of other program requirements, including Spill Prevention Control and Countermeasures (SPCC) plans required under Section 311 of the CWA and the regulations promulgated there under, and Best Management Programs under 40 CFR 125.100.
- K. The plan is considered a report that shall be available to the public at any reasonable time upon request.
- L. The plan shall include the signature and title of the person responsible for preparation of the plan and include the date of initial preparation and each amendment thereto.
- M. Facilities which discharge storm water associated with industrial activity to municipal separate storm sewers may also be subject to additional requirement imposed by the operator of the municipal system

Construction Authorization

Authorization is hereby granted to construct treatment works and related equipment that may be required by the Storm Water Pollution Prevention Plan developed pursuant to this permit.

This Authorization is issued subject to the following condition(s).

- N. If any statement or representation is found to be incorrect, this authorization may be revoked and the permittee there upon waives all rights there under.
- O. The issuance of this authorization (a) does not release the permittee from any liability for damage to persons or property caused by or resulting from the installation, maintenance or operation of the proposed facilities; (b) does not take into consideration the structural stability of any units or part of this project; and (c) does not release the permittee from compliance with other applicable statutes of the State of Illinois, or other applicable local law, regulations or ordinances.
- P. Plans and specifications of all treatment equipment being included as part of the stormwater management practice shall be included in the SWPPP.
- Q. Construction activities which result from treatment equipment installation, including clearing, grading and excavation activities which result in the disturbance of one acre or more of land area, are not covered by this authorization. The permittee shall contact the IEPA regarding the required permit(s).

REPORTING

- R. The facility shall submit an electronic copy of the annual inspection report to the Illinois Environmental Protection Agency. The report shall include results of the annual facility inspection which is required by Part I of this condition. The report shall also include documentation of any event (spill, treatment unit malfunction, etc.) which would require an inspection, results of the inspection, and any subsequent corrective maintenance activity. The report shall be completed and signed by the authorized facility employee(s) who conducted the inspection(s). The annual inspection report is considered a public document that shall be available at any reasonable time upon request.
- S. The first report shall contain information gathered during the one year time period beginning with the effective date of coverage under this permit and shall be submitted no later than 60 days after this one year period has expired. Each subsequent report shall contain the previous year's information and shall be submitted no later than one year after the previous year's report was due.
- T. If the facility performs inspections more frequently than required by this permit, the results shall be included as additional information in the annual report.
- U. The permittee shall retain the annual inspection report on file at least 3 years. This period may be extended by request of the Illinois Environmental Protection Agency at any time.

Annual inspection reports shall be mailed to the following address:

NPDES Permit No. IL0073806

Special Conditions

Illinois Environmental Protection Agency  
Bureau of Water  
Compliance Assurance Section  
Annual Inspection Report  
1021 North Grand Avenue East  
Post Office Box 19276  
Springfield, Illinois 62794-9276

- V. The permittee shall notify any regulated small municipal separate storm sewer owner (MS4 Community) that they maintain coverage under an individual NPDES permit. The permittee shall submit any SWPPP or any annual inspection to the MS4 community upon request by the MS4 community.

SPECIAL CONDITION 16. The facility utilizes a closed-cycle recirculating cooling system, cooling towers, for cooling of plant condensers and is determined to be the equivalent of Best Technology Available (BTA) for cooling water intake structures to prevent/minimize impingement mortality in accordance with the Best Professional Judgment (BPJ) provisions of 40 CFR 125.3 because it allows the facility to only withdraw the amount of water necessary for cooling of the plant condensers.

The permittee has submitted information on the cooling water intake structure operation in accordance with Section 316(b) of the Clean Water Act. This permit may also be revised or modified in accordance with any laws, regulations, or judicial orders pursuant to Section 316(b) of the Clean Water Act.