

PDES Permit No. IL0029424

Notice No. FRB:14042101.bah

Public Notice Beginning Date: **August 29, 2015**

Public Notice Ending Date: **September 29, 2015**

National Pollutant Discharge Elimination System (NPDES)
Permit Program

PUBLIC NOTICE/FACT SHEET
of
Draft Reissued NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois EPA
Division of Water Pollution Control
Permit Section
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276
217/782-0610

Name and Address of Discharger:

City of LaSalle
745 Second Street
LaSalle, Illinois 61301

Name and Address of Facility:

LaSalle Wastewater Treatment Plant - South
400 River Street
LaSalle, Illinois 61301
(LaSalle County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES Permit to discharge into the waters of the state and has prepared a draft Permit and associated fact sheet for the above named discharger. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. All comments on the draft Permit and requests for hearing must be received by the IEPA by U.S. Mail, carrier mail or hand delivered by the Public Notice Ending Date. Interested persons are invited to submit written comments on the draft Permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the Permit applicant. The NPDES Permit and notice numbers must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft Permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicate a significant degree of public interest in the draft Permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final Permit is issued. For further information, please call Francis Burba at 217/782-0610.

The following water quality and effluent standards and limitations were applied to the discharge:

Title 35: Environmental Protection, Subtitle C: Water Pollution, Chapter I: Pollution Control Board and the Clean Water Act were applied in determining the applicable standards, limitations and conditions contained in the draft Permit.

The applicant is engaged in treating domestic and industrial wastewater for the City of LaSalle.

The length of the Permit is approximately 5 years.

The main discharge number is B01. The seven day once in ten year low flow (7Q10) of the receiving stream, Illinois River is 3,530 cfs.

The design average flow (DAF) for the facility is 3.33 million gallons per day (MGD) and the design maximum flow (DMF) for the facility is 5.0 MGD. Treatment consists of mechanical bar screen, grit removal, primary clarifiers, aeration tanks, secondary clarifiers, chlorination, anaerobic digestion, aerobic digestion, sludge drying beds, and digested sludge is stored in a sludge lagoon.

This treatment works has an approved pretreatment program. There are 4 noncategorical SIUs and 0 CIUs.

This Reissued Permit does not increase the facility's DAF, DMF, concentration limits, and/or load limits.


Application is made for the existing discharge(s) which are located in LaSalle County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

Discharge Number	Receiving Stream	Latitude	Longitude	Stream Classification	Integrity Rating
001 (combined flow)	Illinois River	41° 19' 18" North	89° 05' 07" West	General Use	Not Rated
A01 (excess flow)	Illinois River	41° 19' 18" North	89° 05' 07" West	General Use	Not Rated
B01 (internal outfall)	Illinois River	41° 19' 18" North	89° 05' 07" West	General Use	Not Rated
004 (First flush facility)	Illinois & Michigan Canal	41° 19' 28" North	89° 06' 08" West	General Use	Not Rated
002 (Final Effluent Pump Station)	Illinois & Michigan Canal	41° 19' 33" North	89° 05' 56" West	General Use	Not Rated

This permit authorizes discharge from 3 CSOs in accordance with 35 Ill. Adm. Code 306.305. This facility also includes the discharge from a treated combined sewer overflow (Outfall 004) which is located prior to the headworks of the treatment plant.

The Long Term Control Plan (LTCP) was submitted December 16, 2010, revised May 14, 2013 and approved on June 25, 2013. The LTCP once implemented, is presumed to have no more than an average of four (4) overflow events per year. Construction activities and completion dates are included in Special Condition 15 of the permit. Construction activities include insystem storage, flow control, and sewer separation. The LTCP construction projects planned to meet the presumptive approach will be completed by December 31, 2025.

To assist you further in identifying the location of the discharge(s) please see the attached map

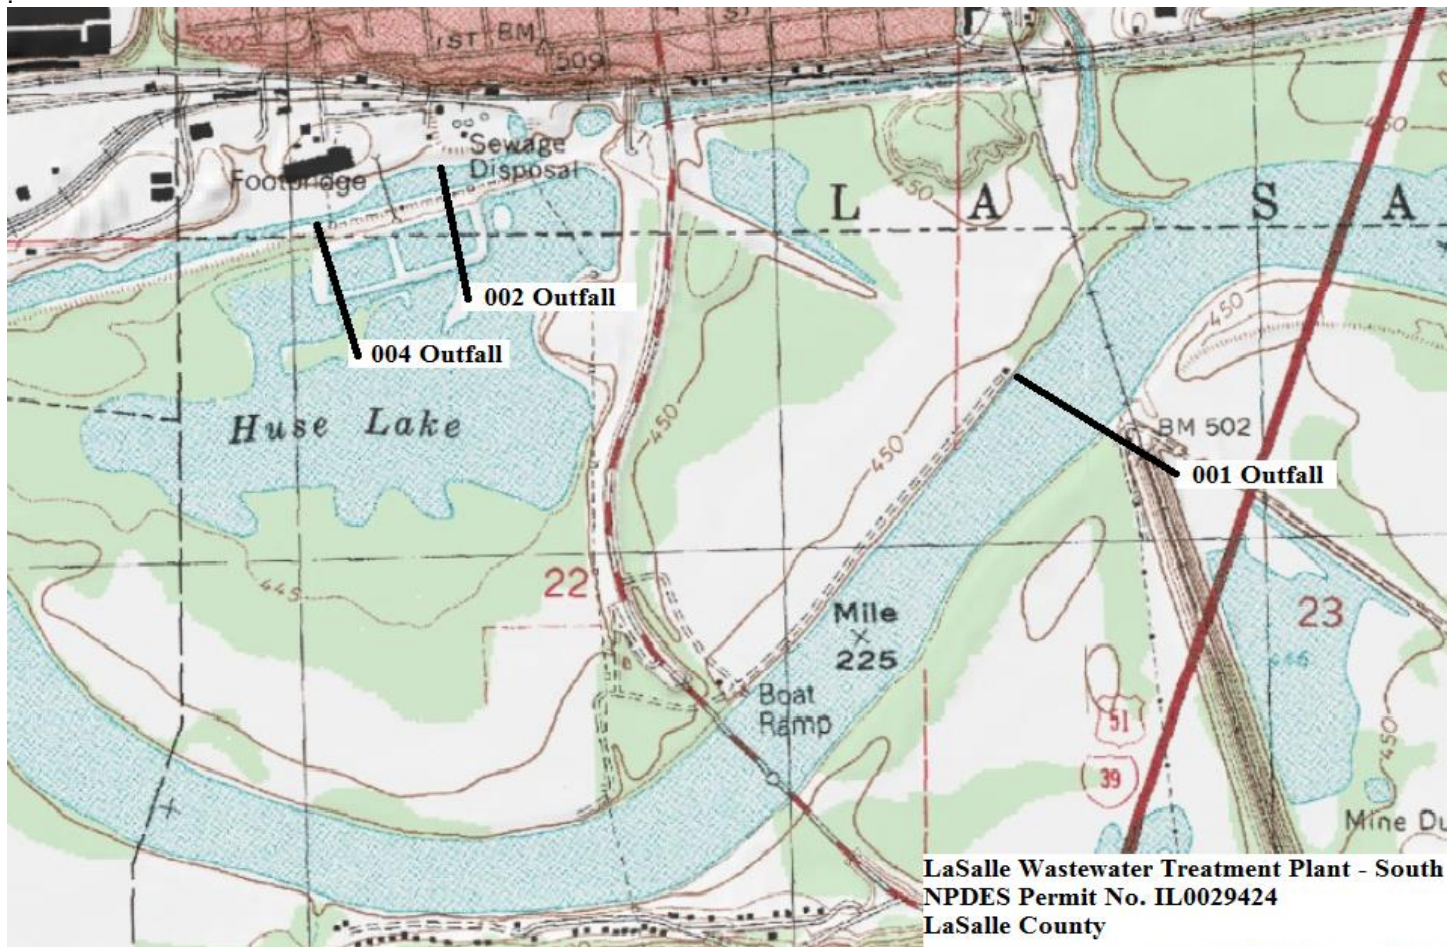

The stream segment(s) (Waterbody Segment D-16) receiving the discharge from outfall(s) 001 and A01 are on the 303(d) list of impaired waters.

The following parameters have been identified as the pollutants causing impairment:

<u>Potential Causes</u>	<u>Uses Impaired</u>
Mercury and polychlorinated biphenyls	Fish consumption
Fecal coliform	Primary contact recreation

The stream segment(s) receiving the discharge from outfall(s) 002 and 004 are not on the 303 (d) list of impaired waters.

The discharge(s) from the facility is (are) proposed to be monitored and limited at all times as follows:

Discharge Number(s) and Name(s): B01 STP Internal Outfall

Load limits computed based on a design average flow (DAF) of 3.33 MGD (design maximum flow (DMF) of 5.0 MGD).

The effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day DAF (DMF)*			CONCENTRATION LIMITS mg/L			Regulation
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum	
CBOD ₅ **	555 (834)	1111 (1668)		20	40		35 IAC 304.120 40 CFR 133.102
Suspended Solids**	694 (1043)	1250 (1877)		25	45		35 IAC 304.120 40 CFR 133.102
pH	Shall be in the range of 6 to 9 Standard Units						35 IAC 304.125
Fecal Coliform	Daily Maximum shall not exceed 400 per 100 mL (May through October)						35 IAC 304.121
Chlorine Residual***						0.75	35 IAC 302.208
Ammonia Nitrogen (as N)	Monitor only						35 IAC 309.146
Total Nitrogen	Monitor only						35 IAC 309.146
Total Phosphorus (as P)	Monitor only						35 IAC 309.146

*Load Limits are calculated by using the formula: $8.34 \times (\text{Design Average and/or Maximum Flow in MGD}) \times (\text{Applicable Concentration in mg/L})$.

** BOD₅ and Suspended Solids (85% removal required): In accordance with 40 CFR 133, the 30-day average percent removal shall not be less than 85 percent except as provided in Sections 133.103 and 133.105.

***Chlorine Residual limit is based on a chlorine study at the treatment plant conducted by IEPA and the results approved September 13, 1990 and the mixing study approved December 12, 2014.

This Permit contains an authorization to treat and discharge excess flow as follows:

Discharge Number(s) and Name(s): A01 Excess Flow Outfall (Flows in excess of 3472 gpm).

Parameter	CONCENTRATION LIMITS (mg/L)	
	Monthly Average	Regulation
BOD ₅	Monitor only	40 CFR 133.102
Suspended Solids	Monitor only	40 CFR 133.102
Fecal Coliform	Daily Maximum Shall Not Exceed 400 per 100 mL	35 IAC 304.121

Discharge Number(s) and Name(s): 001 Combined Discharge from A01 and B01 Outfall

The effluent of the above discharge(s) shall be monitored and limited at all times as follows:

<u>Parameter</u>	<u>CONCENTRATION LIMITS (mg/L)</u>		<u>Regulation</u>
	<u>Monthly Average</u>	<u>Weekly Average</u>	
BOD ₅ *	30	45	40 CFR 133.102
Suspended Solids*	30	45	40 CFR 133.102
pH	Shall be in the range of 6 to 9 Standard Units		35 IAC 304.125
Chlorine residual	0.75		35 IAC 302.208
Ammonia Nitrogen (as N)	Monitor only		35 IAC 355 and 35 IAC 302

*The 30-day average percent removal shall not be less than 85 percent.

This Permit contains an authorization to treat and discharge excess flow as follows:

Discharge Number(s) and Name(s): 004 Treated Combined Sewage Outfall from First Flush Facility (Flows in excess of 3472 gpm).

<u>Parameter</u>	<u>CONCENTRATION LIMITS (mg/L)</u>		<u>Regulation</u>
	<u>Monthly Average</u>	<u>Weekly Average</u>	
BOD ₅	Monitor only		40 CFR 133.102
Suspended Solids	Monitor only		40 CFR 133.102
Fecal Coliform	Daily Maximum Shall Not Exceed 400 per 100mL		35 IAC 304.121
pH	Shall be in the range of 6 to 9 Standard Units		35 IAC 304.125
Chlorine Residual	0.75		35 IAC 304.208

This draft Permit also contains the following requirements as special conditions:

1. Reopening of this Permit to include different final effluent limitations.
2. Operation of the facility by or under the supervision of a certified operator.
3. Submission of the operational data in a specified form and at a required frequency at any time during the effective term of this Permit.
4. More frequent monitoring requirement without Public Notice in the event of operational, maintenance or other problems resulting in possible effluent deterioration.
5. Prohibition against causing or contributing to violations of water quality standards.
6. Recording the monitoring results on Discharge Monitoring Report Forms using one such form for each outfall each month and submitting the forms to IEPA each month.
7. The provisions of 40 CFR Section 122.41(m) & (n) are incorporated herein by reference.
8. Effluent sampling point location.
9. Controlling the sources of infiltration and inflow into the sewer system.
10. Seasonal fecal coliform limits.
11. The Permittee implements and administers an industrial pretreatment program pursuant to 40 CFR §403.
12. Submission of annual fiscal data.
13. Conditional authorization to discharge from high level emergency outfall based on 40 CFR.
14. Submission of semi annual reports indicating the quantities of sludge generated and disposed.
15. An authorization of combined sewer and treatment plant discharges.
16. Reopening of this Permit to include revised effluent limitations based on a Total Maximum Daily Load (TMDL) or other water quality study.
17. The Permittee is required to perform biomonitoring tests in the 18th, 15th, 12th and 9th months prior to the expiration date of the permit, and to submit the results of such tests to the IEPA within one week of receiving the results from the laboratory.
18. Zone of Initial Dilution and mixing zone dimensions.
19. Capacity, Management, Operations and Maintenance (CMOM) requirements.
20. Submission of Phosphorus removal feasibility study.
21. Optimization of existing treatment facilities.
22. Reasonable potential analysis and mixing study plan.

NPDES Permit No. IL0029424

Illinois Environmental Protection Agency

Division of Water Pollution Control

1021 North Grand Avenue East

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Reissued (NPDES) Permit

Expiration Date:

Issue Date:

Effective Date:

Name and Address of Permittee:

City of LaSalle
745 Second Street
LaSalle, Illinois 61301

Facility Name and Address:

LaSalle Wastewater Treatment Plant - South
400 River Street
LaSalle, Illinois 61301
(LaSalle County)

Receiving Waters: Illinois River

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of the Ill. Adm. Code, Subtitle C, Chapter I, and the Clean Water Act (CWA), the above-named Permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the standard conditions and attachments herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the Permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Alan Keller, P.E.
Manager, Permit Section
Division of Water Pollution Control

SAK:FRB:14042101.bah

Effluent Limitations, Monitoring, and Reporting

FINAL

Discharge Number(s) and Name(s): B01 STP Internal Outfall

Load limits computed based on a design average flow (DAF) of 3.33 MGD (design maximum flow (DMF) of 5.0 MGD).

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day DAF (DMF)*			CONCENTRATION LIMITS mg/L			Sample Frequency	Sample Type
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum		
Flow (MGD)							Continuous	
CBOD ₅ ** ⁽¹⁾	555 (834)	1111 (1668)		20	40		3 Days/Week	Composite
Suspended Solids ⁽¹⁾	694 (1043)	1250 (1877)		25	45		3 Days/Week	Composite
pH	Shall be in the range of 6 to 9 Standard Units						3 Days/Week	Grab
Fecal Coliform***	Daily Maximum shall not exceed 400 per 100 mL (May through October)						3 Days/Week	Grab
Chlorine Residual***						0.75	3 Days/Week	Grab
Ammonia Nitrogen (as N)	Monitor only						1 Day/Month	Composite
Total Nitrogen	Monitor only						1 Day/Month	Composite
Total Phosphorus (as P)	Monitor only						1 Day/Month	Composite

*Load limits based on design maximum flow shall apply only when flow exceeds design average flow.

**Carbonaceous BOD₅ (CBOD₅) testing shall be in accordance with 40 CFR 136.

***See Special Condition 10.

⁽¹⁾ BOD₅ and Suspended Solids (85% removal required): In accordance with 40 CFR 133, the 30-day average percent removal shall not be less than 85 percent except as provided in Sections 133.103 and 133.105. The percent removal need not be reported to the IEPA on DMRs but influent and effluent data must be available, as required elsewhere in this Permit, for IEPA inspection and review. For measuring compliance with this requirement, 5 mg/L shall be added to the effluent CBOD₅ concentration to determine the effluent BOD₅ concentration.

Percent removal is a percentage expression of the removal efficiency across a treatment plant for a given pollutant parameter, as determined from the 30-day average values of the raw wastewater influent concentrations to the facility and the 30-day average values of the effluent pollutant concentrations for a given time period.

Flow shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

Fecal Coliform shall be reported on the DMR as a daily maximum value.

pH shall be reported on the DMR as minimum and maximum value.

Chlorine Residual shall be reported on DMR as daily maximum value.

Total Nitrogen and Total Phosphorus shall be reported on the DMR as a daily maximum value.

NPDES Permit No. IL0029424

Effluent Limitations, Monitoring, and Reporting

FINAL

Discharge Number(s) and Name(s): A01 Excess Flow Outfall (Flows in excess of 3472 gpm).

These flow facilities shall not be utilized until the main treatment facility is receiving its design maximum flow* (Flow in excess of 3472 gpm).

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

	CONCENTRATION LIMITS (mg/L)		
<u>Parameter</u>	<u>Monthly Average</u>	<u>Sample Frequency</u>	<u>Sample Type</u>
Total Flow (MG)		Daily When Discharging	Continuous
BOD ₅	Monitor only	Daily When Discharging	Grab
Suspended Solids	Monitor only	Daily When Discharging	Grab
Fecal Coliform	Daily Maximum Shall not Exceed 400 per 100 mL	Daily When Discharging	Grab

Total flow in million gallons shall be reported on the Discharge Monitoring Report (DMR) in the quantity maximum column. The main treatment facility flow at the time that Outfall A01 is first utilized shall be reported in the comment section of the DMR in gallons per minute (gpm).

Report the number of days of discharge in the comments section of the DMR.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration.

Fecal Coliform shall be reported on the DMR as daily maximum.

Ammonia Nitrogen shall be reported on the DMR as a daily maximum value.

Total Phosphorus shall be reported on the DMR as a daily maximum value.

*An explanation shall be provided in the comment section of the DMR should these facilities be used when the main treatment facility is not receiving Design Maximum Flow (DMF). The explanation shall identify the reasons the main facility is at a diminished treatment capacity. Additionally the Permittee shall comply with the provisions of Special Condition 7.

The duration of each A01 discharge and rainfall event (i.e., start and ending time) including rainfall intensity shall be provided in the comment section of the DMR.

NPDES Permit No. IL0029424

Effluent Limitations, Monitoring, and Reporting

FINAL

Discharge Number(s) and Name(s): 001 Combined Discharge from A01 and B01 Outfall*

From the effective date of the Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	CONCENTRATION LIMITS (mg/L)		Sample Frequency	Sample Type
	Monthly Average	Weekly Average		
Total Flow (MG)			Daily when A01 is Discharging	Continuous
BOD ₅ **	30	45	Daily when A01 is Discharging	Grab
Suspended Solids**	30	45	Daily when A01 is Discharging	Grab
pH	Shall be in the range of 6 to 9 Standard Units		Daily when A01 is Discharging	Grab
Chlorine Residual	0.75		Daily when A01 is Discharging	Grab
Ammonia Nitrogen (as N)***	Monitor only		Daily when A01 is Discharging	Grab

*An explanation shall be provided in the comment section of the DMR should these facilities be used when the main treatment facility is not receiving Design Maximum Flow (DMF). The explanation shall identify the reasons the main facility is at a diminished treatment capacity. Additionally, the Permittee shall comply with the provisions of Special Condition 7.

**BOD₅ and Suspended Solids (85% removal required): In accordance with 40 CFR 133, the 30-day average percent removal shall not be less than 85 percent except as provided in Sections 133.103 and 133.105. The percent removal need not be reported to the IEPA on DMRs but influent and effluent data must be available, as required elsewhere in this Permit, for IEPA inspection and review. For measuring compliance with this requirement, 5 mg/L shall be added to the effluent CBOD₅ concentration to determine the effluent BOD₅ concentration. Percent removal is a percentage expression of the removal efficiency across a treatment plant for a given pollutant parameter, as determined from the 30-day average values of the raw wastewater influent concentrations to the facility and the 30-day average values of the effluent pollutant concentrations for a given time period.

***See Special Condition 22.

Total flow in million gallons shall be reported on the Discharge Monitoring Report (DMR) in the quantity maximum column. Report the number of days of discharge in the comments section of the DMR. Chlorine Residual shall be reported on the DMR as monthly average value. pH shall be reported on the DMR as a minimum and a maximum value. BOD₅ and Suspended Solids shall be reported on the DMR as a monthly and weekly average concentration.

A monthly average value for ammonia shall be computed for each month that A01 discharges beginning one month after the effective date of the permit. A monthly average concentration shall be determined by combining data collected from 001 and B01 (only B01 data from days when A01 is not discharging) for the reporting period. These monitoring results shall be submitted to the Agency on the DMR. Ammonia Nitrogen shall also be reported on the DMR as a maximum value.

A monthly and weekly average value for Dissolved Oxygen (DO) shall be computed for each month that A01 discharges beginning one month after the effective date of the permit. The monthly and weekly average concentrations for 001 shall be determined by combining data collected from 001 and B01 (only B01 data from days when A01 is not discharging) for the reporting period. These monitoring results shall be submitted to the Agency on the DMR. DO shall also be reported on the DMR as a minimum value.

Total Phosphorus shall be reported on the DMR as a maximum value.

NPDES Permit No. IL0029424

Effluent Limitations, Monitoring, and Reporting

FINAL

Discharge Number(s) and Name(s): 004 Treated Combined Sewage Outfall from First Flush Facility

These flow facilities shall not be utilized until the main treatment facility is receiving its design maximum flow* (Flow in excess of 3472 gpm).

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

	CONCENTRATION LIMITS (mg/L)		
<u>Parameter</u>	<u>Monthly Average</u>	<u>Sample Frequency</u>	<u>Sample Type</u>
Total Flow (MG)		Daily When Discharging	Continuous
BOD ₅	Monitor only	Daily When Discharging	Grab
Suspended Solids	Monitor only	Daily When Discharging	Grab
Fecal Coliform	Daily Maximum Shall not Exceed 400 per 100 mL	Daily When Discharging	Grab
pH	Shall be in the range of 6 to 9 Standard Units	Daily When Discharging	Grab
Chlorine Residual	0.75	Daily When Discharging	Grab

Total flow in million gallons shall be reported on the Discharge Monitoring Report (DMR) in the quantity maximum column. The main treatment facility flow at the time that Outfall 004 is first utilized shall be reported in the comment section of the DMR in gallons per minute (gpm).

Report the number of days of discharge in the comments section of the DMR.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration.

Fecal Coliform shall be reported on the DMR as daily maximum.

pH shall be reported on the DMR as a minimum and a maximum.

Chlorine Residual shall be reported on the DMR as monthly average. be reported on the DMR as monthly average.

*An explanation shall be provided in the comment section of the DMR should these facilities be used when the main treatment facility is not receiving Design Maximum Flow (DMF). The explanation shall identify the reasons the main facility is at a diminished treatment capacity. Additionally the Permittee shall comply with the provisions of Special Condition 7.

The duration of each 004 discharge and rainfall event (i.e., start and ending time) including rainfall intensity shall be provided in the comment section of the DMR.

NPDES Permit No. IL0029424

Influent, Monitoring, and Reporting

The influent to the plant shall be monitored as follows:

<u>Parameter</u>	<u>Sample Frequency</u>	<u>Sample Type</u>
Flow (MGD)	Continuous	
BOD ₅	3 Days/Week and Daily When Outfall A01 is Discharging	Composite
Suspended Solids	3 Days/Week and Daily When Outfall A01 is Discharging	Composite

Influent samples shall be taken at a point representative of the influent.

Flow (MGD) shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration.

Special Conditions

SPECIAL CONDITION 1. This Permit may be modified to include different final effluent limitations or requirements which are consistent with applicable laws and regulations. The IEPA will public notice the permit modification.

SPECIAL CONDITION 2. The use or operation of this facility shall be by or under the supervision of a Certified Class 1 operator.

SPECIAL CONDITION 3. The IEPA may request in writing submittal of operational information in a specified form and at a required frequency at any time during the effective period of this Permit.

SPECIAL CONDITION 4. The IEPA may request more frequent monitoring by permit modification pursuant to 40 CFR § 122.63 and Without Public Notice.

SPECIAL CONDITION 5. The effluent, alone or in combination with other sources, shall not cause a violation of any applicable water quality standard outlined in 35 Ill. Adm. Code 302.

SPECIAL CONDITION 6. The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) Forms using one such form for each outfall each month.

In the event that an outfall does not discharge during a monthly reporting period, the DMR Form shall be submitted with no discharge indicated.

The Permittee may choose to submit electronic DMRs (NetDMRs) instead of mailing paper DMRs to the IEPA. More information, including registration information for the NetDMR program, can be obtained on the IEPA website, <http://www.epa.state.il.us/water/net-dmr/index.html>.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 25th day of the following month, unless otherwise specified by the permitting authority.

Permittees not using NetDMRs shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency
Division of Water Pollution Control
Attention: Compliance Assurance Section, Mail Code # 19
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 7. The provisions of 40 CFR Section 122.41(m) & (n) are incorporated herein by reference.

SPECIAL CONDITION 8. Samples taken in compliance with the effluent monitoring requirements shall be taken:

- A. For Outfall Number B01: Samples for all effluent limitations and monitoring parameters applicable to Outfall B01 shall be taken at a point representative of the flows from Outfall B01 but prior to entry into the receiving stream. On days when there are discharges from Outfall A01, samples for all effluent limitations and monitoring parameters applicable to Outfall B01 shall be representative of discharges from B01 and shall be taken at a point prior to admixture with discharges from Outfall A01.
- B. For Outfall Number A01: Samples for all effluent limitations and monitoring parameters applicable to Outfall A01 shall be taken at a point representative of the discharge from Outfall A01 and shall be taken at a point prior to admixture with discharges from Outfall B01.
- C. For Outfall Number 001: Samples for all effluent limitations and monitoring parameters applicable to Outfall 001 shall be taken at a point representative of the discharge from Outfall 001 but prior to entry into the receiving stream and shall include all flow from Outfalls A01 and B01. On days when there are no discharges through Outfall A01, samples for discharges through Outfall 001 can be taken at the location of sampling for Outfall B01. Samples for discharges through Outfall B01 taken on days when Outfall A01 does not discharge must be reported on the DMR for both Outfalls B01 and 001. When there are discharges from Outfall A01, samples for all effluent limitations and monitoring parameters applicable to Outfall 001 shall be representative of the discharge from Outfall 001 and shall be taken at a point after flows from Outfalls A01 and B01 are mixed.

SPECIAL CONDITION 9. This Permit may be modified to include requirements for the Permittee on a continuing basis to evaluate and detail its efforts to effectively control sources of infiltration and inflow into the sewer system and to submit reports to the IEPA if necessary.

SPECIAL CONDITION 10. Fecal Coliform limits for Discharge Number B01 are effective May thru October. Sampling of Fecal Coliform is only required during this time period.

The total residual chlorine limit is applicable at all times. If the Permittee is chlorinating for any purpose during the months of November through April, sampling is required on a daily grab basis. Sampling frequency for the months of May through October shall be as indicated on effluent limitations, monitoring and reporting page of this Permit.

Special ConditionsSPECIAL CONDITION 11.A. Publicly Owned Treatment Works (POTW) Pretreatment Program General Provisions

1. The Permittee shall implement and enforce its approved Pretreatment Program which was approved on August 12, 1985 and all approved subsequent modifications thereto. The Permittee shall maintain legal authority adequate to fully implement the Pretreatment Program in compliance with Federal (40 CFR 403), State, and local laws and regulations. All definitions in this section unless specifically otherwise defined in this section, are those definitions listed in 40 CFR 403.3. USEPA Region 5 is the Approval Authority for the administration of pretreatment programs in Illinois. The Permittee shall:
 - a. Develop and implement procedures to ensure compliance with the requirements of a pretreatment program as specified in 40 CFR 403.8 (f) (2).
 - b. Carry out independent inspection and monitoring procedures at least once per year, which will determine whether each significant industrial user (SIU) is in compliance with applicable pretreatment standards.
 - c. Evaluate whether each SIU needs a slug control plan or other action to control slug discharges. If needed, the SIU slug control plan shall include the items specified in 40 CFR 403.8(f)(2)(vi). For IUs identified as significant prior to November 14, 2005, this evaluation must have been conducted at least once by October 14, 2006; additional SIUs must be evaluated within 1 year of being designated an SIU;
 - d. Update its inventory of Industrial Users (IUs) at least annually and as needed to ensure that all SIUs are properly identified, characterized, and categorized;
 - e. Receive and review self monitoring and other IU reports to determine compliance with all pretreatment standards and requirements, and obtain appropriate remedies for noncompliance by any IU with any pretreatment standard and/or requirement;
 - f. Investigate instances of noncompliance, collect and analyze samples, and compile other information with sufficient care as to produce evidence admissible in enforcement proceedings, including judicial action;
 - g. Require development, as necessary, of compliance schedules by each industrial user to meet applicable pretreatment standards; and,
 - h. Maintain an adequate revenue structure and staffing level for continued operation of the Pretreatment Program.
2. The Permittee shall issue/reissue permits or equivalent control mechanisms to all SIUs prior to expiration of existing permits or prior to commencement of discharge in the case of new discharges. The permits at a minimum shall include the elements listed in 40 CFR § 403.8(f)(1)(iii)(B).
3. The Permittee shall develop, maintain, and enforce, as necessary, local limits to implement the general and specific prohibitions in 40 CFR § 403.5 which prohibit the introduction of any pollutants which cause pass through or interference and the introduction of specific pollutants to the waste treatment system from any source of nondomestic discharge.
4. In addition to the general limitations expressed in Paragraph 3 above, applicable pretreatment standards must be met by all industrial users of the POTW. These limitations include specific standards for certain industrial categories as determined by Section 307(b) and (c) of the Clean Water Act, State limits, or local limits, whichever are more stringent.
5. The USEPA and IEPA individually retain the right to take legal action against any industrial user and/or the POTW for those cases where an industrial user has failed to meet an applicable pretreatment standard by the deadline date regardless of whether or not such failure has resulted in a permit violation.
6. The Permittee shall establish agreements with all contributing jurisdictions, as necessary, to enable it to fulfill its requirements with respect to all IUs discharging to its system.
7. Unless already completed, the Permittee shall within twenty four (24) months of the effective date of this Permit submit to USEPA and IEPA a proposal to modify and update its approved Pretreatment Program to incorporate Federal revisions to the general pretreatment regulations. The proposal shall include all changes to the approved program and the sewer use ordinance which are necessary to incorporate the revisions of the Pretreatment Streamlining Rule (which became effective on November 14, 2005), which are considered required changes, as described in the Pretreatment Streamlining Rule Fact Sheet 2.0: Required changes, available at: http://cfpub.epa.gov/npdes/whatsnew.cfm?program_id=3. This includes any necessary revisions to the Permittee's Enforcement Response Plan (ERP).

Special Conditions

8. Within 24 months from the effective date of this permit, the Permittee shall conduct a technical re-evaluation of its local limitations consistent with U.S. EPA's Local Limits Development Guidance (July 2004) and submit the evaluation and any proposed revisions to its local limits to IEPA and U.S. EPA Region 5 for review and approval. USEPA Region 5 requests the Permittee to submit the evaluation and any proposed revisions to its local limits on the spreadsheet found at: <http://www.epa.gov/region5/water/npdestek/Localmt.XLS>. To demonstrate technical justification for new local industrial user limits or justification for retaining existing limits, the following information must be submitted to U.S. EPA:
- a. Total plant flow
 - b. Domestic/commercial pollutant contributions for pollutants of concern
 - c. Industrial pollutant contributions and flows
 - d. Current POTW pollutant loadings, including loadings of conventional pollutants
 - e. Actual treatment plant removal efficiencies, as a decimal (primary, secondary, across the wastewater treatment plant)
 - f. Safety factor to be applied
 - g. Identification of applicable criteria:
 - i. NPDES permit conditions
 - Specific NPDES effluent limitations
 - Water-quality criteria
 - Whole effluent toxicity requirements
 - Criteria and other conditions for sludge disposal
 - ii. Biological process inhibition
 - Nitrification
 - Sludge digester
 - iii. Collection system problems
 - h. The Permittee's sludge disposal methods (land application, surface disposal, incineration, landfill)
 - i. Sludge flow to digester
 - j. Sludge flow to disposal
 - k. % solids in sludge to disposal, not as a decimal
 - l. % solids in sludge to digester, not as a decimal
 - m. Plant removal efficiencies for conventional pollutants
 - n. If revised industrial user discharge limits are proposed, the method of allocating available pollutants loads to industrial users
 - o. A comparison of maximum allowable headworks loadings based on all applicable criteria listed in g, above
 - p. Pollutants that have caused:
 - i. Violations or operational problems at the POTW, including conventional pollutants
 - ii. Fires and explosions
 - iii. Corrosion
 - iv. Flow obstructions
 - v. Increased temperature in the sewer system
 - vi. Toxic gases, vapors or fumes that caused acute worker health and safety problems
 - vii. Toxicity found through Whole Effluent Toxicity testing
 - viii. Inhibition
 - q. Pollutants designated as "monitoring only" in the NPDES permit
 - r. Supporting data, assumptions, and methodologies used in establishing the information a through q above
9. The Permittee's Pretreatment Program has been modified to incorporate a Pretreatment Program Amendment approved by USEPA on February 6, 1995 and July 24, 1997. The amendment became effective on the date of approval and is a fully enforceable provision of your Pretreatment Program. Modifications of your Pretreatment Program shall be submitted in accordance with 40 CFR § 403.18, which established conditions for substantial and nonsubstantial modifications. All requests should be sent in electronic format to r5npdes@epa.gov, attention: NPDES Programs Branch.

B. Reporting and Records Requirements

1. The Permittee shall provide an annual report briefly describing the permittee's pretreatment program activities over the previous calendar year. Permittees who operate multiple plants may provide a single report providing all plant-specific reporting requirements are met. Such report shall be submitted no later than April 28 of each year to USEPA, Region 5, 77 West Jackson Blvd., Chicago, Illinois 60604, Attention: Water Enforcement & Compliance Assurance Branch, and shall be in the format set forth in IEPA's POTW Pretreatment Report Package which contains information regarding:
 - a. An updated listing of the Permittee's significant industrial users, indicating additions and deletions from the previous year, along with brief explanations for deletions. The list shall specify which categorical Pretreatment standards, if any, are applicable to each Industrial User.
 - b. A descriptive summary of the compliance activities including numbers of any major enforcement actions, (i.e., administrative orders, penalties, civil actions, etc.), and the outcome of those actions. This includes an assessment of the compliance status of the Permittee's industrial users and the effectiveness of the Permittee's Pretreatment Program in meeting its needs and objectives.

Special Conditions

- c. A description of all substantive changes made to the Permittee's Pretreatment Program. Changes which are "substantial modifications" as described in 40 CFR § 403.18(c) must receive prior approval from the USEPA.
 - d. Results of sampling and analysis of POTW influent, effluent, and sludge.
 - e. A summary of the findings from the priority pollutants sampling. As sufficient data becomes available the IEPA may modify this Permit to incorporate additional requirements relating to the evaluation, establishment, and enforcement of local limits for organic pollutants. Any permit modification is subject to formal due process procedures pursuant to State and Federal law and regulation. Upon a determination that an organic pollutant is present that causes interference or pass through, the Permittee shall establish local limits as required by 40 CFR § 403.5(c).
2. The Permittee shall maintain all pretreatment data and records for a minimum of three (3) years. This period shall be extended during the course of unresolved litigation or when requested by the IEPA or the Regional Administrator of USEPA. Records shall be available to USEPA and the IEPA upon request.
 3. The Permittee shall establish public participation requirements of 40 CFR 25 in implementation of its Pretreatment Program. The Permittee shall at least annually, publish the names of all IU's which were in significant noncompliance (SNC), as defined by 40 CFR § 403.8(f)(2)(viii), in a newspaper of general circulation that provides meaningful public notice within the jurisdictions served by the Permittee or based on any more restrictive definition of SNC that the POTW may be using.
 4. The Permittee shall provide written notification to the USEPA, Region 5, 77 West Jackson Blvd., Chicago, Illinois 60604, Attention: NPDES Programs Branch and to the Deputy Counsel for the Division of Water Pollution Control, IEPA, 1021 North Grand Avenue East, P.O. Box 19276, Springfield, Illinois 62794-9276 within five (5) days of receiving notice that any Industrial User of its sewage treatment plant is appealing to the Circuit Court any condition imposed by the Permittee in any permit issued to the Industrial User by Permittee. A copy of the Industrial User's appeal and all other pleadings filed by all parties shall be mailed to the Deputy Counsel within five (5) days of the pleadings being filed in Circuit Court.

C. Monitoring Requirements

1. The Permittee shall monitor its influent, effluent and sludge and report concentrations of the following parameters on monitoring report forms provided by the IEPA and include them in its annual report. Samples shall be taken at semi-annual intervals at the indicated reporting limit or better and consist of a 24-hour composite unless otherwise specified below. Sludge samples shall be taken of final sludge and consist of a grab sample reported on a dry weight basis.

STORET CODE	PARAMETER	Minimum reporting limit
01097	Antimony	0.07 mg/L
01002	Arsenic	0.05 mg/L
01007	Barium	0.5 mg/L
01012	Beryllium	0.005 mg/L
01027	Cadmium	0.001 mg/L
01032	Chromium (hex) (grab not to exceed 24 hours)*	0.01 mg/L
01034	Chromium (total)	0.05 mg/L
01042	Copper	0.005 mg/L
00718	Cyanide (grab)* (available**** or amenable to chlorination)	5.0 ug/L
00720	Cyanide (total) (grab)	5.0 ug/L
00951	Fluoride*	0.1 mg/L
01045	Iron (total)	0.5 mg/L
01046	Iron (Dissolved)*	0.5 mg/L
01051	Lead	0.05 mg/L
01055	Manganese	0.5 mg/L
71900	Mercury (effluent grab)***	1.0 ng/L**
01067	Nickel	0.005 mg/L
00556	Oil (hexane soluble or equivalent) (Grab Sample only)*	5.0 mg/L
32730	Phenols (grab)	0.005 mg/L
01147	Selenium	0.005 mg/L
01077	Silver (total)	0.003 mg/L
01059	Thallium	0.3 mg/L
01092	Zinc	0.025 mg/L

Minimum reporting limits are defined as – (1) The minimum value below which data are documented as non-detects. (2) Three to ten times the method detection limit. (3) The minimum value of the calibration range.

All sample containers, preservatives, holding times, analyses, method detection limit determinations and quality assurance/quality control requirements shall be in accordance with 40 CFR 136.

Special Conditions

* Influent and effluent only

**1 ng/L = 1 part per trillion.

***Utilize USEPA Method 1631E and the digestion procedure described in Section 11.1.1.2 of 1631E, other approved methods may be used for influent (composite) and sludge.

****USEPA Method OIA – 1617

Unless otherwise indicated, concentrations refer to the total amount of the constituent present in all phases, whether solid, suspended or dissolved, elemental or combined including all oxidation states. Where constituents are commonly measured as other than total, the phase is so indicated.

2. The Permittee shall conduct an analysis for the one hundred and ten (110) organic priority pollutants identified in 40 CFR 122 Appendix D, Table II as amended. This monitoring shall be done annually and reported on monitoring report forms provided by the IEPA and shall consist of the following:
 - a. The influent and effluent shall be sampled and analyzed for the one hundred and ten (110) organic priority pollutants. The sampling shall be done during a day when industrial discharges are expected to be occurring at normal to maximum levels.

Samples for the analysis of acid and base/neutral extractable compounds shall be 24-hour composites. Five (5) grab samples shall be collected each monitoring day to be analyzed for volatile organic compounds. A single analysis for volatile pollutants (Method 624) may be run for each monitoring day by compositing equal volumes of each grab sample directly in the GC purge and trap apparatus in the laboratory, with no less than one (1) mL of each grab included in the composite.

Wastewater samples must be handled, prepared, and analyzed by GC/MS in accordance with USEPA Methods 624 and 625 of 40 CFR 136 as amended.
 - b. The sludge shall be sampled and analyzed for the one hundred and ten (110) organic priority pollutants. A sludge sample shall be collected concurrent with a wastewater sample and taken as final sludge.

Sampling and analysis shall conform to USEPA Methods 624 and 625 unless an alternate method has been approved by IEPA.
 - c. Sample collection, preservation and storage shall conform to approved USEPA procedures and requirements.
3. In addition, the Permittee shall monitor any new toxic substances as defined by the Clean Water Act, as amended, following notification by the IEPA or USEPA.
4. Permittee shall report any noncompliance with effluent or water quality standards in accordance with Standard Condition 12(e) of this Permit.
5. Analytical detection limits shall be in accordance with 40 CFR 136. Minimum detection limits for sludge analyses shall be in accordance with 40 CFR 503.

D. Pretreatment Reporting

USEPA Region 5 is the Approval Authority for administering the pretreatment program in Illinois. All requests for modifications of pretreatment program elements should be submitted in redline/strikeout electronic format and must be sent to USEPA at r5npdes@epa.gov.

Permittee shall upon notice from USEPA, modify any pretreatment program element found to be inconsistent with 40 CFR 403.

SPECIAL CONDITION 12. During January of each year the Permittee shall submit annual fiscal data regarding sewerage system operations to the Illinois Environmental Protection Agency/Division of Water Pollution Control/Compliance Assurance Section. The Permittee may use any fiscal year period provided the period ends within twelve (12) months of the submission date.

Submission shall be on forms provided by IEPA titled "Fiscal Report Form For NPDES Permittees".

SPECIAL CONDITION 13. Discharge Number 002 is an emergency high level outfall. Discharges from this outfall are prohibited. The Permittee shall maintain continuous electronic monitors capable of detecting all discharges from each prohibited discharge outfall or shall inspect each listed prohibited discharge outfall listed above within 24 hours of receiving .25 inches of precipitation or greater within a 24 hour period as recorded at the nearest National Weather Service Reporting Station. The Permittee shall utilize chalk or block devices or other discharge confirming devices approved by the Agency to enhance visual monitoring. These prohibited discharges, if they occur, are subject to conditions A-E below:

Special Conditions

(A) Definitions

"Severe property damage" means substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a discharge. Severe property damage does not mean economic loss caused by delays in production.

(B) Notice

- (1) Anticipated discharge. If the Permittee knows in advance of the need for a prohibited discharge from Discharge Number 002, it shall submit prior notice, if possible at least ten days before the date of the discharge.
- (2) Unanticipated discharge. The Permittee shall submit notice of an unanticipated discharge as required in Standard Condition 12(f) of this Permit (24-hour notice).

(C) Limitation on IEPA enforcement discretion. The IEPA may take enforcement action against a Permittee for prohibited discharges from Discharge Number 002, unless:

- (1) Discharge was unavoidable to prevent loss of life, personal injury, or severe property damage;
- (2) There was no feasible alternatives to the Discharge, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a discharge which occurred during normal periods of equipment downtime or preventive maintenance; and
- (3) The Permittee submitted notices as required under Standard Condition 12(f) of this Permit.

(D) Emergency Discharges when discharging, shall be monitored daily by grab sample for BOD₅, Suspended Solids and Fecal Coliform. The Permittee shall submit the monitoring results on Discharge Monitoring Report forms using one such form for each month in which discharging occurs. The Permittee shall specify the number of discharges per month that occur and shall report this number in the quantity daily maximum column. The Permittee shall report the highest concentration value of BOD₅, Suspended Solids, and Fecal Coliform discharged in the concentration daily maximum column.

(E) The above limitations on enforcement discretion apply only with respect to IEPA. They do not serve as a limitation on the ability of any other governmental agency or person to bring an enforcement action in accordance with the Federal Clean Water Act.

SPECIAL CONDITION 14. For the duration of this Permit, the Permittee shall determine the quantity of sludge produced by the treatment facility in dry tons or gallons with average percent total solids analysis. The Permittee shall maintain adequate records of the quantities of sludge produced and have said records available for IEPA inspection. The Permittee shall submit to the IEPA, at a minimum, a semi-annual summary report of the quantities of sludge generated and disposed of, in units of dry tons or gallons (average total percent solids) by different disposal methods including but not limited to application on farmland, application on reclamation land, landfilling, public distribution, dedicated land disposal, sod farms, storage lagoons or any other specified disposal method. Said reports shall be submitted to the IEPA by January 31 and July 31 of each year reporting the preceding January thru June and July thru December interval of sludge disposal operations.

Duty to Mitigate. The Permittee shall take all reasonable steps to minimize any sludge use or disposal in violation of this Permit.

Sludge monitoring must be conducted according to test procedures approved under 40 CFR 136 unless otherwise specified in 40 CFR 503, unless other test procedures have been specified in this Permit.

Planned Changes. The Permittee shall give notice to the IEPA on the semi-annual report of any changes in sludge use and disposal.

The Permittee shall retain records of all sludge monitoring, and reports required by the Sludge Permit as referenced in Standard Condition 25 for a period of at least five (5) years from the date of this Permit.

If the Permittee monitors any pollutant more frequently than required by the Sludge Permit, the results of this monitoring shall be included in the reporting of data submitted to the IEPA.

The Permittee shall comply with existing federal regulations governing sewage sludge use or disposal and shall comply with all existing applicable regulations in any jurisdiction in which the sewage sludge is actually used or disposed.

The Permittee shall comply with standards for sewage sludge use or disposal established under Section 405(d) of the CWA within the time provided in the regulations that establish the standards for sewage sludge use or disposal even if the permit has not been modified to incorporate the requirement.

Special Conditions

The Permittee shall ensure that the applicable requirements in 40 CFR Part 503 are met when the sewage sludge is applied to the land, placed on a surface disposal site, or fired in a sewage sludge incinerator.

Monitoring reports for sludge shall be reported on the form titled "Sludge Management Reports" to the following address:

Illinois Environmental Protection Agency
 Bureau of Water
 Compliance Assurance Section
 Mail Code #19
 1021 North Grand Avenue East
 Post Office Box 19276
 Springfield, Illinois 62794-9276

SPECIAL CONDITION 15.

AUTHORIZATION OF
 COMBINED SEWER AND TREATMENT PLANT DISCHARGES

The IEPA has determined that at least a portion of the collection system consists of combined sewers. References to the collection system and the sewer system refer only to those parts of the system which are owned and operated by the Permittee unless otherwise indicated. The Permittee is authorized to discharge from the overflow(s)/bypass(es) listed below provided the diversion structure is located on a combined sewer and the following terms and conditions are met:

<u>Discharge Number</u>	<u>Location</u>	<u>Receiving Water</u>
003	Creve Coeur Street	Illinois and Michigan Canal
006	Union Street	Little Vermilion River
007	11 th Street Overflow	Little Vermilion River

CSO Monitoring, Reporting and Notification Requirements

A. The Permittee shall monitor the frequency of discharge (number of discharges per month) and estimate the duration (in hours) of each discharge from each outfall listed in this Special Condition. Estimates of storm duration and total rainfall shall be provided for each storm event.

Start Date	Rainfall Duration (hrs.)	Rainfall Amount (in.)	CSO Outfall #	Outfall Description	Estimated Duration of CSO Discharge (hrs)	Estimated Volume of CSO Discharge (MG)

For frequency reporting, all discharges from the same storm, or occurring within 24 hours, shall be reported as one. The date that a discharge commences shall be recorded for each outfall. Reports shall be in the form specified by the IEPA and on forms provided by the IEPA (e.g., Form IL 532-2471, or updated form of same). These forms shall be submitted to the IEPA monthly with the DMRs and covering the same reporting period as the DMRs. Parameters (other than flow frequency and volume), if required in this Permit, shall be sampled and reported as indicated in the transmittal letter for such report forms.

B. All submittals listed in this Special Condition can be mailed to the following address:

Illinois Environmental Protection Agency
 Division of Water Pollution Control
 1021 North Grand Avenue East
 Post Office Box 19276
 Springfield, Illinois 62794-9276

Attention: CSO Coordinator, Compliance Assurance Section

All submittals hand carried shall be delivered to 1021 North Grand Avenue East.

CSO Treatment Requirements

C. All combined sewer overflows and if applicable, treatment plant bypasses shall be given sufficient treatment to prevent pollution and the violation of applicable water quality standards. Sufficient treatment shall consist of the following:

1. Treatment as described in PCB 86-2 and dated July 18, 1996 shall be provided. The terms and conditions of this Board Order are hereby incorporated by reference as if fully set forth herein; and,

Special Conditions

2. Any additional treatment, necessary to comply with all applicable water quality based requirements of this permit including, but not limited to, the requirement that discharges from CSOs not cause or contribute to violations of applicable water quality standards or cause use impairment in the receiving waters.
- D. All CSO discharges authorized by this Permit shall be treated, in whole or in part, to the extent necessary to prevent accumulations of sludge deposits, floating debris and solids in accordance with 35 Ill. Adm. Code 302.203 and to prevent depression of oxygen levels below the applicable water quality standards.
- E. Overflows during dry weather are prohibited. Dry weather overflows shall be reported to the IEPA pursuant to Standard Condition 12(f) of this Permit (24 hour notice).
- F. The collection system shall be operated to optimize transport of wastewater flows to the WWTP and shall be operated to maximize treatment of wastewater flows and to minimize CSOs.
- G. The treatment system shall be operated to maximize treatment of wastewater flows.

CSO Nine Minimum Controls

- H. The Permittee shall comply with the nine minimum controls contained in the National CSO Control Policy published in the Federal Register on April 19, 1994. The nine minimum controls are:
 1. Proper operation and maintenance programs for the sewer system and the CSOs;
 2. Maximum use of the collection system for storage;
 3. Review and modification of pretreatment requirements to assure CSO impacts are minimized;
 4. Maximization of flow to the POTW for treatment;
 5. Prohibition of CSOs during dry weather;
 6. Control of solids and floatable materials in CSOs;
 7. Pollution prevention programs which focus on source control;
 8. Public notification to ensure that citizens receive adequate information regarding CSO occurrences and CSO impacts; and,
 9. Monitoring to characterize impacts and efficiency of CSO controls.

A CSO pollution prevention plan (PPP) shall be developed by the Permittee unless one has already been prepared for this collection system. Any previously-prepared PPP shall be reviewed, and revised if necessary, by the Permittee to address the items contained in Chapter 8 of the U.S. EPA guidance document, Combined Sewer Overflows, Guidance For Nine Minimum Controls, and any items contained in previously-sent review documents from the IEPA concerning the PPP. Combined Sewer Overflows, Guidance For Nine Minimum Controls is available on line at <http://www.epa.gov/npdes/pubs/owm0030.pdf>. The PPP (or revised PPP) shall be presented to the general public at a public information meeting conducted by the Permittee annually during the term of this Permit. The Permittee shall submit documentation that the pollution prevention plan complies with the requirements of this Permit and that the public information meeting was held. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Pollution Prevention Plan Certification" one (1) with original signatures. This certification form is available online at <http://www.epa.state.il.us/water/permits/waste-water/forms/cso-pol-prev.pdf>. Following the public meeting, the Permittee shall implement the pollution prevention plan and shall maintain a current pollution prevention plan, updated to reflect system modifications, on file at the sewage treatment works or other acceptable location and made available to the public. The pollution prevention plan shall be submitted to the IEPA one (1) month from the revision date.

CSO Sensitive Area Considerations

- I. Pursuant to Section II.C.3 of the federal CSO Control Policy of 1994, sensitive areas are any water likely to be impacted by a CSO discharge which meet one or more of the following criteria: (1) designated as an Outstanding National Resource Water; (2) found to contain shellfish beds; (3) found to contain threatened or endangered aquatic species or their habitat; (4) used for primary contact recreation; (5) National Marine Sanctuaries; or, (6) within the protection area for a drinking water intake structure.

Special Conditions

The IEPA has tentatively determined that none of the outfalls listed in this Special Condition discharge to sensitive areas. However, if information becomes available that causes the IEPA to reverse this determination, the IEPA will notify the Permittee in writing. Upon the date contained in the notification letter, the Permittee shall revise the LTCP and schedule to eliminate or relocate these outfalls. If elimination or relocation is not economically feasible or technically achievable the Permittee shall submit a revised plan and schedule for treating the discharge. Such justification shall be in accordance with Section II.C.3 of the National CSO Control Policy.

CSO Operational and Maintenance Plans

J. The Permittee shall implement measures to reduce, to the greatest extent practicable, the total loading of pollutants and floatables entering the receiving stream to ensure that the Permittee ultimately achieves compliance with water quality standards. These measures shall include, but not be limited to developing and implementing a CSO O & M plan, tailored to the permittee's collection and waste treatment system, which shall include mechanisms and specific procedures where applicable to ensure:

1. Collection system inspection on a scheduled basis;
2. Sewer, catch basin, and regulator cleaning and maintenance on a scheduled basis;
3. Inspections are made and preventive maintenance is performed on all pump/lift stations;
4. Collection system replacement, where necessary;
5. Detection and elimination of illegal connections;
6. Detection, prevention, and elimination of dry weather overflows;
7. The collection system is operated to maximize storage capacity and the combined sewer portions of the collection system are operated to delay storm water entry into the system; and,
8. The treatment and collection systems are operated to maximize treatment.

A CSO operational and maintenance plan ("CSO O&M plan") shall be developed and presented to the general public at a public information meeting conducted by the Permittee within nine (9) months of the effective date of this Permit or within nine (9) months of the CSO system being modified. The Permittee shall submit documentation that the CSO O&M plan complies with the requirements of this Permit and that the public information meeting was held. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit or within three (3) months of the public meeting and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Operational Plan Checklist and Certification", one (1) copy with original signatures. Copies of the "CSO Operational Plan Checklist and Certification" are available online at <http://www.epa.state.il.us/water/permits/waste-water/forms/cso-checklist.pdf>. Following the public meeting, the Permittee shall implement the CSO O&M plan and shall maintain a current CSO O&M plan, updated to reflect system modifications, on file at the sewage treatment works or other acceptable location and made available to the public. The CSO O&M plan shall be submitted to the IEPA one (1) month from the revision date.

Sewer Use Ordinances

K. The Permittee, within six (6) months of the effective date of this Permit, shall review and where necessary, modify its existing sewer use ordinance to ensure it contains provisions addressing the conditions below. If no ordinance exists, such ordinance shall be developed, adopted, and implemented within six (6) months from the effective date of this Permit. Upon completion of the review of the sewer use ordinance(s), the Permittee shall submit two (2) copies of a completed "Certification of Sewer Use Ordinance Review", one (1) copy with original signatures. Copies of the certification form can be obtained on line at <http://www.epa.state.il.us/water/permits/waste-water/forms/sewer-use.pdf>. The Permittee shall submit additional copies of the sewer use ordinance(s) to the IEPA one (1) month from the revision date. Sewer use ordinances must contain specific provisions to:

1. Prohibit introduction of new inflow sources to the sanitary sewer system;
2. Require that new construction tributary to the combined sewer system be designed to minimize and/or delay inflow contribution to the combined sewer system;
3. Require that inflow sources on the combined sewer system be connected to a storm sewer, in accordance with the approved Long Term Control Plan;

Special Conditions

4. Provide that any new building domestic sewage connection shall be distinct from the building inflow connection;
5. Assure that CSO impacts from industrial and/or commercial sources are minimized and control by determining which industrial and/or commercial discharges that are tributary to CSOs;
6. Assure that the owners of all publicly owned systems with sewers tributary to the Permittee's collection system have procedures in place adequate to ensure that the objectives, mechanisms, and specific procedures given in Paragraph J of this Special Condition are achieved.

The Permittee shall enforce the applicable sewer use ordinances.

CSO Long-Term Control Planning and Compliance with Water Quality Standards

- L. 1. Pursuant to Section 301 of the federal Clean Water Act, 33 U.S.C. § 1311 and 40 CFR § 122.4, discharges from the CSOs, including the outfalls listed in this Special Condition and any other outfall listed as a "Treated Combined Sewage Outfall", shall not cause or contribute to violations of applicable water quality standards or cause use impairment in the receiving waters. In addition, discharges from CSOs shall comply with all applicable parts of 35 Ill. Adm. Code 306.305(a), (b), (c), and (d).
2. This is a Phase II Permit under USEPA's 1994 CSO Policy requiring implementation of the LTCP submitted by the Permittee to IEPA on December 16, 2010 and May 14, 2013. The implementation schedule can be found under the Additional Action Items and Required Reporting of this Special Condition (Item O). Consistent with the design conditions of the LTCP, the numeric water quality based effluent limitations for the CSOs in this permit are that there shall be no more than 4 CSO discharges from any specific outfall during any 12 month period of time. This limitation shall become effective on December 31, 2025. Each renewal application for this facility must include a re-evaluation of the Permittee's financial capability to implement CSO controls. All provisions of this Special Condition shall stay in effect prior to and after completion of construction. Progress reports shall be submitted to the Agency six (6) months from the effective date of this Permit and every six (6) months thereafter.
3. The Illinois River shall be monitored upstream and downstream of the outfalls during construction. A plan for monitoring water quality during construction shall be submitted to the Agency within nine (9) months of the effective date of this Permit. This water quality monitoring plan shall be implemented within six (6) months of the date of IEPA approval. Upon completion of construction, post-construction monitoring shall be implemented for a twenty-four (24) month period. Within thirty (30) months of completion of construction, the results shall be submitted to the IEPA along with recommendations and conclusions as to whether or not the discharges from any of the CSOs (treated or untreated) authorized by this Permit are causing or contributing to violations of applicable water quality standards or causing use impairment in the receiving water(s).
4. Should the results of the post-construction water quality monitoring plan or if information becomes available that causes IEPA to conclude that the discharges from any of the CSOs (treated or untreated) authorized to discharge under this Permit are causing or contributing to violations of water quality standards or are causing use impairment in the receiving water(s), the IEPA will notify the Permittee in writing. Upon receiving such notification, the Permittee shall develop and implement a revised CSO Long-Term Control Plan (LTCP) for assuring that the discharges from the CSOs (treated or untreated) authorized in this Permit comply with the provisions of Paragraph L.1 above. The revised LTCP shall contain all applicable elements of Paragraph L.5 below including a schedule for implementation and provisions for re-evaluating compliance with applicable standards and regulations after implementation. Three (3) copies of the revised LTCP shall be submitted to the IEPA within twelve (12) months of receiving the IEPA written notice. The LTCP shall be:
 - a. Consistent with Section II.C.4.a.i of the Policy; or,
 - b. Consistent with either Section II.C.4.a.ii, Section II.C.4.a.iii, or Section II.C.4.b of the Policy and be accompanied by data sufficient to demonstrate that the LTCP, when completely implemented, will be sufficient to meet water quality standards.
5. Pursuant to the Policy, the required components of the LTCP include the following:
 - a. Characterization, monitoring, and modeling of the Combined Sewer System (CSS);
 - b. Consideration of Sensitive Areas;
 - c. Evaluation of alternatives;
 - d. Cost/Performance considerations;
 - e. Revised CSO Operational Plan;

Special Conditions

- f. Maximizing treatment at the treatment plant;
- g. Implementation schedule;
- h. Post-Construction compliance monitoring program; and
- i. Public participation.

Following submittal of the revised LTCP, the Permittee shall respond to any initial IEPA review letter in writing within ninety (90) days of the date of such a review letter, and within thirty (30) days of any subsequent review letter(s), if any. Implementation of the revised LTCP shall be as indicated by IEPA in writing or other enforceable mechanism.

- M. A public notification program in accordance with Section II.B.8 of the federal CSO Control Policy of 1994 shall be developed employing a process that actively informs the affected public. The program shall include at a minimum public notification of CSO occurrences and CSO impacts, with consideration given to including mass media and/or Internet notification. The Permittee shall post and maintain signs in waters likely to be impacted by CSO discharges at the point of discharge and at points where these waters are used for primary contact recreation. Signage's message should be visible from both shoreline and water vessel approach (if appropriate), respectively. Provisions shall be made to include modifications of the program when necessary and notification to any additional member of the affected public. The program shall be presented to the general public at a public information meeting conducted by the Permittee. The Permittee shall conduct the public information meeting providing a summary and status of the CSO control program annually during the term of this Permit. The Permittee shall submit documentation that the public information meeting was held, shall submit a summary of all significant issues raised by the public and the Permittee's response to each issue and shall identify any modifications to the program as a result of the public information meeting within 60 days of holding the public meeting. The Permittee shall submit copies of the public notification program to the IEPA upon written request.
- N. If any of the CSO discharge points listed in this permit are eliminated, or if additional CSO discharge points, not listed in this permit, are discovered, the Permittee shall notify the IEPA in writing within one (1) month of the respective outfall elimination or discovery. Such notification shall be in the form of a request for the appropriate modification of this NPDES Permit.

Summary of Compliance Dates in this CSO Special Condition

- O. a. The following summarizes the dates that submittals contained in this Special Condition are due at the IEPA (unless otherwise indicated):

Submission of CSO Monitoring Data (Paragraph A)	25th of every month
Elimination of a CSO or Discovery of Additional CSO Locations (Paragraph N)	1 month from discovery or elimination
Certification of Sewer Use Ordinance Review (Paragraph K)	6 months from the effective date of this Permit
Conduct Pollution Prevention and PN Public Information Meeting (Paragraphs H and M)	Annually
No Submittal Due with this Milestone	
Conduct OMP Meeting and Submit Water Quality Monitoring Plan (Paragraphs J and L)	9 months from the effective date of this Permit
Submit Pollution Prevention Certification and OMP Certification (Paragraphs H and J)	12 months from the effective date of this Permit
Submit PN Information Meeting Summary (Paragraph M)	60 days after public meeting
CSO Long-Term Control Plan (Paragraph L)	
Complete LTCP construction to meet Presumptive Approach and Implement Full Operation	December 31, 2025
b. Additional Action Items and Required Reporting	
Progress Reports	Six Months from effective date and every six months thereafter

Special Conditions

Baker Avenue Separation Construction Completed	July 31, 2016
Underground Storage Facility #1 Construction Completed	October 31, 2017
Underground Storage Facility #2 Construction Completed	December 31, 2019
Underground Storage Facility #3 Construction Completed	December 31, 2021
Underground Storage Facility #4 Construction Completed	December 31, 2023
Underground Storage Facility #5 Construction Completed	December 31, 2025
Submit Results of Post-Construction Monitoring Plan (Paragraph L)	30 months after completion of construction

All submittals listed in this Special Condition can be mailed to the following address:

Illinois Environmental Protection Agency
 Division of Water Pollution Control
 1021 North Grand Avenue East
 Post Office Box 19276
 Springfield, Illinois 62794-9276

Attention: CSO Coordinator, Compliance Assurance Section

All submittals hand carried shall be delivered to 1021 North Grand Avenue East.

Reopening and Modifying this Permit

- P. The IEPA may initiate a modification for this Permit at any time to include requirements and compliance dates which have been submitted in writing by the Permittee and approved by the IEPA, or other requirements and dates which are necessary to carry out the provisions of the Illinois Environmental Protection Act, the Clean Water Act, or regulations promulgated under those Acts. Public Notice of such modifications and opportunity for public hearing shall be provided.

SPECIAL CONDITION 16. This Permit may be modified to include alternative or additional final effluent limitations pursuant to an approved Total Maximum Daily Load (TMDL) Study or upon completion of an alternate Water Quality Study.

SPECIAL CONDITION 17. The Permittee shall conduct biomonitoring of the effluent from Discharge Number(s) B01.

Biomonitoring

- A. Acute Toxicity - Standard definitive acute toxicity tests shall be run on at least two trophic levels of aquatic species (fish, invertebrate) representative of the aquatic community of the receiving stream. Testing must be consistent with Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms (Fifth Ed.) EPA/821-R-02-012. Unless substitute tests are pre-approved; the following tests are required:
1. Fish - 96 hour static LC₅₀ Bioassay using fathead minnows (*Pimephales promelas*).
 2. Invertebrate 48-hour static LC₅₀ Bioassay using *Ceriodaphnia*.
- B. Testing Frequency - The above tests shall be conducted using 24-hour composite samples unless otherwise authorized by the IEPA. Samples must be collected in the 18th, 15th, 12th, and 9th month prior to the expiration date of this Permit.
- C. Reporting - Results shall be reported according to EPA/821-R-02-012, Section 12, Report Preparation, and shall be submitted to IEPA, Bureau of Water, Compliance Assurance Section within one week of receipt from the laboratory. Reports are due to the IEPA no later than the 16th, 13th, 10th, and 7th month prior to the expiration date of this Permit.
- D. Toxicity - Should a bioassay result in toxicity to >20% of organisms test in the 100% effluent treatment, the IEPA may require, upon notification, six (6) additional rounds of monthly testing on the affected organism(s) to be initiated within 30 days of the toxic bioassay. Results shall be submitted to IEPA within (1) week of becoming available to the Permittee. Should any of the additional bioassays result in toxicity to ≥50% of organisms tested in the 100% effluent treatments, the Permittee shall immediately notify IEPA in writing of the test results.

Special Conditions

- E. Toxicity Reduction Evaluation and Identification - Should the biomonitoring program identify toxicity and result in notification by IEPA, the permittee shall develop a plan for toxicity reduction evaluation and identification. The plan shall be developed and implemented in accordance with Toxicity Reduction Evaluation Guidance for Municipal Wastewater Treatment Plants, EPA/833B-99/002, and shall include an evaluation to determine which chemicals have a potential for being discharged in the plant wastewater, a monitoring program to determine their presence or absence and to identify other compounds which are not being removed by treatment, and other measures as appropriate. The Permittee shall submit to the IEPA its plan within ninety (90) days following notification by the IEPA. The Permittee shall implement the plan within ninety (90) days of notification of the permittee above or other such date as is received by IEPA.

The IEPA may modify this Permit during its term to incorporate additional requirements or limitations based on the results of the biomonitoring. In addition, after review of the monitoring results and toxicity reduction evaluation, the IEPA may modify this Permit to include numerical limitations for specific toxic pollutants and additional whole effluent toxicity monitoring to confirm the results of the evaluation. Modifications under this condition shall follow public notice and opportunity for hearing.

SPECIAL CONDITION 18. A zone of initial dilution (ZID) is recognized for ammonia and residual chlorine with dimensions of 10.6 feet across the width of the river from the end-of-pipe and 13.25 feet downstream from this point. Within the ZID, 17.2:1 dilution is afforded. A mixing zone is recognized with dimensions extending 57 feet across the width of the river and 218 feet downstream. Within the mixing zone, 171:1 dilution is afforded.

SPECIAL CONDITION 19. The Permittee shall work towards the goals of achieving no discharges from sanitary sewer overflows or basement back-ups and ensuring that overflows or back-ups, when they do occur do not cause or contribute to violations of applicable standards or cause impairment in any adjacent receiving water. Overflows from sanitary sewers are expressly prohibited by this Permit and by Ill. Adm. Code 306.304. In order to accomplish these goals of complying with this prohibition and mitigating the adverse impacts of any such overflows if they do occur, the Permittee shall (A) identify and report to IEPA all SSOs that do occur, and (B) develop, implement and submit to the IEPA a Capacity, Management, Operations, and Maintenance (CMOM) plan which includes an Asset Management strategy within twelve (12) months of the effective date of this Permit or review and revise any existing plan accordingly. The permittee shall modify the Plan to incorporate any comments that it receives from IEPA and shall implement the modified plan as soon as possible. The Permittee should work as appropriate, in consultation with affected authorities at the local, county, and/or state level to develop the plan components involving third party notification of overflow events. The Permittee may be required to construct additional sewage transport and/or treatment facilities in future permits or other enforceable documents should the implemented CMOM plan indicate that the Permittee's facilities are not capable of conveying and treating the flow for which they were designed.

The CMOM plan shall include the following elements:

A. Measures and Activities:

1. A complete map and system inventory for the collection system owned and operated by the Permittee;
2. Organizational structure; budgeting; training of personnel; legal authorities; schedules for maintenance, sewer system cleaning, and preventative rehabilitation; checklists, and mechanisms to ensure that preventative maintenance is performed on equipment owned and operated by the Permittee;
3. Documentation of unplanned maintenance;
4. An assessment of the capacity of the collection and treatment system owned and operated by the Permittee at critical junctions and immediately upstream of locations where overflows and back-ups occur or are likely to occur; use flow monitoring as necessary;
5. Identification and prioritization of structural deficiencies in the system owned and operated by the Permittee;
6. Operational control, including documented system control procedures, scheduled inspections and testing;
7. The Permittee shall develop and implement an Asset Management strategy to ensure the long-term sustainability of the collection system. Asset management shall be used to assist the Permittee in making decisions on when it is most appropriate to repair, replace or rehabilitate particular assets and develop long-term funding strategies; and
8. Asset management shall include but is not limited to the following elements:
 - a. Asset Inventory and State of the Asset;
 - b. Level of Service;
 - c. Critical Asset Identification;
 - d. Life Cycle Cost; and
 - e. Long-Term Funding Strategy.

B. Design and Performance Provisions:

1. Monitor the effectiveness of CMOM;
2. Upgrade the elements of the CMOM plan as necessary; and
3. Maintain a summary of CMOM activities.

Special Conditions

C. Overflow Response Plan:

1. Know where overflows and back-ups within the facilities owned and operated by the Permittee occur;
2. Respond to each overflow or back-up to determine additional actions such as clean up; and
3. Locations where basement back-ups and/or sanitary sewer overflows occur shall be evaluated as soon as practicable for excessive inflow /infiltration, obstructions or other causes of overflows or back-ups as set forth in the System Evaluation Plan.

D. System Evaluation Plan:

1. Summary of existing SSO and Excessive I/I areas in the system and sources of contribution;
2. Evaluate plans to reduce I/I and eliminate SSOs;
3. Special provisions for Pump Stations and force mains and other unique system components; and
4. Construction plans and schedules for correction.

E. Reporting and Monitoring Requirements:

1. Program for SSO detection and reporting; and
2. Program for tracking and reporting basement back-ups, including general public complaints.

F. Third Party Notice Plan:

1. Describes how, under various overflow scenarios, the public, as well as other entities, would be notified of overflows within the Permittee's system that may endanger public health, safety or welfare;
2. Identifies overflows within the Permittee's system that would be reported, giving consideration to various types of events including events with potential widespread impacts;
3. Identifies who shall receive the notification;
4. Identifies the specific information that would be reported including actions that will be taken to respond to the overflow;
5. Includes a description of the lines of communication; and
6. Includes the identities and contact information of responsible POTW officials and local, county, and/or state level officials.

For additional information concerning USEPA CMOM guidance and Asset Management please refer to the following web site addresses.
http://www.epa.gov/npdes/pubs/cmom_guide_for_collection_systems.pdf and
http://water.epa.gov/type/watersheds/wastewater/upload/guide_smallsystems_assetmanagement_bestpractices.pdf

SPECIAL CONDITION 20. The Permittee shall, within twenty four (24) months of the effective date of this permit, prepare and submit to the Agency a feasibility study that identifies the method, timeframe, and costs of reducing phosphorus levels in its discharge to a level consistently meeting a potential future effluent limit of 1.0 mg/L, 0.5 mg/L and 0.1 mg/L. The study shall evaluate the construction and O & M costs of the application of these limits on a monthly, seasonal and annual average basis.

SPECIAL CONDITION 21. The Permittee shall develop and submit to the Agency a Phosphorus Discharge Optimization Plan within eighteen (18) months of the effective date of this permit. The plan shall include a schedule for the implementation of these optimization measures. Annual progress reports on the optimization of the existing treatment facilities shall be submitted to the Agency by March 31 of each year. In developing the plan, the Permittee shall evaluate a range of measures for reducing phosphorus discharges from the treatment plant, including possible source reduction measures, operational improvements, and minor facility modifications that will optimize reductions in phosphorus discharges from the wastewater treatment facility. The Permittee's evaluation shall include, but not be limited to, an evaluation of the following optimization measures:

- A. WWTF influent reduction measures.
 1. Evaluate the phosphorus reduction potential of users.
 2. Determine which sources have the greatest opportunity for reducing phosphorus (i.e., industrial, commercial, institutional, municipal and others).
 - a. Determine whether known sources (i.e., restaurant and food preparation) can adopt phosphorus minimization and water conservation plans.
 - b. Evaluate implementation of local limits on influent sources of excessive phosphorus.
- B. WWTF effluent reduction measures.
 1. Reduce phosphorus discharges by optimizing existing treatment processes without causing non-compliance with permit effluent limitations or adversely impacting stream health.
 - a. Adjust the solids retention time for biological phosphorus removal.
 - b. Adjust aeration rates to reduce dissolved oxygen and promote biological phosphorus removal.
 - c. Change aeration settings in plug flow basins by turning off air or mixers at the inlet side of the basin system.
 - d. Minimize impact on recycle streams by improving aeration within holding tanks.
 - e. Adjust flow through existing basins to enhance biological nutrient removal.

Special Conditions

- f. Increase volatile fatty acids for biological phosphorus removal.

SPECIAL CONDITION 22. The Agency shall consider all monitoring data submitted by the discharger in accordance with the monitoring requirements of this permit for all parameters, including but not limited to data pertaining to ammonia and dissolved oxygen for discharges from Discharge Number 001, to determine whether the discharges are at levels which cause, have the reasonable potential to cause or contribute to exceedances of water quality standards; and, if so, to develop appropriate water quality based effluent limitations. If the discharger wants the Agency to consider mixing when considering the need for and establishment of water quality based effluent limitations, the discharger shall submit a study plan on mixing to the Agency for the Agency's review and comment within two (2) months of the effective date of this Permit.