

NPDES Permit No. IL0068365

Notice No. KAR:13040806.bah

Public Notice Beginning Date: **July 17, 2015**

Public Notice Ending Date: **August 17, 2015**

National Pollutant Discharge Elimination System (NPDES)
Permit Program

PUBLIC NOTICE/FACT SHEET
of
Draft Reissued NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois EPA
Division of Water Pollution Control
Permit Section
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276
217/782-0610

Name and Address of Permittee:

City of Marshall
201 South Michigan
Marshall, Illinois 62441

Name and Address of Facility:

City of Marshall STP
1791 Treatment Plant Road
Marshall, Illinois
(Clark County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES Permit to discharge into the waters of the state and has prepared a draft Permit and associated fact sheet for the above named Permittee. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. All comments on the draft Permit and requests for hearing must be received by the IEPA by U.S. Mail, carrier mail or hand delivered by the Public Notice Ending Date. Interested persons are invited to submit written comments on the draft Permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the Permit applicant. The NPDES Permit and notice numbers must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft Permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicate a significant degree of public interest in the draft Permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final Permit is issued. For further information, please call Keith Runge at 217/782-0610.

The following water quality and effluent standards and limitations were applied to the discharge:

Title 35: Environmental Protection, Subtitle C: Water Pollution, Chapter I: Pollution Control Board and the Clean Water Act were applied in determining the applicable standards, limitations and conditions contained in the draft Permit.

The applicant is engaged in treating domestic wastewater for the City of Marshall.

The length of the Permit is approximately 5 years.

The main discharge number is 001. The seven day once in ten year low flow (7Q10) of the receiving stream, Little Creek tributary to Big Creek is 0 cfs.

The design average flow (DAF) for the facility is 0.45 million gallons per day (MGD) and the design maximum flow (DMF) for the facility is 1.35 MGD. Treatment consists of screening, aerated lagoons and rock filter.

This Reissued Permit does not increase the facility's DAF, DMF, concentration limits, and/or load limits.

Pursuant to the waiver provisions authorized by 40 CFR § 123.24, this draft permit is within the class, type, and size for which the Regional Administrator, Region V, has waived his right to review, object, or comment on this draft permit action.

This Permit recognizes and continues the year-round disinfection exemption approved by the IEPA on May 6, 1988 and included in past NPDES permit actions since that date. It is the IEPA's tentative decision that under Illinois Pollution Control Board regulations, the following reach of waterbody is not classified for primary contact use activities and is not subject to the fecal coliform water quality standard of 35 Ill. Adm. Code 302.209.

This draft permit does not contain requirements for disinfection of the discharge from discharge numbers(s) 001. Little Creek from the point of discharge to the confluence of Big Creek has been determined to be unsuited to support primary contact activities (swimming) due to physical, hydrologic or geographic configuration. Anyone knowing of primary contact activities occurring within this water segment is invited to submit comments to the IEPA. Comments should give the nature of the activities (i.e swimming, fishing, canoeing, etc.), the location and months of the year when these activities have been observed. The IEPA is also interested in obtaining information on the proximity of residential dwellings and the accessibility of the public to this water segment. Anyone with such information is asked to submit comments to the IEPA on this draft permit action. Instructions for submitting comments are contained earlier in this document.

Application is made for the existing discharge(s) which is located in Clark County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

<u>Discharge Number</u>	<u>Receiving Stream</u>	<u>Latitude</u>	<u>Longitude</u>	<u>Stream Classification</u>	<u>Integrity Rating</u>
001	Little Creek tributary to Big Creek	39° 23' 30" North	87° 40' 48" West		
002	Little Creek tributary to Big Creek	39° 23' 31" North	87° 40' 49" West		
003	Unnamed tributary of East Mill Creek	39° 23' 15" North	87° 42' 37" West		
004	Unnamed tributary of East Mill Creek	39° 23' 17" North	87° 42' 37" West		

To assist you further in identifying the location of the discharge(s) please see the attached map.

This permit authorizes discharge from 2 CSOs in accordance with 35 Ill. Adm. Code 306.305.

CSO controls consist of settling and disinfection for outfall 004.

Little Creek, a tributary to waterbody segment BJ-01, is not listed on the draft 2014 Illinois Integrated Water Quality Report and Section 303(d) List since it has not been assessed.

Unnamed tributary of East Mill Creek waterbody segment BHF, is not listed on the draft 2014 Illinois Integrated Water Quality Report and Section 303(d) List since it has not been assessed.

The discharge(s) from the facility is (are) proposed to be monitored and limited at all times as follows:

Discharge Number(s) and Name(s): 001

Load limits computed based on a design average flow (DAF) of 0.45 MGD (design maximum flow (DMF) of 1.35 MGD).

The effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day DAF (DMF)*			CONCENTRATION LIMITS mg/L			Regulation
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum	
CBOD ₅	94 (281)	150 (450)		25	40		35 IAC 304.120 40 CFR 133.102
Suspended Solids	139 (417)	169 (507)		37	45		35 IAC 304.120 40 CFR 133.102
pH	Shall be in the range of 6 to 9 Standard Units						35 IAC 304.125
Fecal Coliform	Monitor Only (May through October)						35 IAC 309.146
Chlorine Residual						0.05	35 IAC 302.208
Ammonia (as N)	Monitor Only						35 IAC 302.208
				Monthly Avg. not less than	Weekly Avg. not less than	Daily Minimum	
Dissolved Oxygen March-July				N/A	6.0	5.0	35 IAC 302.206
August-February				5.5	4.0	3.5	

*Load Limits are calculated by using the formula: $8.34 \times (\text{Design Average and/or Maximum Flow in MGD}) \times (\text{Applicable Concentration in mg/L})$.

The discharge(s) from the facility is (are) proposed to be monitored and limited at all times as follows:

Discharge Number(s) and Name(s): 004 Treated CSO from abandoned West Side Treatment Plant.


The effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day DAF (DMF)*			CONCENTRATION LIMITS mg/L			Regulation
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum	
CBOD ₅							35 IAC 304.120 40 CFR 133.102
Suspended Solids							35 IAC 304.120 40 CFR 133.102
pH	Shall be in the range of 6 to 9 Standard Units						35 IAC 304.125
Fecal Coliform	Daily Maximum shall not exceed 400 per 100 mL						35 IAC 309.145
Ammonia (as N)	Monitor Only						35 IAC 302.208
Chlorine Residual				0.75			35 IAC 302.208

*Load Limits are calculated by using the formula: $8.34 \times (\text{Design Average and/or Maximum Flow in MGD}) \times (\text{Applicable Concentration in mg/L})$.

This draft Permit also contains the following requirements as special conditions:

1. Reopening of this Permit to include different final effluent limitations.
2. Operation of the facility by or under the supervision of a certified operator.
3. Submission of the operational data in a specified form and at a required frequency at any time during the effective term of this Permit.
4. More frequent monitoring requirement without Public Notice in the event of operational, maintenance or other problems resulting in possible effluent deterioration.
5. Prohibition against causing or contributing to violations of water quality standards.
6. Recording the monitoring results on Discharge Monitoring Report Forms using one such form for each outfall each month and submitting the forms to IEPA each month.
7. The provisions of 40 CFR Section 122.41(m) & (n) are incorporated herein by reference.
8. Effluent sampling point location.
9. At minimum of 85% removal of CBOD₅ and suspended solids.
10. Controlling the sources of infiltration and inflow into the sewer system.
11. A requirement to monitor and a limit of 0.05 mg/L for residual chlorine when it is used.
12. Submission of annual fiscal data.
13. An authorization of combined sewer and treatment plant discharges.
14. Submission of Capacity, Management, Operations, and Maintenance (CMOM) plan.

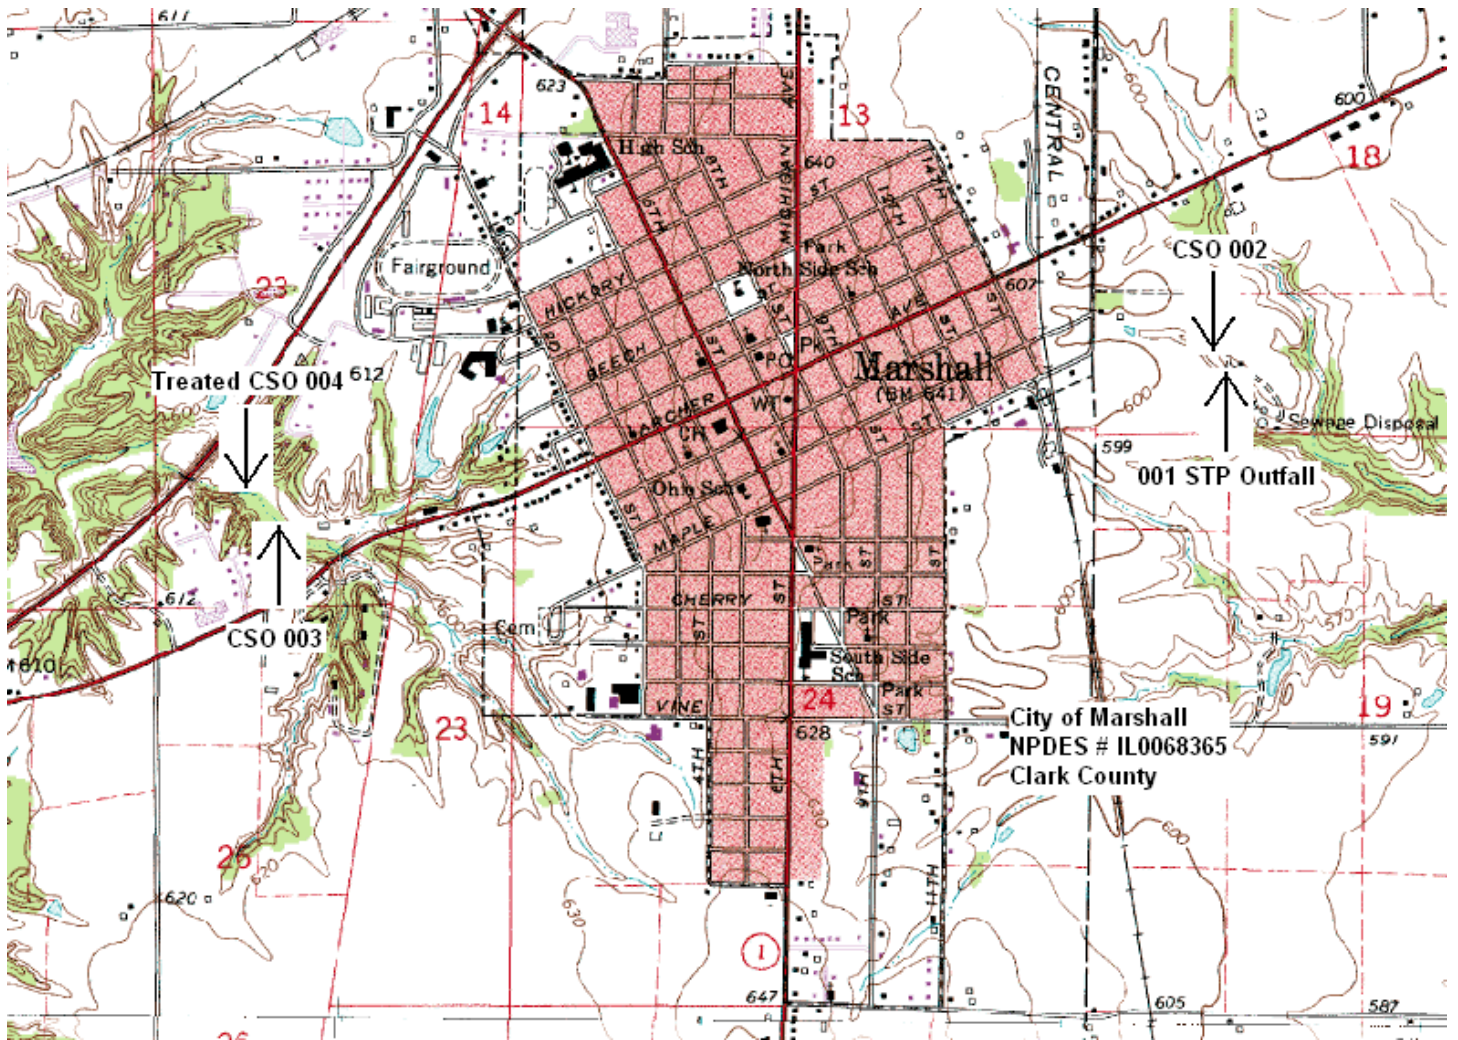

NPDES Permit No. IL0068365

Illinois Environmental Protection Agency

Division of Water Pollution Control

1021 North Grand Avenue East

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Reissued (NPDES) Permit

Expiration Date:

Issue Date:

Effective Date:

Name and Address of Permittee:

City of Marshall
201 South Michigan
Marshall, Illinois 62441

Facility Name and Address:

City of Marshall STP
1791 Treatment Plant Road
Marshall, Illinois
(Clark County)

Receiving Waters: Little Creek tributary to Big Creek

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of the Ill. Adm. Code, Subtitle C, Chapter I, and the Clean Water Act (CWA), the above-named Permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the standard conditions and attachments herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the Permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Alan Keller, P.E.
Manager, Permit Section
Division of Water Pollution Control

SAK:KAR:13040806.bah

NPDES Permit No. IL0068365

Effluent Limitations, Monitoring, and Reporting

FINAL

Discharge Number(s) and Name(s): 001

Load limits computed based on a design average flow (DAF) of 0.45 MGD (design maximum flow (DMF) of 1.35 MGD).

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day DAF (DMF)*			CONCENTRATION LIMITS mg/L			Sample Frequency	Sample Type
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum		
Flow (MGD)							Continuous	
CBOD ₅ **	94 (281)	150 (450)		25	40		2 Days/Month	Composite
Suspended Solids	139 (417)	169 (507)		37	45		2 Days/Month	Composite
pH	Shall be in the range of 6 to 9 Standard Units						2 Days/Month	Grab
Fecal Coliform***	Monitor Only (May through October)						2 Days/Month	Grab
Chlorine Residual						0.05	****	Grab
Ammonia (as N)	Monitor Only						2 Day/Month	Grab
				Monthly Average not less than	Weekly Average not less than	Daily Minimum		
Dissolved Oxygen March-July				N/A	6.0	5.0	2 Days/Month	Grab
August-February				5.5	4.0	3.5	2 Days/Month	Grab

*Load limits based on design maximum flow shall apply only when flow exceeds design average flow.

**Carbonaceous BOD₅ (CBOD₅) testing shall be in accordance with 40 CFR 136.

*** Fecal Coliform shall be monitored May through October with sample results reported as a daily maximum value on the DMR

**** See Special Condition 11.

There shall be no discharges from 002 outfall until a flow of 8.9 MGD is being conveyed to the treatment plant.

There shall be no discharges from 003 outfall until a flow of 5.2 MGD is being conveyed to the East Sewage Treatment Plant.

Flow shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

pH shall be reported on the DMR as minimum and maximum value.

Chlorine Residual shall be reported on DMR as daily maximum value.

Dissolved oxygen shall be reported on the DMR as a minimum value.

Discharge Number(s) and Name(s): 004 Treated CSO from abandoned West Side Treatment Plant

These flows facilities shall not be utilized until the main treatment facility is receiving its maximum practical flow.

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day DAF (DMF)*			CONCENTRATION LIMITS mg/L			Sample Frequency	Sample Type
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum		
Total Flow (MG)	See Below						Daily When Discharging	Grab
BOD ₅							Daily When Discharging	Grab
Suspended Solids							Daily When Discharging	Grab
Fecal Coliform	Daily Maximum Shall Not Exceed 400 per 100 mL						Daily When Discharging	Grab
pH	Shall be in the range of 6 to 9 Standard Units						Daily When Discharging	Grab
Ammonia (as N)	Monitor Only						Daily When Discharging	Grab
Chlorine Residual					0.75		Daily When Discharging	Grab

Total flow in million gallons shall be reported on the Discharge Monitoring Report (DMR) in the quantity maximum column. Flow measurements shall be continuous if hardware allows, otherwise measurements shall be at a frequency sufficient to ensure an accurate estimation of total flow, but in no case shall flow measurements frequency be less than daily while discharging.

Report the number of days of discharge in the comments section of the DMR.

Fecal Coliform shall be reported on the DMR as a daily maximum value.

pH shall be reported on the DMR as minimum and maximum value.

Chlorine Residual shall be reported on DMR as daily maximum value.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration

Influent Monitoring, and Reporting

The influent to the plant shall be monitored as follows:

Parameter	Sample Frequency	Sample Type
Flow (MGD)	Continuous	
BOD ₅	2 Days/Month	Composite
Suspended Solids	2 Days/Month	Composite

Influent samples shall be taken at a point representative of the influent.

Flow (MGD) shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration.

Special Conditions

SPECIAL CONDITION 1. This Permit may be modified to include different final effluent limitations or requirements which are consistent with applicable laws and regulations. The IEPA will public notice the permit modification.

SPECIAL CONDITION 2. The use or operation of this facility shall be by or under the supervision of a Certified Class 4 operator.

SPECIAL CONDITION 3. The IEPA may request in writing submittal of operational information in a specified form and at a required frequency at any time during the effective period of this Permit.

SPECIAL CONDITION 4. The IEPA may request more frequent monitoring by permit modification pursuant to 40 CFR § 122.63 and Without Public Notice.

SPECIAL CONDITION 5. The effluent, alone or in combination with other sources, shall not cause a violation of any applicable water quality standard outlined in 35 Ill. Adm. Code 302.

SPECIAL CONDITION 6. The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) Forms using one such form for each outfall each month.

In the event that an outfall does not discharge during a monthly reporting period, the DMR Form shall be submitted with no discharge indicated.

The Permittee may choose to submit electronic DMRs (NetDMRs) instead of mailing paper DMRs to the IEPA. More information, including registration information for the NetDMR program, can be obtained on the IEPA website, <http://www.epa.state.il.us/water/net-dmr/index.html>.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 25th day of the following month, unless otherwise specified by the permitting authority.

Permittees not using NetDMRs shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency
Division of Water Pollution Control
Attention: Compliance Assurance Section, Mail Code # 19
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 7. The provisions of 40 CFR Section 122.41(m) & (n) are incorporated herein by reference.

SPECIAL CONDITION 8. Samples taken in compliance with the effluent monitoring requirements shall be taken at a point representative of the discharge, but prior to entry into the receiving stream.

SPECIAL CONDITION 9. BOD₅ and Suspended Solids (85% removal required) For Discharge No. 001: In accordance with 40 CFR 133, the 30-day average percent removal shall not be less than 85 percent except as provided in Sections 133.103 and 133.105. The percent removal need not be reported to the IEPA on DMRs but influent and effluent data must be available, as required elsewhere in this Permit, for IEPA inspection and review. For measuring compliance with this requirement, 5 mg/L shall be added to the effluent CBOD₅ concentration to determine the effluent BOD₅ concentration.

Percent removal is a percentage expression of the removal efficiency across a treatment plant for a given pollutant parameter, as determined from the 30-day average values of the raw wastewater influent concentrations to the facility and the 30-day average values of the effluent pollutant concentrations for a given time period.

SPECIAL CONDITION 10. This Permit may be modified to include requirements for the Permittee on a continuing basis to evaluate and detail its efforts to effectively control sources of infiltration and inflow into the sewer system and to submit reports to the IEPA if necessary.

SPECIAL CONDITION 11. For Discharge No. 001, any use of chlorine to control slime growths, odors or as an operational control, etc. shall not exceed the limit of 0.05 mg/L (daily maximum) total residual chlorine in the effluent.

Special Conditions

Sampling is required on a daily grab basis during the chlorination process. Reporting shall be submitted on the DMR's on a monthly basis.

SPECIAL CONDITION 12. During January of each year the Permittee shall submit annual fiscal data regarding sewerage system operations to the Illinois Environmental Protection Agency/Division of Water Pollution Control/Compliance Assurance Section. The Permittee may use any fiscal year period provided the period ends within twelve (12) months of the submission date.

Submission shall be on forms provided by IEPA titled "Fiscal Report Form For NPDES Permittees".

SPECIAL CONDITION 13.

AUTHORIZATION OF
COMBINED SEWER AND TREATMENT PLANT DISCHARGES

The IEPA has determined that at least a portion of the collection system consists of combined sewers. References to the collection system and the sewer system refer only to those parts of the system which are owned and operated by the Permittee unless otherwise indicated. The Permittee is authorized to discharge from the overflow(s)/bypass(es) listed below provided the diversion structure is located on a combined sewer and the following terms and conditions are met:

<u>Discharge Number</u>	<u>Location</u>	<u>Receiving Water</u>
002	East STP CSO	Little Creek
003	South Church Street & Richland Creek	Unnamed
tributary of East Mill Creek		

A. CSO Monitoring, Reporting and Notification Requirements

- The Permittee shall monitor the frequency of discharge (number of discharges per month) and estimate the duration (in hours) of each discharge from each outfall listed in this Special Condition. Estimates of storm duration and total rainfall shall be provided for each storm event.

<u>Start Date</u>	<u>Rainfall Duration (hrs.)</u>	<u>Rainfall Amount (in.)</u>	<u>CSO Outfall #</u>	<u>Outfall Description</u>	<u>Estimated Duration of CSO Discharge (hrs.)</u>	<u>Estimated Volume of CSO Discharge (MG)</u>
-------------------	---------------------------------	------------------------------	----------------------	----------------------------	---	---

For frequency reporting, all discharges from the same storm, or occurring within 24 hours, shall be reported as one. The date that a discharge commences shall be recorded for each outfall. Reports shall be in the form specified by the IEPA and on forms provided by the IEPA (e.g., Form IL 532-2471, or updated form of same). These forms shall be submitted to the IEPA monthly with the DMRs and covering the same reporting period as the DMRs. Parameters (other than flow frequency and volume), if required in this Permit, shall be sampled and reported as indicated in the transmittal letter for such report forms.

- All Submittals listed in this Special Condition can be mailed to the following address:

Illinois Environmental Protection Agency
Division of Water Pollution Control
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

Attention: CSO Coordinator, Compliance Assurance Section

All submittals hand carried shall be delivered to 1021 North Grand Avenue East

B. CSO Treatment Requirements

- All combined sewer overflows and treatment plant bypasses shall be given sufficient treatment to prevent

Special Conditions

pollution and the violation of applicable water quality standards and to the extent required by the federal Clean Water Act, the 1994 CSO Control Policy including any amendments made by the Wet Weather Water Quality Act of 2000. Sufficient treatment consists of the following:

- a. All dry weather flows, the first flush of storm flows, and additional flows, but not less than ten times the average dry weather flow for the design year, shall be conveyed to Marshall sewage treatment plant for treatment.
4. All CSO discharges authorized by this Permit shall be treated, in whole or in part, to the extent necessary to prevent accumulations of sludge deposits, floating debris and solids in accordance with 35 Ill. Adm. Code 302.203 and to prevent depression of oxygen levels below the applicable water quality standards.
5. Overflows during dry weather are prohibited. Dry weather overflows shall be reported to the IEPA pursuant to Standard Condition 12(f) of this Permit (24 hour notice).
6. The collection system shall be operated to optimize transport of wastewater flows and to minimize CSO discharges and the treatment system shall be operated to maximize treatment of wastewater flows.

C. CSO Nine Minimum Controls

7. The Permittee shall comply with the nine minimum controls contained in the National CSO Control Policy published in the Federal Register on April 19, 1994. The nine minimum controls are:
 - a. Proper operation and maintenance programs for the sewer system and the CSOs;
 - b. Maximum use of the collection system for storage;
 - c. Review and modification of pretreatment requirements to assure CSO impacts are minimized;
 - d. Maximization of flow to the POTW for treatment;
 - e. Prohibition of CSOs during dry weather;
 - f. Control of solids and floatable materials in CSOs;
 - g. Pollution prevention programs which focus on source control activities;
 - h. Public notification to ensure that citizens receive adequate information regarding CSO occurrences and CSO impacts; and,
 - i. Monitoring to characterize impacts and efficiency of CSO controls.

A CSO pollution prevention plan (PPP) shall be developed by the Permittee unless one has already been prepared for this collection system. Any previously-prepared PPP shall be reviewed, and revised if necessary, by the Permittee to address the items contained in Chapter 8 of the U.S. EPA guidance document, Combined Sewer Overflows, Guidance For Nine Minimum Controls, and any items contained in previously-sent review documents from the IEPA concerning the PPP. Combined Sewer Overflows, Guidance For Nine Minimum Controls is available on line at <http://www.epa.gov/npdes/pubs/owm0030.pdf>. The PPP (or revised PPP) shall be presented to the general public at a public information meeting conducted by the Permittee annually during the term of the effective date of this Permit. The Permittee shall submit documentation that the pollution prevention plan complies with the requirements of this Permit and that the public information meeting was held. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Pollution Prevention Plan Certification" one (1) with original signatures. This certification form is available online at <http://www.epa.state.il.us/water/permits/waste-water/forms/cso-pol-prev.pdf>. Following the public meeting, the Permittee shall implement the pollution prevention plan and shall maintain a current pollution prevention plan, updated to reflect system modifications, on file at the sewage treatment works or other acceptable location and made available to the public. The pollution prevention plan revisions shall be submitted to the

Special Conditions

IEPA one (1) month from the revision date.

D. Sensitive Area Considerations

8. Pursuant to Section II.C.3 of the federal CSO Control Policy of 1994, sensitive areas are any water likely to be impacted by a CSO discharge which meet one or more of the following criteria: (1) designated as an Outstanding National Resource Water; (2) found to contain shellfish beds; (3) found to contain threatened or endangered aquatic species or their habitat; (4) used for primary contact recreation; or, (5) within the protection area for a drinking water intake structure.

The IEPA has tentatively determined that none of the outfalls listed in this Special Condition discharge to sensitive areas. However, if information becomes available that causes the IEPA to reverse this determination, the IEPA will notify the Permittee in writing. Within three (3) months of the date of notification, or such other date contained in the notification letter, the Permittee shall submit two (2) copies of either a schedule to relocate, control, or treat discharges from these outfalls. If none of these options are possible, the Permittee shall submit adequate justification at that time as to why these options are not possible. Such justification shall be in accordance with Section II.C.3 of the National CSO Control Policy.

E. CSO Operational and Maintenance Plans

9. The Permittee shall implement a CSO O&M plan to reduce, to the greatest extent practicable, the total loading of pollutants and floatables entering the receiving stream and to mitigate, to the greatest extent practicable, the impacts from such loadings, to ensure that the Permittee ultimately achieves compliance with water quality standards. These plans, tailored to the local government's collection and waste treatment system, shall include mechanisms and specific procedures where applicable to ensure:
- a. Collection system inspection on a scheduled basis;
 - b. Sewer, catch basin, and regulator cleaning and maintenance on a scheduled basis;
 - c. Inspections are made and preventive maintenance is performed on all pump/lift stations;
 - d. Collection system replacement, where necessary;
 - e. Detection and elimination of illegal connections;
 - f. Detection, prevention, and elimination of dry weather overflows;
 - g. The collection system is operated to maximize storage capacity and the combined sewer portions of the collection system are operated to delay storm entry into the system; and,
 - h. The treatment and collection systems are operated to maximize treatment.

The IEPA received a CSO operational and maintenance plan "CSO O&M plan" for this sewerage system on February 11, 1998. The Permittee shall fully implement the plan and review and revise, if needed, the CSO O&M plan to reflect system changes and any comments previously sent to the Permittee by the IEPA. The CSO O&M plan shall be presented to the general public at a public information meeting conducted by the Permittee within nine (9) months of the effective date of this Permit. The Permittee shall submit documentation that the public information meeting was held within twelve (12) months of the effective date of this Permit. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Operational Plan Checklist and Certification", one (1) copy with original signatures. Copies of the "CSO Operational Plan Checklist and Certification" are available online at <http://www.epa.state.il.us/water/permits/waste-water/forms/cso-checklist.pdf>. The Permittee shall maintain a current CSO O&M plan, updated to reflect system modifications, on file at the sewage treatment works or other acceptable location and made available to the public. CSO O&M plan revisions shall be implemented immediately and revised plans shall be submitted to the IEPA within one (1) month from the revision date.

F. Sewer Use Ordinances

10. The Permittee, within six (6) months of the effective date of this Permit, shall review and where necessary,

Special Conditions

modify its existing sewer use ordinance to ensure it contains provisions addressing the conditions below. If no ordinance exists, such ordinance shall be developed and implemented within six (6) months from the effective date of this Permit. Upon completion of the review of the sewer use ordinance(s), the Permittee shall submit two (2) copies of a completed "Certification of Sewer Use Ordinance Review", one (1) with original signatures. Copies of the certification form can be obtained on line at <http://www.epa.state.il.us/water/permits/waste-water/forms/sewer-use.pdf>. The Permittee shall submit copies of the sewer use ordinance(s) to the IEPA one (1) month from the revision date. Sewer use ordinances are to contain specific provisions to:

- a. Prohibit introduction of new inflow sources to the sanitary sewer system;
- b. Require that new construction tributary to the combined sewer system be designed to minimize and/or delay inflow contribution to the combined sewer system;
- c. Require that inflow sources on the combined sewer system be connected to a storm sewer, within a reasonable period of time, if a storm sewer becomes available;
- d. Provide that any new building domestic waste connection shall be distinct from the building inflow connection, to facilitate disconnection if a storm sewer becomes available;
- e. Assure that CSO impacts from non-domestic sources are minimized by determining which non-domestic discharges, if any, are tributary to CSOs and reviewing, and, if necessary, modifying the sewer use ordinance to control pollutants in these discharges; and,
- f. Assure that the owners of all publicly owned systems with combined sewers tributary to the Permittee's collection system have procedures in place adequate to ensure that the objectives, mechanisms, and specific procedures given in Paragraph 8 of this Special Condition are achieved.

The Permittee shall enforce the applicable sewer use ordinances.

G. Long-Term Control Planning and Compliance with Water Quality Standards

11.
 - a. Pursuant to Section 301 of the federal Clean Water Act, 33 U.S.C. Section 1311 and 40 CFR Section 122.4, discharges from the CSOs, including the outfalls listed in this Special Condition and any other outfall listed as a "Treated Combined Sewage Outfall", shall not cause or contribute to violations of applicable water quality standards or cause use impairment in the receiving waters. In addition, discharges from CSOs shall comply with all applicable parts of 35 Ill. Adm. Code 306.305(a), (b), (c), and (d).
 - b. Based on available information, it appears that the CSOs authorized in this Permit meet the criteria of Section II.C.4.a.i of the federal CSO Control Policy of 1994 (Policy), not more than four overflow events per year, and are presumed to meet the water quality-based requirements of the federal Clean Water Act. Pursuant to Section I.C.1 and Section II.C.9 of the Policy, the Permittee shall develop a post-construction water quality monitoring program adequate to verify compliance with water quality standards and to verify protection of designated uses in the receiving water(s) and to ascertain the effectiveness of CSO controls. This program shall contain a plan that details the monitoring protocols to be followed, including any necessary effluent and ambient monitoring, and if appropriate, other monitoring protocols such as biological assessments, whole effluent toxicity testing, and sediment sampling. This plan shall be presented to the public at an informational meeting within nine (9) months of the effective date of this Permit. Within twelve (12) months of the effective date of this Permit, the Permittee shall submit a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the final plan (revised following the public meeting, if necessary) implementing the post-construction monitoring program. The post-construction monitoring plan shall be implemented within six (6) months of the date of IEPA approval. The Permittee shall respond to an IEPA review letter in writing within ninety (90) days of the date of such an initial review letter and within thirty (30) days of any subsequent review letter(s), if any. Within thirty (30) months of the approval of

Special Conditions

the plan, the results shall be submitted to the IEPA along with recommendations and conclusions as to whether or not the discharges from any of the CSOs (treated or untreated) authorized by this Permit are causing or contributing to violations of applicable water quality standards or causing use impairment in the receiving water(s).

- c. Should the results of the post-construction water quality monitoring plan or if information becomes available that causes IEPA to conclude that the discharges from any of the CSOs (treated or untreated) authorized to discharge under this Permit are causing or contributing to violations of water quality standards or are causing use impairment in the receiving water(s), the IEPA will notify the Permittee in writing. Upon receiving such notification, the Permittee shall develop and implement a CSO Long-Term Control Plan (LTCP) for assuring that the discharges from the CSOs (treated or untreated) authorized in this Permit comply with the provisions of Paragraph 10.a above. The LTCP shall contain all applicable elements of Paragraph 10.d below including a schedule for implementation and provisions for re-evaluating compliance with applicable standards and regulations after complete implementation. Two (2) copies of the LTCP shall be submitted to the IEPA within twelve (12) months of receiving the IEPA written notice. The LTCP shall be:
1. Consistent with Section II.C.4.a.i of the Policy; or,
 2. Consistent with either Section II.C.4.a.ii, Section II.C.4.a.iii, or Section II.C.4.b of the Policy and be accompanied by data sufficient to demonstrate that the LTCP, when completely implemented, will be sufficient to meet water quality standards.
- d. Pursuant to the Policy, the required components of the LTCP include the following:
1. Characterization, monitoring, and modeling of the Combined Sewer System (CSS);
 2. Consideration of Sensitive Areas;
 3. Evaluation of alternatives;
 4. Cost/Performance considerations;
 5. Revised CSO Operational Plan;
 6. Maximizing treatment at the treatment plant;
 7. Implementation schedule;
 8. Post-Construction compliance monitoring program; and
 9. Public participation.

Following submittal of the LTCP, the Permittee shall respond to any initial IEPA review letter in writing within ninety (90) days of the date of such a review letter, and within thirty (30) days of any subsequent review letter(s), if any. Implementation of the LTCP shall be as indicated by IEPA in writing or other enforceable mechanism.

12. A public notification program in accordance with Section II.B.8 of the federal CSO Control Policy of 1994 shall be developed employing a process that actively informs the affected public. The program shall include at a minimum public notification of CSO occurrences and CSO impacts, with consideration given to including mass media and/or Internet notification. The Permittee shall also consider posting signs in waters likely to be impacted by CSO discharges at the point of discharge and at points where these waters are used for primary contact recreation. Provisions shall be made to include modifications of the program when necessary and notification to any additional member of the affected public. The program shall be presented to the general public at a public information meeting conducted by the Permittee. The Permittee shall conduct the public information meeting within nine (9) months of the effective date of this Permit. The Permittee shall submit documentation that the public information meeting was held, shall submit a summary of all significant issues raised by the public and the Permittee's response to each issue and shall identify any modifications to the program as a result of the public information meeting. The Permittee shall submit the public information meeting documentation to the IEPA and implement the public notification program within twelve (12) months of the effective date of this Permit. The Permittee shall submit copies of the public notification program to the IEPA upon written request.
13. If any of the CSO discharge points listed in this Special Condition are eliminated, or if additional CSO discharge points, not listed in this Special Condition, are discovered, the Permittee shall notify the IEPA in writing within one (1) month of the respective outfall elimination or discovery. Such notification shall be in the form of a request for the appropriate modification of this NPDES Permit.

Special ConditionsH. Summary of Compliance Dates in this CSO Special Condition

14. The following summarizes the dates that submittals contained in this Special Condition are due at the IEPA (unless otherwise indicated):

Submission of CSO Monitoring Data (Paragraph 1)	25th of every month
Submission of Revised CSO O&M Plan (Paragraph 9)	1 month from revision date
Elimination of a CSO or Discovery of Additional CSO Locations (Paragraph 13)	1 month from discovery or elimination
Control (or Justification for No Control) of CSOs to Sensitive Areas (Paragraph 8)	3 months from IEPA notification
Certification of Sewer Use Ordinance Review (Paragraph 10) this Permit	6 months from the effective date of this Permit
Implement Post-Construction Monitoring Plan (Paragraph 10) approval	6 months from the date of IEPA plan approval
No Submittal Due with this Milestone	
Conduct Pollution Prevention, OMP and PN Public this Permit Information Meeting (Paragraphs, 7, 9 and 12)	9 months from the effective date of this Permit
No Submittal Due with this Milestone	
Submit Pollution Prevention Certification, OMP Certification and PN Information Meeting Summary (Paragraphs, 7, 9 and 12)	12 months from the effective date of this Permit
Submit CSO Long-Term Control Plan (Paragraph 10)	12 months from the date of IEPA notification

All submittals listed in this Special Condition can be mailed to the following address:

Illinois Environmental Protection Agency
 Division of Water Pollution Control
 Attention: CSO Coordinator, Compliance Assurance Section
 1021 North Grand Avenue East
 Post Office Box 19276
 Springfield, Illinois 62794-9276

All submittals hand carried shall be delivered to 1021 North Grand Avenue East.

I. Reopening and Modifying this Permit

15. The IEPA may initiate a modification for this Permit at any time to include requirements and compliance dates which have been submitted in writing by the Permittee and approved by the IEPA, or other requirements and dates which are necessary to carry out the provisions of the Illinois Environmental Protection Act, the Clean Water Act, or regulations promulgated under those Acts. Public Notice of such modifications and opportunity for public hearing shall be provided.

SPECIAL CONDITION 14: The Permittee shall work towards the goals of achieving no discharges from sanitary sewer overflows or basement back-ups and ensuring that overflows or back-ups, when they do occur do not cause or contribute to violations of applicable standards or cause impairment in any adjacent receiving water. Overflows from sanitary sewers are expressly prohibited by this permit and by Ill. Adm. Code 306.304. In order to accomplish these goals of complying with this prohibition and mitigating the adverse impacts of any such overflows if they do occur, the

Special Conditions

Permittee shall (A) identify and report to IEPA all SSOs that do occur, and (B) develop, implement and submit to the IEPA a Capacity, Management, Operations, and Maintenance (CMOM) plan which includes an Asset Management strategy within 12 months of the effective date of this Permit or review and revise any existing plan accordingly. The Permittee shall modify the Plan to incorporate any comments that it receives from IEPA and shall implement the modified plan as soon as possible. The Permittee should work as appropriate, in consultation with affected authorities at the local, county, and/or state level to develop the plan components involving third party notification of overflow events. The Permittee may be required to construct additional sewage transport and/or treatment facilities in future permits or other enforceable documents should the implemented CMOM plan indicate that the Permittee's facilities are not capable of conveying and treating the flow for which they are designed. The CMOM plan shall include the following elements:

A. Measures and Activities:

1. A complete map and system inventory for the collection system owned and operated by the Permittee;
2. Organizational structure; budgeting; training of personnel; legal authorities; schedules for maintenance, sewer system cleaning, and preventative rehabilitation; checklists, and mechanisms to ensure that preventative maintenance is performed on equipment owned and operated by the Permittee;
3. Documentation of unplanned maintenance;
4. An assessment of the capacity of the collection and treatment system owned and operated by the Permittee at critical junctions and immediately upstream of locations where overflows and backups occur or are likely to occur; use flow monitoring as necessary;
5. Identification and prioritization of structural deficiencies in the system owned and operated by the Permittee;
6. Operational control, including documented system control procedures, scheduled inspections and testing;
7. The Permittee shall develop and implement an Asset Management strategy to ensure the long-term sustainability of the collection system. Asset Management shall be used to assist the Permittee in making decisions on when it is most appropriate to repair, replace or rehabilitate particular assets and develop long-term funding strategies; and
8. Asset Management shall include but is not limited to the following elements:
 - a. Asset Inventory and State of the Asset;
 - b. Level of Service;
 - c. Critical Asset Identification;
 - d. Life Cycle Cost; and
 - e. Long-Term Funding Strategy.

B. Design and Performance Provisions:

1. Monitor the effectiveness of CMOM;
2. Upgrade the elements of the CMOM plan as necessary; and
3. Maintain a summary of CMOM activities.

C. Overflow Response Plan:

1. Know where overflows and back-ups within the facilities owned and operated by the Permittee occur;
2. Respond to each overflow or back-up to determine additional actions such as clean up; and
3. Locations where basement back-ups and/or sanitary sewer overflows occur shall be evaluated as soon as practicable for excessive inflow/infiltration, obstructions or other causes of overflows or back-ups as set forth in the System Evaluation Plan.

D. System Evaluation Plan:

1. Summary of existing SSO and Excessive I/I areas in the system and sources of contribution;
2. Evaluate plans to reduce I/I and eliminate SSOs;
3. Special provisions for Pump Stations and force mains and other unique system components; and
4. Construction plans and schedules for correction.

E. Reporting and Monitoring Requirements:

Special Conditions

1. Program for SSO detection and reporting; and
2. Program for tracking and reporting basement back-ups, including general public complaints.

F. Third Party Notice Plan:

1. Describes how, under various overflow scenarios, the public, as well as other entities, would be notified of overflows within the Permittee's system that may endanger public health, safety or welfare;
2. Identifies overflows within the Permittee's system that would be reported, giving consideration to various types of events including events with potential widespread impacts;
3. Identifies who shall receive the notification;
4. Identifies the specific information that would be reported including actions that will be taken to respond to the overflow;
5. Includes a description of the lines of communication; and
6. Includes the identities and contact information of responsible POTW officials and local, county, and/or state level officials.

For additional information concerning USEPA CMOM guidance and Asset Management please refer to the following web site addresses. http://www.epa.gov/npdes/pubs/cmom_guide_for_collection_systems.pdf and http://water.epa.gov/type/watersheds/wastewater/upload/guide_smallsystems_assetmanagement_bestpractices.pdf