

NPDES Permit No. IL0028592

Notice No. BDF:13091801.bah

Public Notice Beginning Date: **August 5, 2015**

Public Notice Ending Date: **September 4, 2015**

National Pollutant Discharge Elimination System (NPDES)  
Permit Program

PUBLIC NOTICE/FACT SHEET  
of  
Draft Reissued NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois EPA  
Division of Water Pollution Control  
Permit Section  
1021 North Grand Avenue East  
Post Office Box 19276  
Springfield, Illinois 62794-9276  
217/782-0610

Name and Address of Discharger:

Metro East Sanitary District  
1800 Edison Avenue  
P.O. Box 1366  
Granite City, Illinois 62040

Name and Address of Facility:

Metro East Facility Sanitary District  
Combined Sewer Overflows  
East St. Louis, Illinois  
(St. Clair County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES Permit to discharge into the waters of the state and has prepared a draft Permit and associated fact sheet for the above named discharger. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. All comments on the draft Permit and requests for hearing must be received by the IEPA by U.S. Mail, carrier mail or hand delivered by the Public Notice Ending Date. Interested persons are invited to submit written comments on the draft Permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the Permit applicant. The NPDES Permit and notice numbers must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft Permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicate a significant degree of public interest in the draft Permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final Permit is issued. For further information, please call Brant Fleming at 217/782-0610.

The following water quality and effluent standards and limitations were applied to the discharge:

Title 35: Environmental Protection, Subtitle C: Water Pollution, Chapter I: Pollution Control Board and the Clean Water Act were applied in determining the applicable standards, limitations and conditions contained in the draft Permit.

The applicant is engaged in conveying domestic and industrial wastewater from the Metro East Sanitary District service area to the Granite City WWTP.

The length of the Permit is approximately 5 years.

The main discharge number is 001, 002, and 003. The seven day once in ten year low flow (7Q10) of the receiving stream, Mississippi River is 46,500 cfs.


This Reissued Permit does not increase the facility's DAF, DMF, concentration limits, and/or load limits.

Pursuant to the waiver provisions authorized by 40 CFR § 123.24, this draft permit is within the class, type, and size for which the Regional Administrator, Region V, has waived his right to review, object, or comment on this draft permit action.

Application is made for the existing discharge(s) which are located in St. Clair County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

Discharge Number	Receiving Stream	Latitude	Longitude	Stream Classification	Integrity Rating
001	Mississippi River	38° 38' 14" North	90° 10' 26" West	General Use	Not Rated
002	Mississippi River	38° 38' 14" North	90° 10' 26" West	General Use	Not Rated
003	Mississippi River	38° 40' 06" North	90° 19' 47" West	General Use	Not Rated

To assist you further in identifying the location of the discharge(s) please see the attached map.

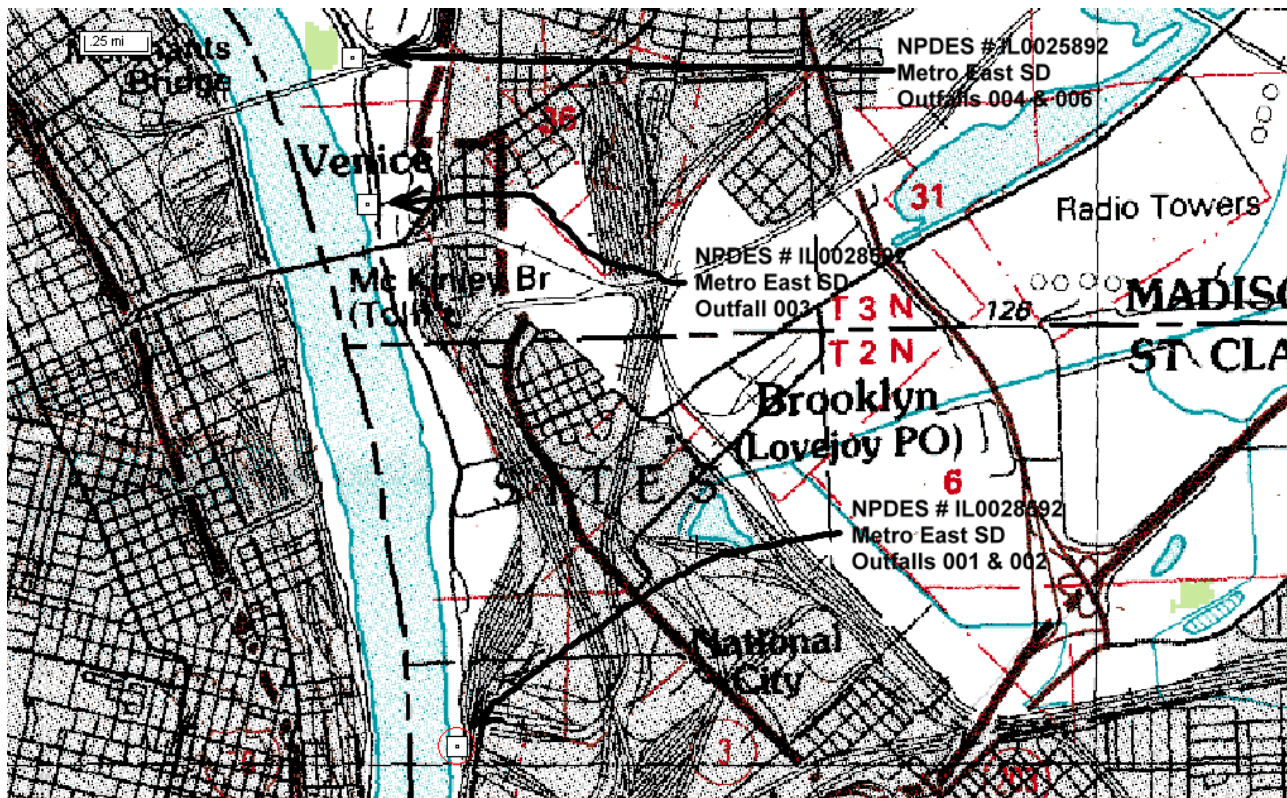

The stream segment(s) receiving the discharge from outfall(s) 001, 002 and 003 are on the 2014 303(d) list of impaired waters.

The following parameters have been identified as the pollutants causing impairment:

Potential Causes	Uses Impaired
Mercury and PCBs	Fish consumption

This draft Permit also contains the following requirements as special conditions:

1. Reopening of this Permit to include different final effluent limitations.
2. Submission of the operational data in a specified form and at a required frequency at any time during the effective term of this Permit.
3. Prohibition against causing or contributing to violations of water quality standards.

4. Recording the monitoring results on Discharge Monitoring Report Forms using one such form for each outfall each month and submitting the forms to IEPA each month.
5. An authorization of combined sewer and treatment plant discharges.

NPDES Permit No. IL0028592

Illinois Environmental Protection Agency

Division of Water Pollution Control

1021 North Grand Avenue East

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Reissued (NPDES) Permit

Expiration Date:

Issue Date:

Effective Date:

Name and Address of Permittee:

Metro East Sanitary District  
1800 Edison Avenue  
P.O. Box 1366  
Granite City, Illinois 62040

Facility Name and Address:

Metro East Facility Sanitary District  
Combined Sewer Overflows  
East St. Louis, Illinois  
(St. Clair County)

Receiving Waters: Mississippi River

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of the Ill. Adm. Code, Subtitle C, Chapter I, and the Clean Water Act (CWA), the above-named Permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the standard conditions and attachments herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the Permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Alan Keller, P.E.  
Manager, Permit Section  
Division of Water Pollution Control

SAK:BDF:13091801.bah

Special Conditions

SPECIAL CONDITION 1. This Permit may be modified to include different final effluent limitations or requirements which are consistent with applicable laws and regulations. The IEPA will public notice the permit modification.

SPECIAL CONDITION 2. The IEPA may request in writing submittal of operational information in a specified form and at a required frequency at any time during the effective period of this Permit.

SPECIAL CONDITION 3. The effluent, alone or in combination with other sources, shall not cause a violation of any applicable water quality standard outlined in 35 Ill. Adm. Code 302.

SPECIAL CONDITION 4. The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) Forms using one such form for each outfall each month.

In the event that an outfall does not discharge during a monthly reporting period, the DMR Form shall be submitted with no discharge indicated.

The Permittee may choose to submit electronic DMRs (NetDMRs) instead of mailing paper DMRs to the IEPA. More information, including registration information for the NetDMR program, can be obtained on the IEPA website, <http://www.epa.state.il.us/water/net-dmr/index.html>.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 25th day of the following month, unless otherwise specified by the permitting authority.

Permittees not using Net-DMRs shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency  
 Division of Water Pollution Control  
 Attention: Compliance Assurance Section, Mail Code # 19  
 1021 North Grand Avenue East  
 Post Office Box 19276  
 Springfield, Illinois 62794-9276

SPECIAL CONDITION 5.

AUTHORIZATION OF  
 COMBINED SEWER AND TREATMENT PLANT DISCHARGES

The IEPA has determined that at least a portion of the collection system consists of combined sewers. References to the collection system and the sewer system refer only to those parts of the system which are owned and operated by the Permittee unless otherwise indicated. The Permittee is authorized to discharge from the overflow(s)/bypass(es) listed below provided the diversion structure is located on a combined sewer and the following terms and conditions are met:

<u>Discharge Number</u>	<u>Location</u>	<u>Receiving Water</u>
001	Peak Flow Storage Facility CSO	Mississippi River
002	Landsdown Pumping Station CSO	Mississippi River
003	Venice Pump Station CSO	Mississippi River

A. CSO Monitoring, Reporting and Notification Requirements

- The Permittee shall monitor the frequency of discharge (number of discharges per month) and estimate the duration (in hours) of each discharge from each outfall listed in this Special Condition. Estimates of storm duration and total rainfall shall be provided for each storm event.

Start Date	Rainfall Duration (hrs.)	Rainfall Amount (in.)	CSO Outfall #	Outfall Description	Estimated Duration of CSO Discharge (hrs)	Estimated Volume of CSO Discharge (MG)
------------	--------------------------	-----------------------	---------------	---------------------	---	--

For frequency reporting, all discharges from the same storm, or occurring within 24 hours, shall be reported as one. The date that a discharge commences shall be recorded for each outfall. Reports shall be in the form specified by the IEPA and on forms provided by the IEPA (e.g., Form IL 532-2471, or updated form of same). These forms shall be submitted to the IEPA monthly with the DMRs and covering the same reporting period as the DMRs. Parameters (other than flow frequency and volume), if required in this Permit, shall be sampled and reported as indicated in the transmittal letter for such report forms.

Special Conditions

Discharge Number(s) and Name(s): 001 CSO Outfall (Peak Flow Storage Facility) 002 CSO Outfall (Landsdown Pumping Station) and 003 CSO Outfall (Venice Pump Station CSO)

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored at all times as follows:

		CONCENTRATION LIMITS mg/L			
<u>Parameter</u>			<u>Daily Maximum</u>	<u>Sample Frequency</u>	<u>Sample Type</u>
Total Flow (MG)	See Below			Daily When Discharging	Continuous
BOD <sub>5</sub>	Monitor Only			Once Per Discharge Event	Grab
Suspended Solids	Monitor Only			Once Per Discharge Event	Grab

Total flow in million gallons shall be reported on the Discharge Monitoring Report (DMR) in the quantity maximum. Flow shall be measured as allowed by current equipment.

BOD<sub>5</sub> and Suspended Solids shall be reported on the DMR as a monthly average concentration.

2. All submittals listed in this Special Condition can be mailed to the following address:

Illinois Environmental Protection Agency  
 Division of Water Pollution Control  
 1021 North Grand Avenue East  
 Post Office Box 19276  
 Springfield, Illinois 62794-9276

Attention: CSO Coordinator, Compliance Assurance Section

All submittals hand carried shall be delivered to 1021 North Grand Avenue East.

B. CSO Treatment Requirements

3. All combined sewer overflows shall be given sufficient treatment to prevent pollution and the violation of applicable water quality standards and to the extent required by the federal Clean Water Act, the 1994 CSO Control Policy including any amendments made by the Wet Weather Water Quality Act of 2000.
4. All CSO discharges authorized by this Permit shall be treated, in whole or in part, to the extent necessary to prevent accumulations of sludge deposits, floating debris and solids in accordance with 35 Ill. Adm. Code 302.203 and to prevent depression of oxygen levels below the applicable water quality standards.
5. Overflows during dry weather are prohibited. Dry weather overflows shall be reported to the IEPA pursuant to Standard Condition 12(f) of this Permit (24 hour notice).
6. The collection system shall be operated to optimize transport of wastewater flows and to minimize CSO discharges and the treatment system, if applicable, shall be operated to maximize treatment of wastewater flows.

C. CSO Nine Minimum Controls

7. The Permittee shall comply with the nine minimum controls contained in the National CSO Control Policy published in the Federal Register on April 19, 1994. The nine minimum controls are:
  - a. Proper operation and maintenance programs for the sewer system and the CSOs;
  - b. Maximum use of the collection system for storage;
  - c. Review and modification of pretreatment requirements to assure CSO impacts are minimized;
  - d. Maximization of flow to the POTW for treatment;
  - e. Prohibition of CSOs during dry weather;

Special Conditions

- f. Control of solids and floatable materials in CSOs;
- g. Pollution prevention programs which focus on source control activities;
- h. Public notification to ensure that citizens receive adequate information regarding CSO occurrences and CSO impacts; and,
- i. Monitoring to characterize impacts and efficiency of CSO controls.

A CSO pollution prevention plan (PPP) shall be developed by the Permittee unless one has already been prepared for this collection system. Any previously-prepared PPP shall be reviewed, and revised if necessary, by the Permittee to address the items contained in Chapter 8 of the U.S. EPA guidance document, Combined Sewer Overflows, Guidance For Nine Minimum Controls, and any items contained in previously-sent review documents from the IEPA concerning the PPP. Combined Sewer Overflows, Guidance For Nine Minimum Controls is available on line at <http://www.epa.gov/npdes/pubs/owm0030.pdf>. The PPP (or revised PPP) shall be presented to the general public at a public information meeting conducted by the Permittee annually during the term of this Permit. The Permittee shall submit documentation that the pollution prevention plan complies with the requirements of this Permit and that the public information meeting was held. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Pollution Prevention Plan Certification" one (1) with original signatures. This certification form is available online at <http://www.epa.state.il.us/water/permits/waste-water/forms/cso-pol-prev.pdf>. Following the public meeting, the Permittee shall implement the pollution prevention plan and shall maintain a current pollution prevention plan, updated to reflect system modifications, on file at the sewage treatment works or other acceptable location and made available to the public. The pollution prevention plan revisions shall be submitted to the IEPA one (1) month from the revision date.

D. Sensitive Area Considerations

- 8. Pursuant to Section II.C.3 of the federal CSO Control Policy of 1994, sensitive areas are any water likely to be impacted by a CSO discharge which include one or more of the following criteria: (1) designated as an Outstanding National Resource Water; (2) found to contain shellfish beds; (3) found to contain threatened or endangered aquatic species or their habitat; (4) used for primary contact recreation; (5) National Marine Sanctuaries; or, (6) within the protection area for a drinking water intake structure.

The IEPA has tentatively determined that none of the outfalls listed in this Special Condition discharge to sensitive areas. However, if information becomes available that causes the IEPA to reverse this determination, the IEPA will notify the Permittee in writing. Upon the date contained in the notification letter, the Permittee shall revise the LTCP and schedule to eliminate or relocate these outfalls. If elimination or relocation is not economically feasible or technically achievable the permittee shall submit a revised plan and schedule for treating the discharge. Such justification shall be in accordance with Section II.C.3 of the National CSO Control Policy.

E. CSO Operational and Maintenance Plans

- 9. The IEPA reviewed and accepted a CSO operational and maintenance plan "CSO O&M plan" on July 14, 1997 and a revised CSO operational and maintenance plan was received April 5, 2007 prepared for this sewerage system. The Permittee shall fully implement the approved plan and review and revise, if needed, the CSO O&M plan to reflect system changes.

The CSO O&M plan shall be presented to the general public at a public information meeting conducted by the Permittee within nine (9) months of the effective date of this Permit or within nine (9) months of the CSO system being modified. The Permittee shall submit documentation that the CSO O&M plan complies with the requirements of this Permit and that the public information meeting was held. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit or within three (3) months of the public meeting and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Operational Plan Checklist and Certification", one (1) with original signatures. Copies of the "CSO Operational Plan Checklist and Certification" are available online at <http://www.epa.state.il.us/water/permits/waste-water/forms/cso-checklist.pdf>. Following the public meeting, the Permittee shall maintain a current CSO O & M plan, updated to reflect system modifications, on file at the sewage treatment works or other acceptable location and made available to the public. The CSO O & M plan revisions shall be submitted to the IEPA one (1) month from the revision date.

Special Conditions

The objectives of the CSO O&M plan are to reduce the total loading of pollutants and floatables entering the receiving stream and to ensure that the Permittee ultimately achieves compliance with water quality standards. These plans, tailored to the local government's collection and waste treatment systems, shall include mechanisms and specific procedures where applicable to ensure:

- a. Collection system inspection on a scheduled basis;
- b. Sewer, catch basin, and regulator cleaning and maintenance on a scheduled basis;
- c. Inspections are made and preventive maintenance is performed on all pump/lift stations;
- d. Collection system replacement, where necessary;
- e. Detection and elimination of illegal connections;
- f. Detection, prevention, and elimination of dry weather overflows;
- g. The collection system is operated to maximize storage capacity and the combined sewer portions of the collection system are operated to delay storm entry into the system; and,
- h. The treatment and collection systems are operated to maximize treatment.

F. Sewer Use Ordinances

10. The Permittee, within six (6) months of the effective date of this Permit, shall review and where necessary, modify its existing sewer use ordinance to ensure it contains provisions addressing the conditions below. If no ordinance exists, such ordinance shall be developed and implemented within six (6) months from the effective date of this Permit. Upon completion of the review of the sewer use ordinance(s), the Permittee shall submit two (2) copies of a completed "Certification of Sewer Use Ordinance Review", one (1) with original signatures. Copies of the certification form can be obtained on line at <http://www.epa.state.il.us/water/permits/waste-water/forms/sewer-use.pdf>. The Permittee shall submit copies of the sewer use ordinance(s) to the IEPA one (1) month from the revision date. Sewer use ordinances are to contain specific provisions to:
  - a. Prohibit introduction of new inflow sources to the sanitary sewer system;
  - b. Require that new sanitary sewer construction tributary to the combined sewer system be designed to minimize and/or delay inflow contribution to the combined sewer system;
  - c. Require that inflow sources on the combined sewer system be connected to a storm sewer, in accordance with the approved Long Term Control Plan;
  - d. Provide that any new building domestic sewage connection shall be distinct from the building inflow connection;
  - e. Assure that CSO impacts from industrial and/or commercial sources are minimized and control by determining which industrial and/or commercial discharges that are tributary to CSOs; and,
  - f. Assure that the owners of all publicly owned systems with sewers tributary to the Permittee's collection system have procedures in place adequate to ensure that the objectives, mechanisms, and specific procedures given in Paragraph 10 of this Special Condition are achieved.

The Permittee shall enforce the applicable sewer use ordinances.

G. CSO Long-Term Control Planning and Compliance with Water Quality Standards

11. A. Pursuant to Section 301 of the federal Clean Water Act, 33 U.S.C. § 1311 and 40 CFR § 122.4, discharges from the CSOs, including the outfalls listed in this Special Condition and any other outfall listed as a "Treated Combined Sewage Outfall", shall not cause or contribute to violations of applicable water quality standards or cause use impairment in the receiving waters. In addition, discharges from CSOs shall comply with all applicable parts of 35 Ill. Adm. Code 306.305(a), (b), (c), and (d).
- B. The long term control plan (LTCP) received September 21, 2010 was approved on September 17, 2012 and listed in item 14 of this special condition, and once implemented, will meet the presumptive approach prescribed by Section II C.4.a.i of the federal CSO Control Policy by having no more than an average of four overflow events per year for Outfalls 001, 002 and 003. All provisions of this Special Condition shall stay in effect prior to and after completion of



Special Conditions

construction. Pursuant to Section I.C.1 and Section II.C.9 of the Policy, the Permittee shall develop a post-construction water quality monitoring program adequate to verify compliance with water quality standards and to verify protection of designated uses in the receiving water(s) and to ascertain the effectiveness of CSO controls. Guidance on post construction monitoring plans is available at:

[http://www.epa.gov/npdes/pubs/final\\_draft\\_cso\\_pccm\\_guidance.pdf](http://www.epa.gov/npdes/pubs/final_draft_cso_pccm_guidance.pdf). This program shall contain a plan that details the monitoring protocols to be followed, including any necessary effluent and ambient monitoring, and if appropriate, other monitoring protocols such as biological assessments, whole effluent toxicity testing, and sediment sampling. This plan shall be presented to the public at an informational meeting 15 months prior to construction completion. The Permittee shall submit 12 months prior to construction completion a summary of all significant issues raised by the public, the Permittee's response to each issue, and three (3) copies of the final plan (revised following the public meeting, if necessary) implementing the post-construction monitoring program. The post-construction monitoring plan shall be implemented within six (6) months of the date of IEPA approval. The Permittee shall respond to an IEPA review letter in writing within ninety (90) days of the date of such an initial review letter and within thirty (30) days of any subsequent review letter(s), if any. Within thirty (30) months of the approval of the plan, the results shall be submitted to the IEPA along with recommendations and conclusions as to whether or not the discharges from any of the CSOs (treated or untreated) authorized by this Permit are causing or contributing to violations of applicable water quality standards or causing use impairment in the receiving water(s).

- c. Should the results of the post-construction water quality monitoring plan or if information becomes available that causes IEPA to conclude that the discharges from any of the CSOs (treated or untreated) authorized to discharge under this Permit are causing or contributing to violations of water quality standards or are causing use impairment in the receiving water(s), the IEPA will notify the Permittee in writing. Upon receiving such notification, the Permittee shall develop and implement a CSO Long-Term Control Plan (LTCP) for assuring that the discharges from the CSOs (treated or untreated) authorized in this Permit comply with the provisions of Paragraph 10.a above. The LTCP shall contain all applicable elements of Paragraph 10.d below including a schedule for implementation and provisions for re-evaluating compliance with applicable standards and regulations after complete implementation. Three (3) copies of the LTCP shall be submitted to the IEPA within twelve (12) months of receiving the IEPA written notice. The LTCP shall be:
1. Consistent with Section II.C.4.a.i of the Policy; or,
  2. Consistent with either Section II.C.4.a.ii, Section II.C.4.a.iii, or Section II.C.4.b of the Policy and be accompanied by data sufficient to demonstrate that the LTCP, when completely implemented, will be sufficient to meet water quality standards.
- d. Pursuant to the Policy, the required components of the LTCP include the following:
1. Characterization, monitoring, and modeling of the Combined Sewer System (CSS);
  2. Consideration of Sensitive Areas;
  3. Evaluation of alternatives;
  4. Cost/Performance considerations;
  5. Revised CSO Operational Plan;
  6. Maximizing treatment at the treatment plant;
  7. Implementation schedule;
  8. Post-Construction compliance monitoring program; and
  9. Public participation.

Following submittal of the LTCP, the Permittee shall respond to any initial IEPA review letter in writing within ninety (90) days of the date of such a review letter, and within thirty (30) days of any subsequent review letter(s), if any. Implementation of the LTCP shall be as indicated by IEPA in writing or other enforceable mechanism.

12. A public notification program in accordance with Section II.B.8 of the federal CSO Control Policy of 1994 shall be developed employing a process that actively informs the affected public. The program shall include at a minimum public notification of CSO occurrences and CSO impacts, with consideration given to including mass media and/or Internet notification. The Permittee shall post and maintain signs in waters likely to be impacted by CSO discharges at the point of discharge and at points where these waters are used for primary contact recreation. Signage's message should be visible from both shoreline and water vessel approach (if appropriate), respectively. Provisions shall be made to include modifications of the program when necessary and notification to any additional member of the affected public. The program shall be presented to the general public at a public information meeting conducted by the Permittee. The Permittee shall conduct the public information meeting providing a summary and status of the CSO control program annually during the term of this Permit. The Permittee shall submit documentation that the public information meeting was held, shall submit a summary of all significant issues raised by the public and the Permittee's response to each issue, and shall identify any modifications to the program as a result of the public information meeting within 60 days of holding the public meeting. The Permittee shall submit copies of the public notification program to the IEPA upon written request.

Special Conditions

13. If any of the CSO discharge points listed in this permit are eliminated, or if additional CSO discharge points, not listed in this permit, are discovered, the Permittee shall notify the IEPA in writing within one (1) month of the respective outfall elimination or discovery. Such notification shall be in the form of a request for the appropriate modification of this NPDES Permit.

H. Summary of Compliance Dates in this CSO Special Condition

14. The following summarizes the dates that submittals contained in this Special Condition are due at the IEPA (unless otherwise indicated):

Submission of CSO Monitoring Data (Paragraph 1)	15th of every month
Submission of Revised CSO O&M Plan (Paragraphs 7 and 9)	1 month from revision date
Elimination of a CSO or Discovery of Additional CSO elimination	1 month from discovery or Locations (Paragraph 13)
Certification of Sewer Use Ordinance Review (Paragraph 10)	6 months from the effective date of this Permit
Conduct OMP Public Information Meeting (Paragraph 9) <b>No Submittal Due with this Milestone</b>	9 months from the effective date of this Permit
Submit Pollution Prevention Certification and OMP Certification (Paragraphs 7 and 9)	12 months from the effective date of this Permit
Submit PN Information Meeting Summary (Paragraph 12)	60 days after public meeting
Submit CSO Long-Term Control Plan (Paragraph 11)	12 months from written notice

Action Item

Dates

Interim Reports	6 months from the effective date of this permit and every 6 months there after
Complete design of weir height increase.	December 2015
Complete construction of weir.	March 2016
Evaluate effectiveness of weir.*	March 2017
Submittal of Post Construction Compliance Monitoring Plan.	May 2016
Implement Post-Construction Monitoring Plan.	6 months from the date of IEPA plan approval

CSO Long-Term Control Plan improvements include increasing weir heights at CSOs 001, 002 and 003.

\*Construct disinfection equipment or increase pumping to Granite City WWTP if necessary.

All submittals listed in this Special Condition can be mailed to the following address:

Illinois Environmental Protection Agency  
 Division of Water Pollution Control  
 1021 North Grand Avenue East  
 Post Office Box 19276  
 Springfield, Illinois 62794-9276

Attention: CSO Coordinator, Compliance Assurance Section

All submittals hand carried shall be delivered to 1021 North Grand Avenue East.

I. Reopening and Modifying this Permit

15. The IEPA may initiate a modification for this Permit at any time to include requirements and compliance dates which have been submitted in writing by the Permittee and approved by the IEPA, or other requirements and dates which are necessary to carry out the provisions of the Illinois Environmental Protection Act, the Clean Water Act, or regulations promulgated under those Acts. Public Notice of such modifications and opportunity for public hearing shall be provided.